




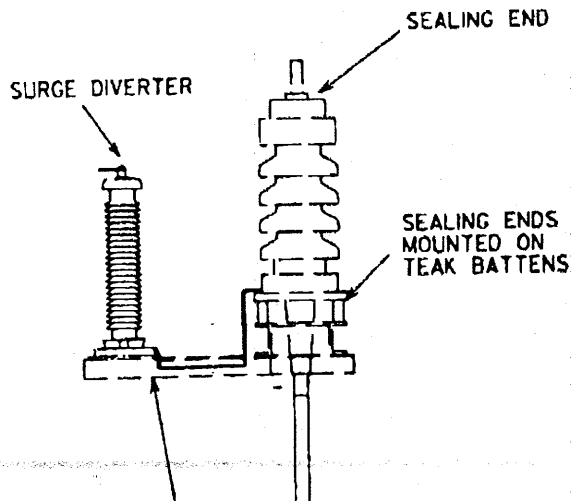

THE BASE PLATES OF THE SEALING ENDS AND THE EARTH TERMINALS OF THE SURGE DIVERTER ARE TO BE BONDED USING THE EARTH BAR ASSEMBLY ITEM 10

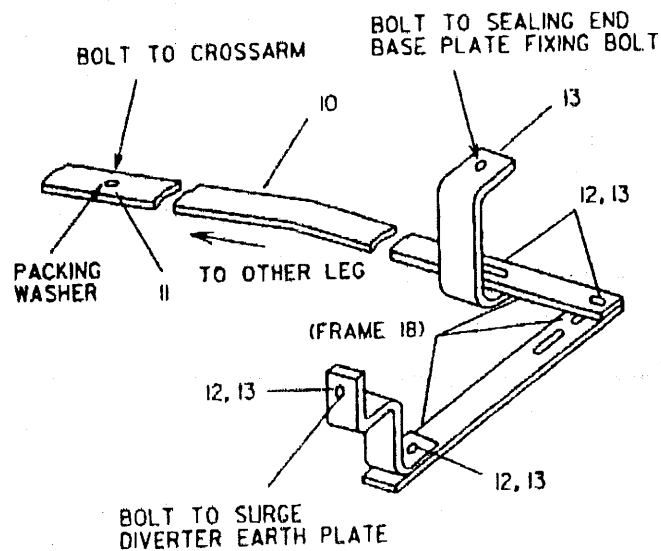

EARTH BAR ASSEMBLY

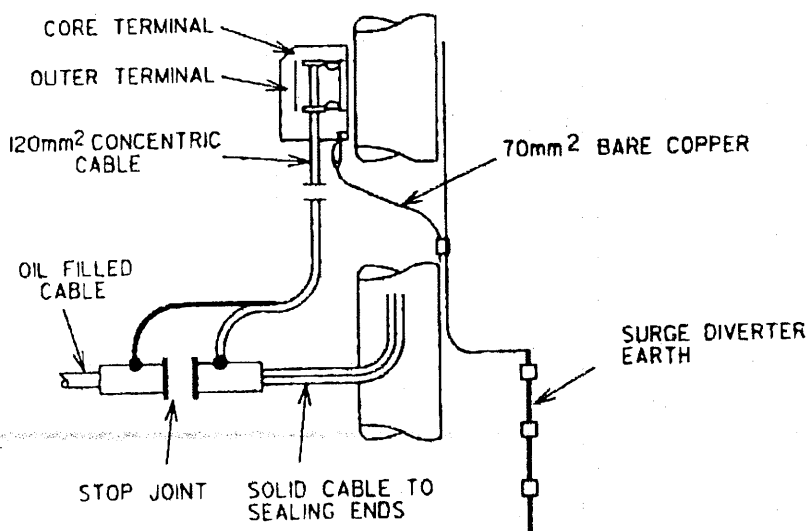

DISCONNECTING LINK BOX

SCHEDULE:- E6005
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6005-1 SHT 2

**UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN
ELECTRIC**

**33 kV DOUBLE CIRCUIT
'H' TERMINAL POLE (CABLE)
BONDING DETAILS**

Scale:- N.T.S.
Drm. by:- D.K.W.
Tcd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres
Drawing no.
HO37/6005 SHT 3 OF 5
C.A.D. Reference. HO6005.37

