
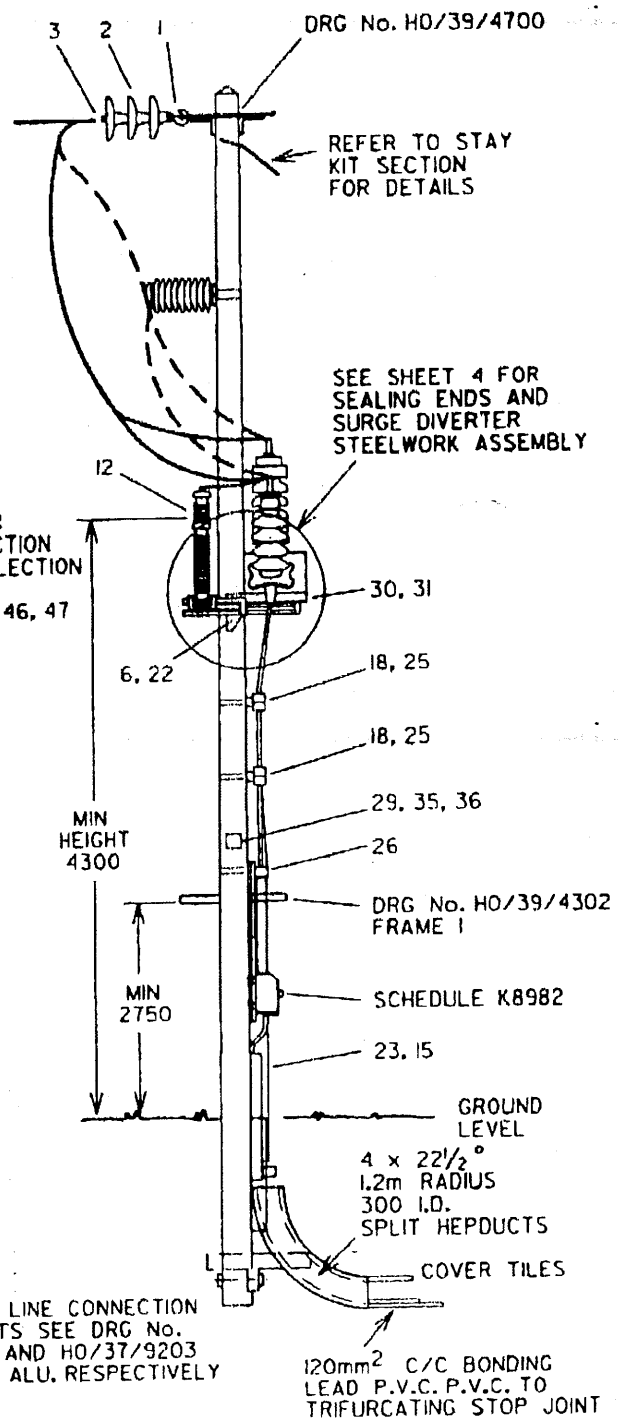


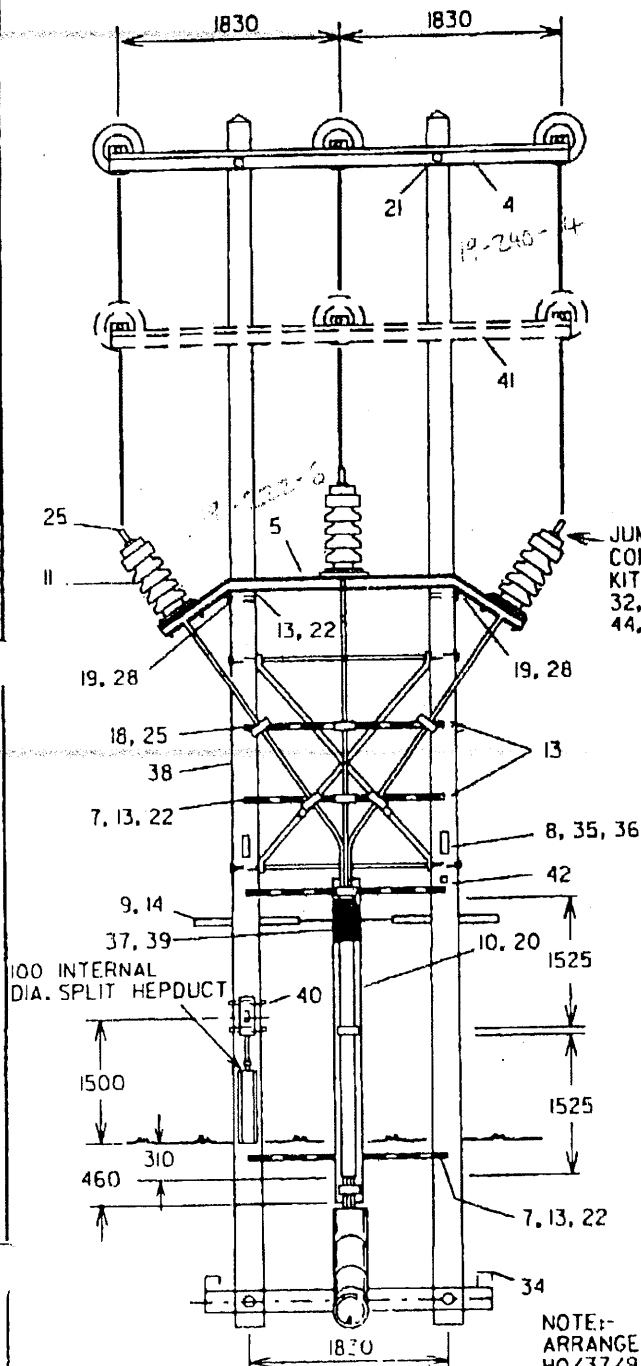

NOTE:- FOR LINE CONNECTION ARRANGEMENTS SEE DRG No. HO/37/9202 AND HO/37/9203 FOR CU. AND ALU. RESPECTIVELY

ITEM 24 EARTHING DETAIL: SEE DRG No. HO/37/2019 SHT 2

ITEM 38 POLE DRILLING DETAILS SEE DRG No. HO/37/2019 SHT 5

APPLICATION:- 10-20 In² COPPER UP TO 250 sq.mm
AL.AL. CONDUCTOR 300mm² (SINGLE) CABLE

SCHEDULE:- A2019
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A2019

**UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33kV 'H' TERMINAL POLE (300mm² CABLE)**

Scale:- N.T.S.
Dwn. by:- D.K.W.
Tcd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.
HO/37/2019 SHT 1 OF 5
C.A.D. Reference. HO2019.37

