




Original Issue
Date: 14-10-92

ISSUE I
POLE MARKING &
ROOFING ADDED.
D.K.M. MAR 93

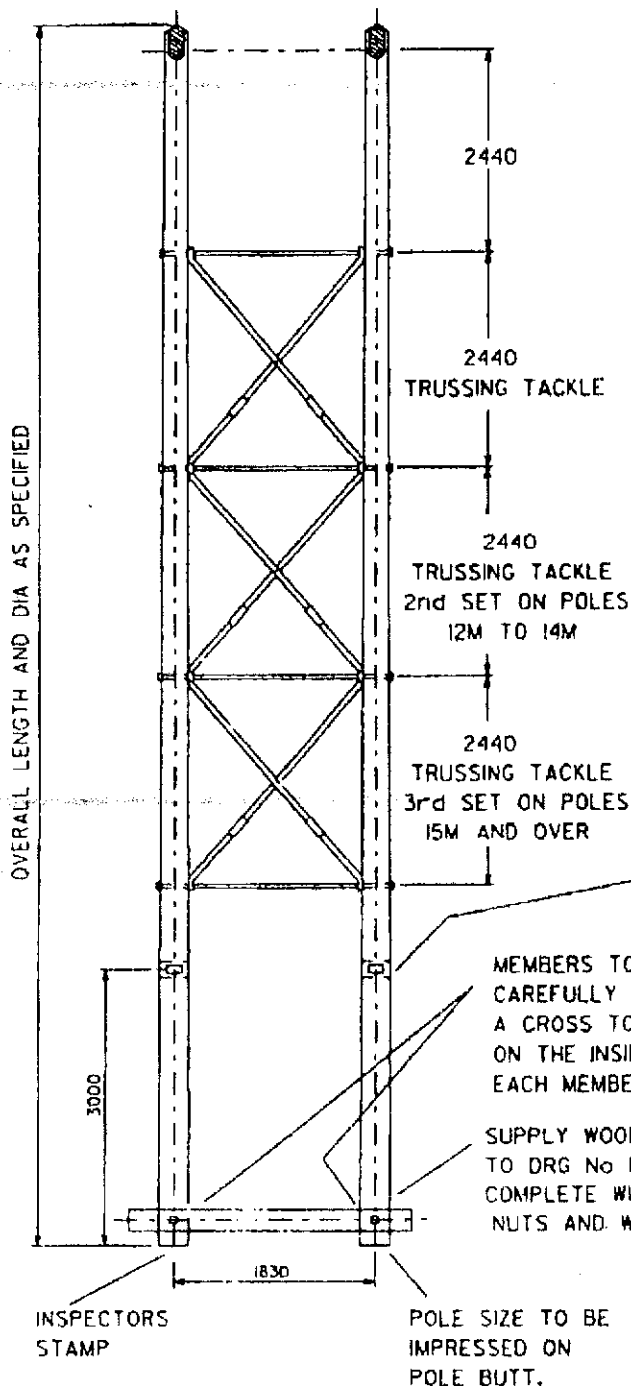

POLE SCARFING ON BOTH SIDES CUT TO GIVE A 90mm FACE AND THE ENDS CHAMFERED OFF BEYOND THE LENGTH SHOWN.

POLE MARKINGS AND ROOFING TO DRG No H0/39/4407



NOTES.
1. SUPPLY TRUSSING TACKLE TO DRG No. H0/39/172 TYPES I, 6 OR II
2. ALL DRILLING 22 DIA
SCHEDULE:-P2010
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF No:-A2010

FOR ASSEMBLY DRAWINGS NO. H0/37/2014, 2015, 2016

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

**POLE DRILLING, SCARFING AND MARKING
33kV S.C. 'H' POLE
1830 POLE CENTRES**

Scale:- N.T.S.
Dwn. by:- D.K.W.
Yed. by:- D.K.M.
Chd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.

HO /37 /2010

C.A.D. Reference: HO2010.37

A4P

DATE PLOTTED 27-OCT-1993