

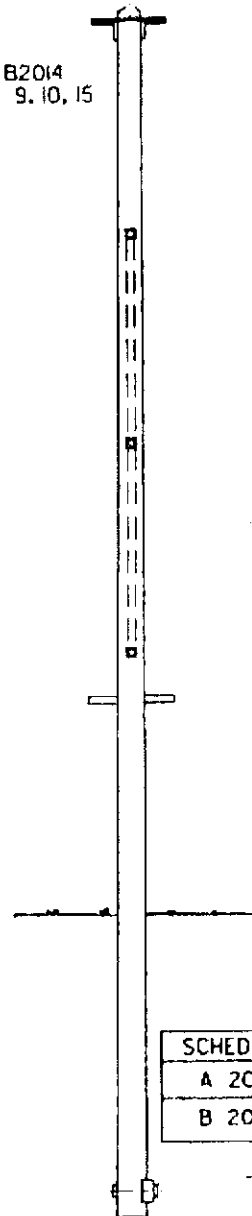
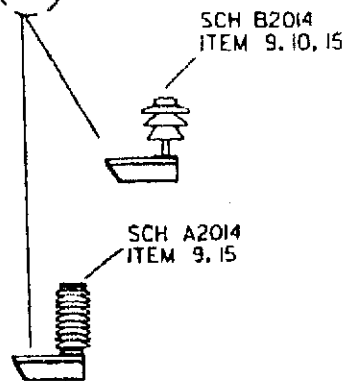


Original Issue
Date:- 14-10-92

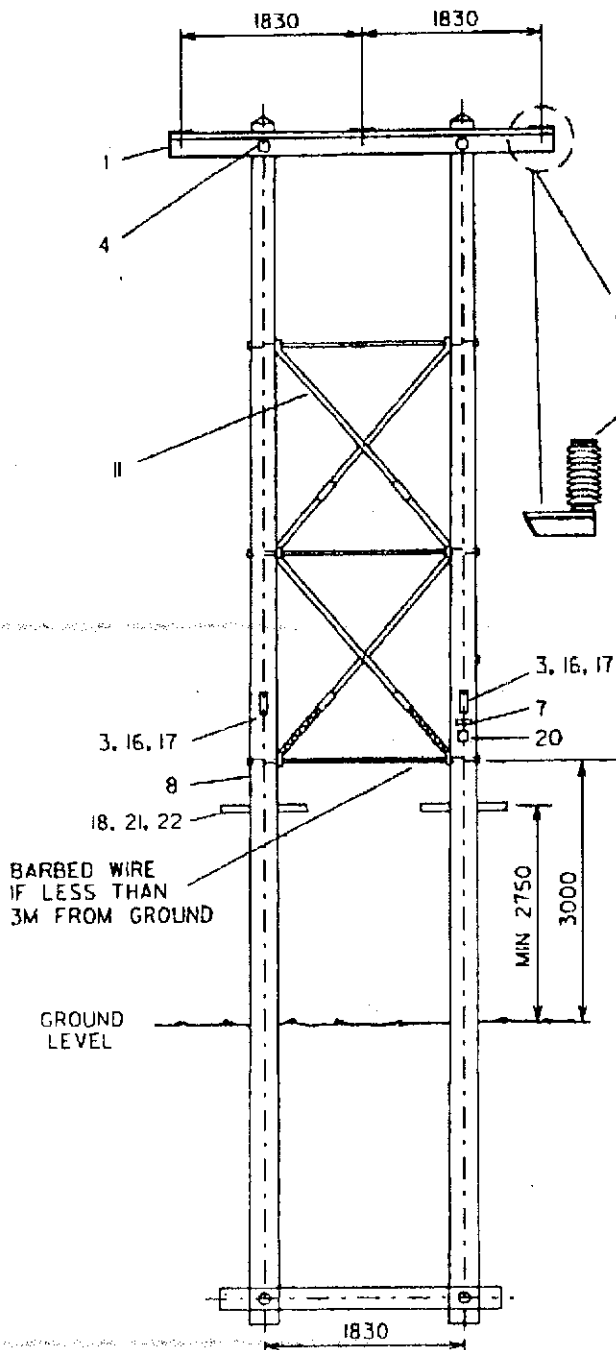

SCHEDULE	USAGE
A 2014	COASTAL AREAS
B 2014	INLAND AREAS

POLE LENGTH (m)	PLANTING DEPTH (m)
8.5 TO 14	1.8
15 TO 20	2.1

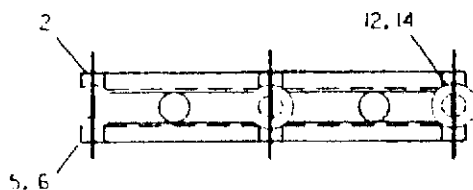

POLE DRILLING AND SCARFING IN ACCORDANCE WITH DRG No. HO/37/2010

ITEM 13 EARTH KIT FOR TRUSSING TACKLE
SEE REF No. HO/37/8983

APPLICATION:- ALL CONDUCTORS UP TO AND INCLUDING 0.2sq.in CU. 250sq.mm AAA

SCHEDULE:- A2014
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF No:- A2014

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

GENERAL ASSEMBLY
33kV SINGLE CIRCUIT, INTERMEDIATE
'H' POLE, 1830 PHASE SPACING

Scale:- N.T.S.
Dwn. by:- D.K.W.
Tcd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres
Drawing no.
HO /37 /2014
C.A.D. Reference. HO2014.37

A4P

DATE PLOTTED 27-OCT-1993