


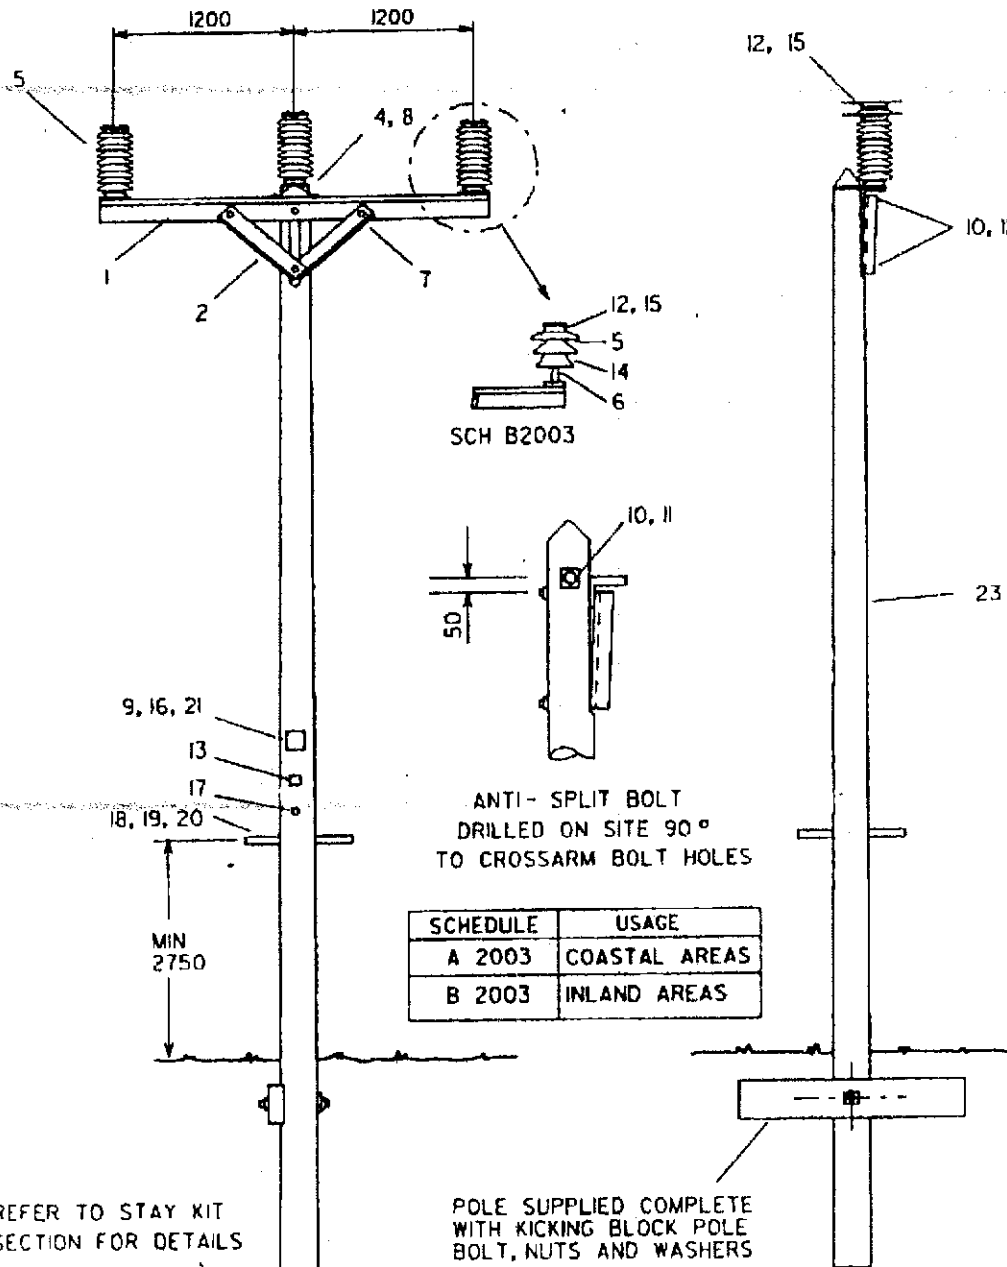

REFER TO STAY KIT
SECTION FOR DETAILS

POLE SUPPLIED COMPLETE
WITH KICKING BLOCK POLE
BOLT, NUTS AND WASHERS

SCHEDULE	USAGE
A 2003	COASTAL AREAS
B 2003	INLAND AREAS

POLE LENGTH (m)	PLANTING DEPTH (m)
8.5 TO 14	1.8
15 TO 20	2.1

NOTE:- SCHEDULE A2003 ALL LINES WITHIN
24 KILOMETRES OF THE COAST

LIMITATION:- MAX CONDUCTOR SIZES 100 sq.mm
AL. ALLOY AND 70sq.mm CU. MAX 1:10 DOWNPULL

APPLICATION:- UP TO 5° ANGLE ON PIN/POST INSULATORS

POLE DRILLING AND SCARFING IN
ACCORDANCE WITH DRG No. HO/37/2001

SCHEDULE A2003
33KV HEAVY CONSTRUCTION
SUPERSEDES DRG REF. A2003

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied or the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

GENERAL ASSEMBLY PIN / POST ANGLE POLE

Scale:- N.T.S.
Dm. by:- D.K.W.
Tel. by:- D.K.M.
Cld. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres
Drawing no.
HO /37 /2003
C.A.D. Reference. HO2003.37