


Original Issue
Date:- OCT 92

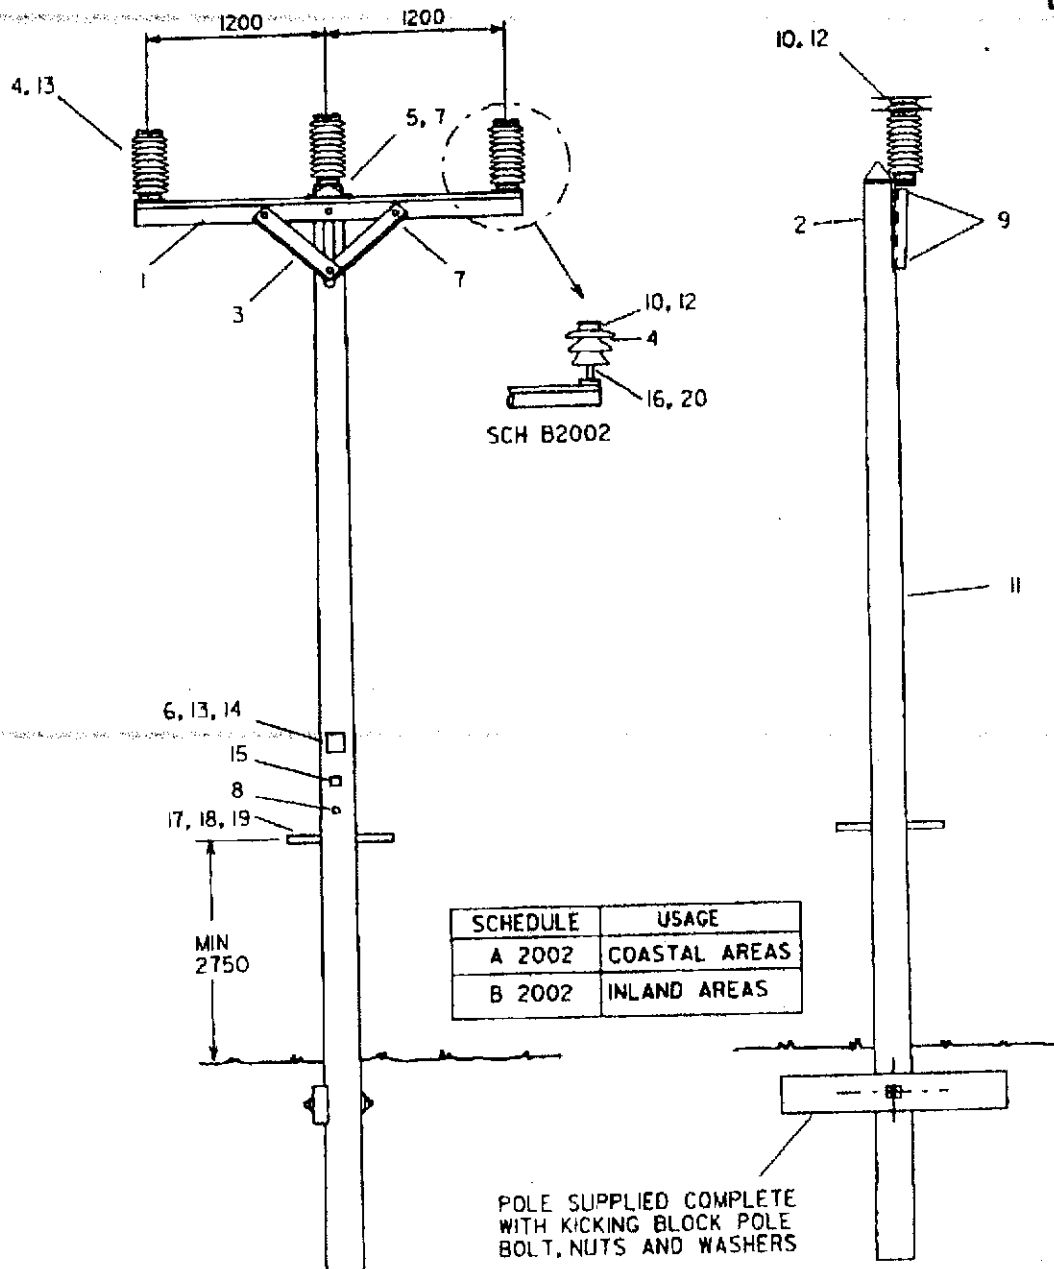

NOTE:- SCHEDULE A2002 ALL LINES WITHIN 24 KILOMETRES OF THE COAST

LIMITATION:- MAX CONDUCTOR SIZES 150 sq.mm AL. ALLOY (140m) & 70sq.mm CU.
1:10 DOWNPULL

POLE LENGTH (m)	PLANTING DEPTH (m)
8.5 TO 14	1.8
15 TO 20	2.1

POLE DRILLING AND SCARFING IN ACCORDANCE WITH DRG No. HO/37/2001

SCHEDULE A2002
33KV HEAVY CONSTRUCTION
SUPERSEDES DRG REF. A2002

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

GENERAL ASSEMBLY INTERMEDIATE POLE

Scale:- N.T.S.
Dwn. by:- D.K.W.
Ted. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres
Drawing no.
HO /37 /2002
C.A.D. Reference. HO2002.37

AAP

DATE PLOTTED 27-OCT-1993