




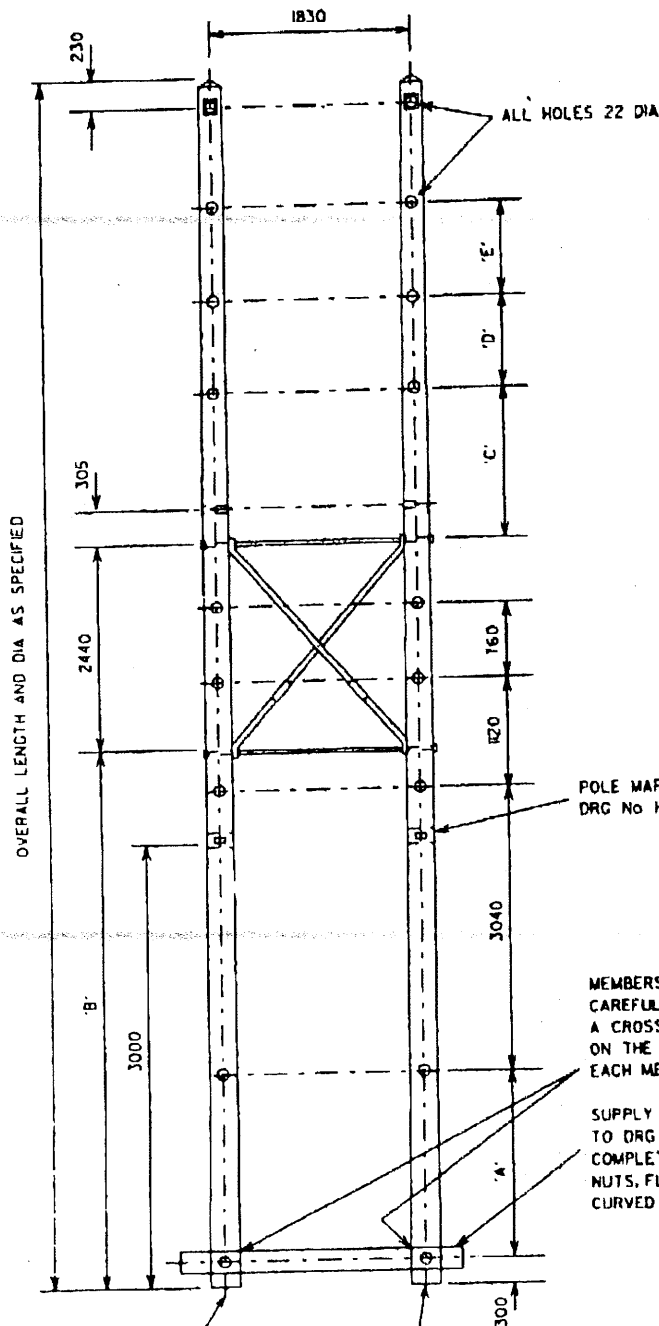

POLE TO BE EVENLEY QUARTERED
APEX 120°



POLE SLOTS ON BOTH SIDES
CUT TO GIVE A 50mm FACE



SUPPLY WOOD BRACE BLOCK
TO DRG No HO/38/513
COMPLETE WITH POLE BOLTS,
NUTS, FLAT AND SQUARE WASHERS

POLE MARKINGS TO
DRG No HO/39/4407

MEMBERS TO BE
CAREFULLY MATCHED
A CROSS TO BE CUT
ON THE INSIDE OF
EACH MEMBER

SUPPLY WOOD BRACE BLOCK
TO DRG No. HO/38/514
COMPLETE WITH POLE BOLTS,
NUTS, FLAT AND SQUARE
CURVED WASHERS

POLE LENGTH	DIMENSION				
	'A'	'B'	'C'	'D'	'E'
10-11m	1430	4970	—	—	—
12-13m	1730	5270	3450	—	—
14-15m	2040	5580	3200	1900	—
16m	2040	5580	3980	1900	—
17m	2040	5580	3980	2400	—
18m	2040	5580	3980	2900	—

SUPPLY:- TRUSSING TACKLE TO DRG No. HO/39/172 TYPE 4 OR 9

SCHEDULE- P2019
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A2019-2

**UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN
ELECTRIC**

**POLE DRILLING SCARFING AND MARKING
33kV 'H' TERMINAL POLE (300mm² CABLE)
HEAVY CONSTRUCTION**

Scale:- N.T.S.
Drm. by:- D.K.W.
Ycd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.
HO/37/2019 SHY 5 OF 5
C.A.D. Reference. HO2019.37

