

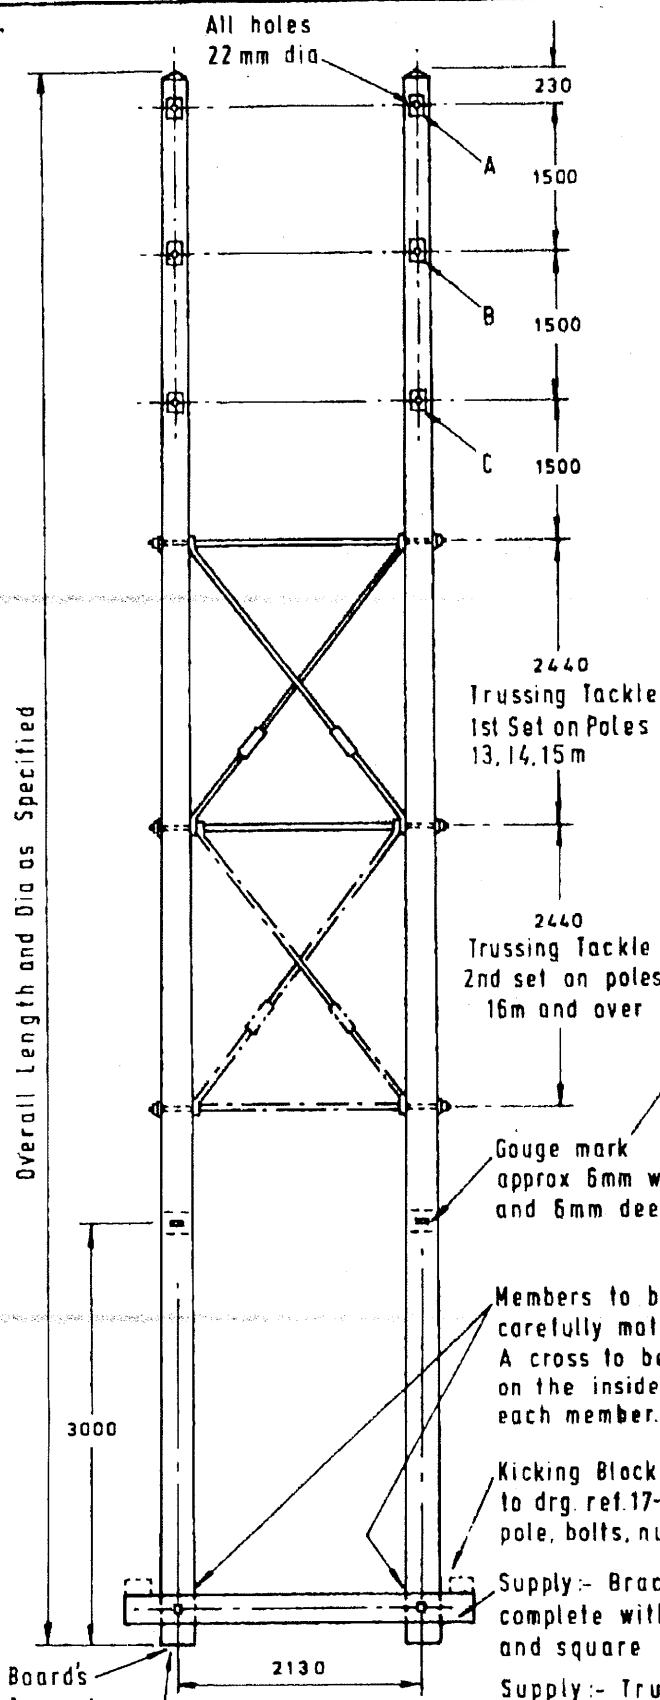


Original frame size 287mm x 180mm

southern electricity



Pole to be evenly quartered Apex 120°

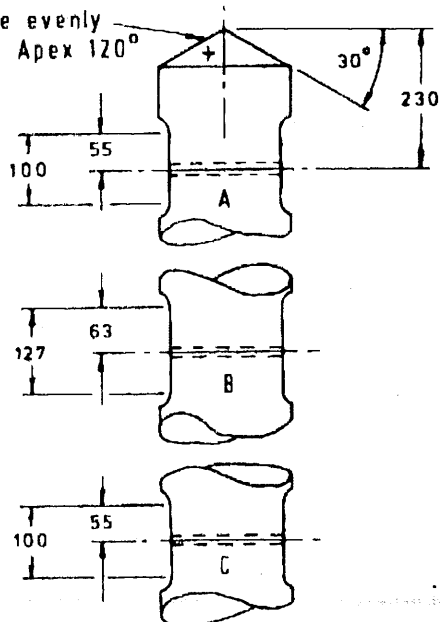

Reference

12 = Length of pole in metres

+ = Denotes Large Pole Head


M = Grade of pole

Medium or Stout as defined in BS 1990

I.F. = Imported Scots Pine

83 = Year of preservation

ABC = Suppliers name or mark

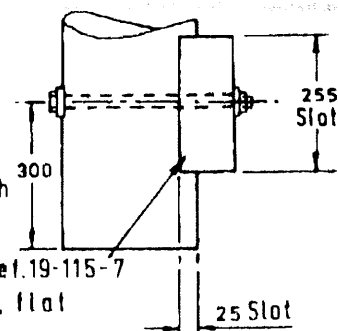

Board's Inspectors Brand

Pole size to be impressed on pole butt

Dimensions in Millimetres

Heavy Construction

Drawing Replaces:- 4/71, 4/246.

Pole Drilling, Scarfing and Marking
33kV Double Circuit
Intermediate 'H' Pole, 1500 Spacing.

Scale :- N.T.S.

Drn by :- D.K.W.

App by :- A.T.R.

Issue 1 / April-84

E.S.I.

Ref :-

Drawing

Ref :-

A6001-2

