


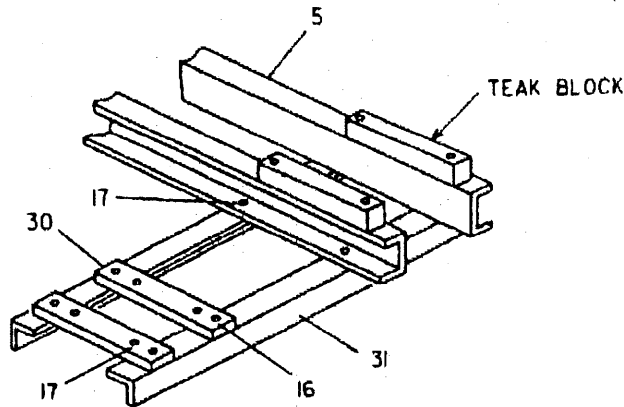


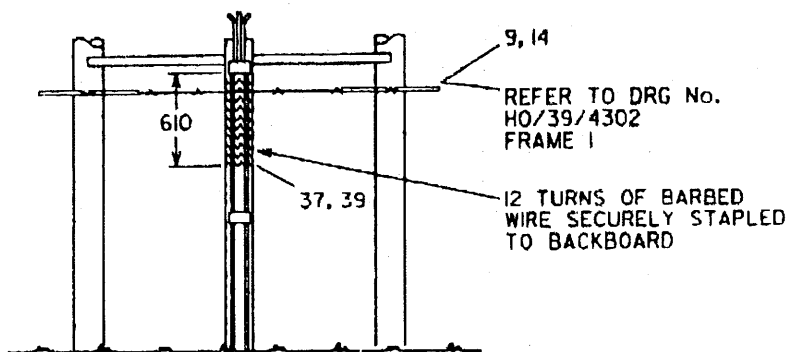


ERECTION OF SURGE  
ARRESTOR STEELWORK

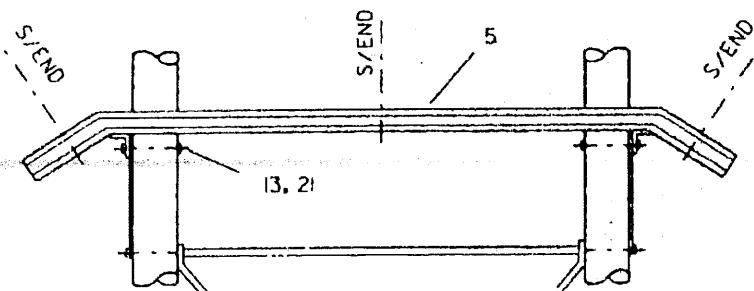

ANTI-CLIMBING

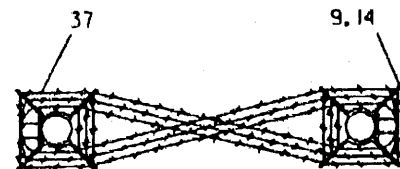

ERECTION OF SEALING END CROSSARM

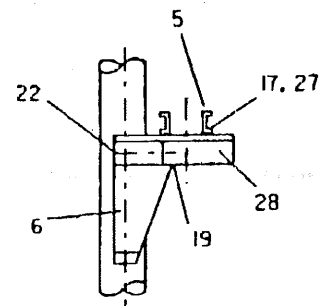

SCHEDULE:- A2020  
33kV HEAVY CONSTRUCTION

**UNCONTROLLED COPY  
SUBJECT TO REVISION  
MASTER HELD AT HEAD OFFICE  
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN  
ELECTRIC**

**33kV DOUBLE CIRCUIT  
'H' TERMINAL POLE (630mm<sup>2</sup> CABLE)  
DETAIL SHEET**

Scale:- N.T.S.  
Dwn. by:- D.K.W.  
Tcd. by:- D.K.M.  
Ckd. by:- W.C.S.  
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.  
**HO/37/2020 SHT 2 OF 2**  
C.A.D. Reference. HO2020.37

