


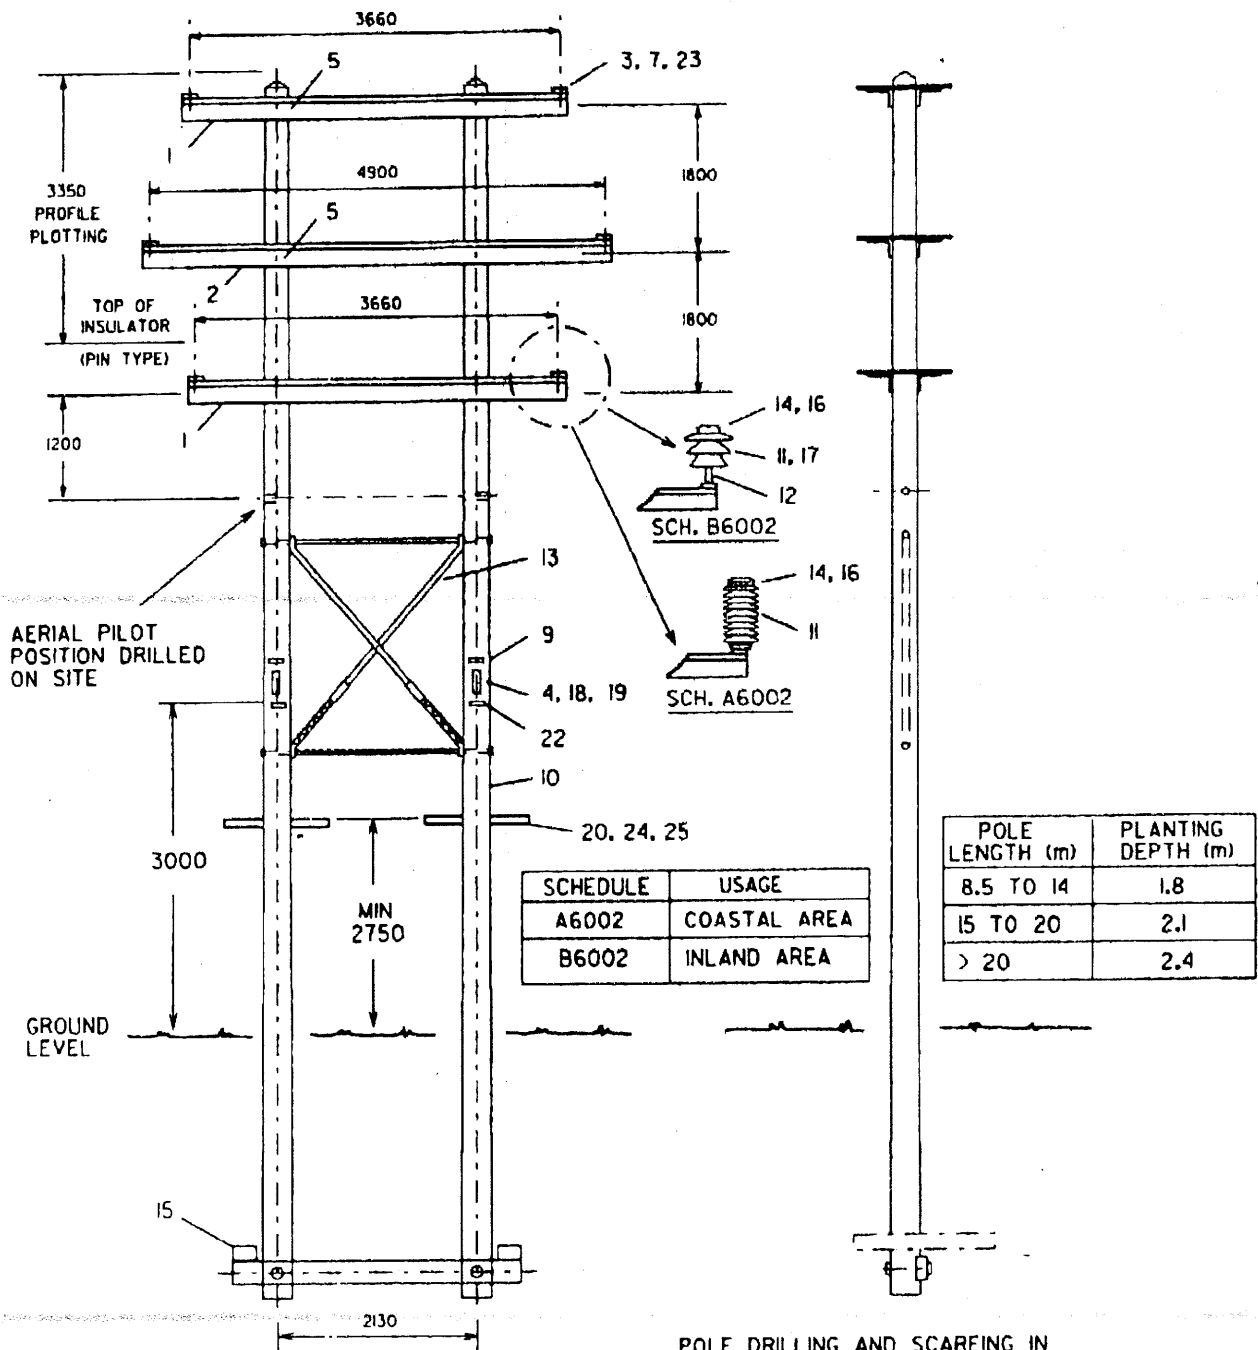

POLE DRILLING AND SCARFING IN
ACCORDANCE WITH DRG. No. HO/37/6002 SHT 3

ITEM 26 EARTHING KIT FOR TRUSSING TACKLE
SEE DRG. No. HO/37/8983

ITEM 8 BONDING DETAILS
SEE DRG. No. HO/37/6002 SHT 2

APPLICATION :- CONDUCTORS UP TO
AND INCLUDING 0.2 sq.in CU AND
250 sq.mm ALUM.ALLOY

SCHEDULE:- A6002
33kv HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6002

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33kV DOUBLE CIRCUIT
INTERMEDIATE 'H' POLE 1800 Ph. SPACING**

Scale:-	N.T.S.	Dimensions in millimetres
Des. by:-	D.K.W.	Drawing no.
Yed. by:-	D.K.M.	HQ/37/6002 SHT 1 OF 3
Ord. by:-	W.C.S.	C.A.D. Reference. HO6002.37
App. by:-	W.C.S.	

