
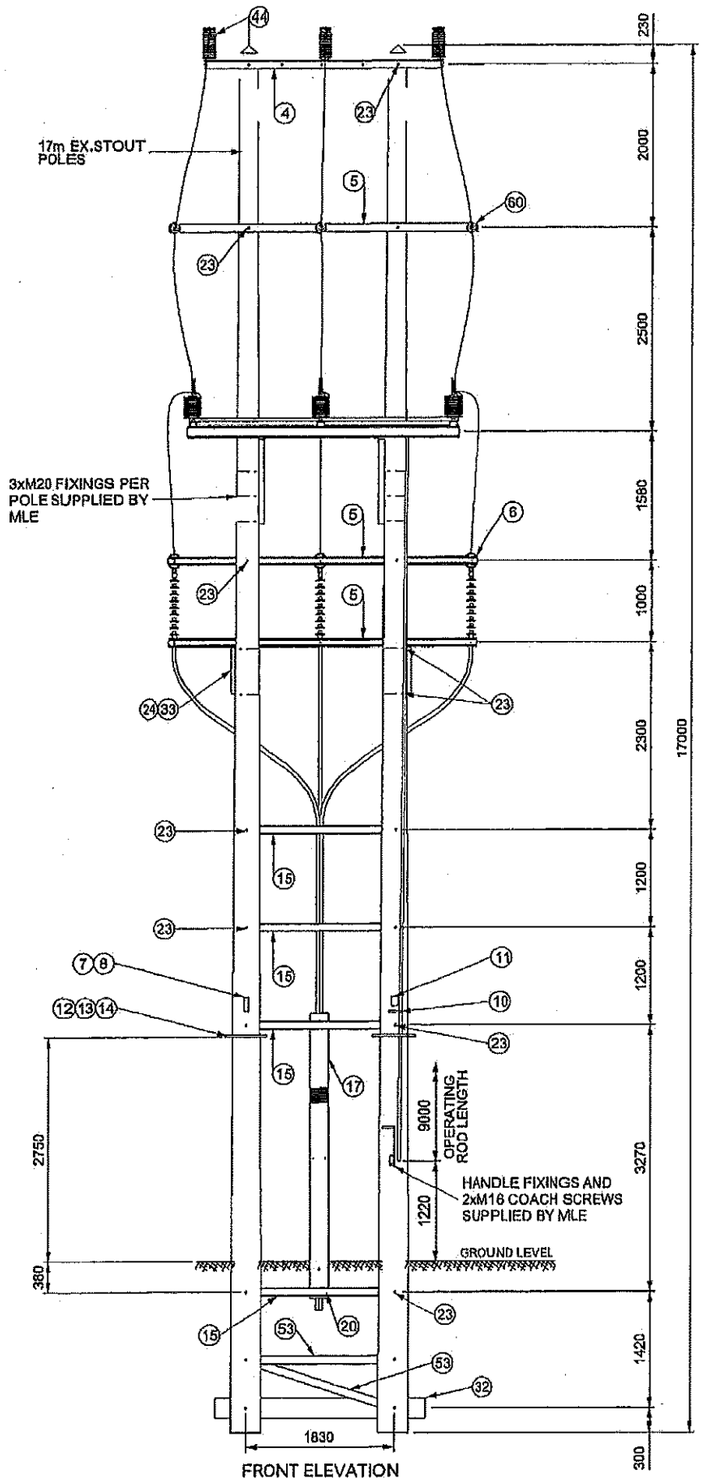



FRONT ELEVATION

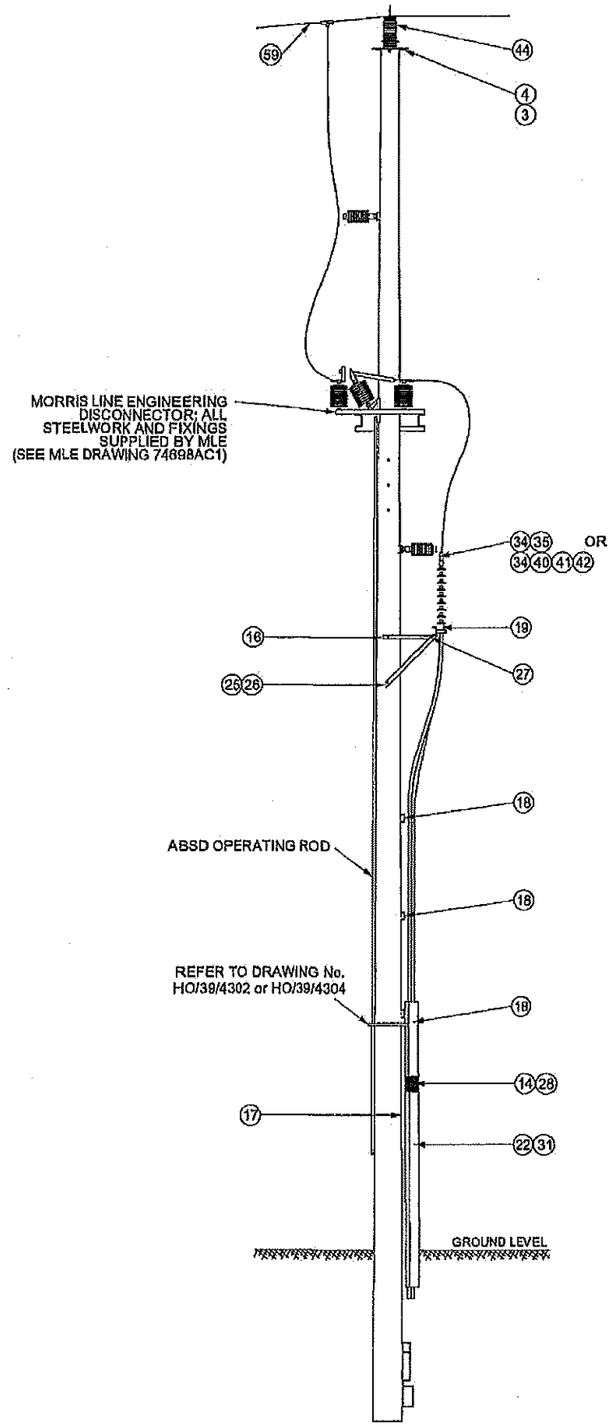

SIDE ELEVATION

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. FOR EARTHING DETAILS SEE DRAWING No. HO/37/2021 Sheet 2 (CONFIGURATION TO BE USED UP TO SURGE ARRESTER LEVEL ONLY).
3. CABLE TERMINAL ARRANGEMENT BASED UPON SSE DRAWING No. HO/37/2021 Sheet 1 of 3.

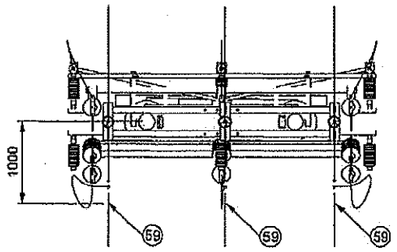

PLAN VIEW OF CROSSARM

CDM NOTES

1. ONLY COMPETENT/EXPERIENCED CONTRACTORS SHALL BE APPOINTED TO UNDERTAKE THIS WORK.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH PROJECT SPECIFICATION AND ANY OTHER DOCUMENTS ISSUED BY THE CLIENT.
3. CONTRACTOR SHALL CONSIDER ALL PHASES OF WORK AND ENSURE LIMITS OF APPROACH ARE ADHERED TO WHEN LIVE ELECTRICAL EQUIPMENT IS IN PLACE.
4. CONTRACTOR SHALL ADHERE TO ALL ELECTRICITY COMPANIES OPERATIONAL PROCEDURES, MANUFACTURERS RECOMMENDED & INSTALLATION PROCEDURES FOR PLANT AND MATERIALS.
5. CONTRACTOR SHALL HAVE ASSESSED RISKS AND USE SAFE METHODS OF WORKING TO COMPLY WITH CURRENT HEALTH AND SAFETY LEGISLATION AND CDM REGULATIONS.
6. THE CONTRACTOR SHALL HAVE TAKEN DUE COGNISANCE OF THE HAZARDS IDENTIFIED IN THE DESIGN HAZARD INVENTORY AND HEALTH AND SAFETY PLAN, PARTICULARLY MEN WORKING AT HEIGHT AND ELECTROCUTION AND SHALL HAVE IMPLEMENTED MITIGATION MEASURES TO REDUCE RISKS TO ACCEPTABLE LEVEL.

Ref	Qty	Schedule / Commodity	Comments
Morris Line Disconnector	1	Morris Line Drawing 74698AC1	33kV type 'RX' disconnector underline mounting on 'H' wood poles (P314 insulators)
Sub-Kits			
37	1	LSTC-18-15112-05	SCARFING & DRILLINGS FOR 33kV INTERMEDIATE H POLE
38	1	E2021	BONDING FOR 33KV SINGLE CIRCUIT POLYMERIC TERM POLE
Commodities			
3	3	192129	LINE PLATE FOR INTERMEDIATE TWIN AND H POLES
4	2	ENATS 439520	CROSSARM MEMBER - 2.9m
5	3	179121	33kV POLYMERIC CABLE & SURGE DIVERTER SUPPORT
6	3	217473	BOWTHORPE SURGE ARRESTERS (21-747-3)
7	2	067432	SAFETY SIGN HV POLE DANGER OF DEATH
12	2	061290	BRACKET OUTRIGGER ANTI-CLIMBING
13	8	062657	COACHSCREW GALVANISED SQUARE HEAD 0.375x3
15	4	192288	X-ARM BACKBOARD & CLEAT TO DRG 192288
16	1	179131	33kV POLMERIC CABLE CLEAT SUPPORT MEMBER
17	1	191131	BACKBOARD TO SSE DRAWING HO/36/512
18	5	174471	CLEAT TREFOIL ATLAS RANGE TAKING
19	3	174426	ATLAS RANGE-TAKER CLEAT FOR SINGLE CABLE
20	4	060802	BOLT & NUT GALVOILED 60x20mm THREAD 45
22	1	178116	CABLE COVER 8FT LENGTH x 4 INCH GALVANISED
24	2	060833	BOLT & NUT GALVOILED 50x16mm THREAD 35
25	12	060531	WASHER SQUARE CURVED TO DRAWING 06-053-1
26	1	179141	POLYMERIC CABLE CLEAT SUPPORT CHANNEL
27	2	060859	BOLT & NUT GALVOILED 45x20mm THREAD 45
31	16	062628	COACHSCREW GALVANISED SQUARE HEAD 0.375x1.5
33	2	060515	WASHER GALVANISED 18mm
44	3	175469	INSULATOR LINE POST TYPE 33kV
53	2	ENATS 439588	FOUNDATION BRACE C/W BOLTS
59	3	-	COMPRESSION TEE CONNECTOR
60	3	-	33kV POST INSULATOR (horizontal mount - single 16mm stud max)
Decision Items			
10	--	G7-S1	POLE NUMBER & LETTER PLATES
11	1	G7-S7	CIRCUIT IDENTIFICATION PLATE
23	20	G6-S11	POLE HEAD BOLTS
34	3	G2S231	SINGLE HOLE LUGS - HEAVY CONSTRUCTION
Reminder Items			
8	--	116695	NAIL DRIVE 4mmx50mm ZINC PLATED POLY TOP
14	--	069719	BARBED WIRE
28	--	118503	STAPLE GALVANISED 40x4mm
32	--	174109	BLOCK WOOD STAY/KICKING C/W BOLT
35	--	023368	UNIAL COMPOUND
40	--	060804	M12 x 45mm NUT AND BOLT
41	--	060502	M12 WASHERS
42	--		ALUMINIUM ADAPTER PLATE

WARNING: DRAWING MAY BE REDUCED WHEN PLOTTED OR PRINTED. DO NOT SCALE.

REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD
A	09/04/15	SP																					
	DRWN MA	APPD MJS		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD
FIRST ISSUE																							

DATE	25/03/2015
DRAWN	MA
CHKD	SP
APPD	MJS
SCALE	1:50 @ A2

Scottish and Southern Energy
Power Distribution

Project Number	Drawing Status
-	FOR APPROVAL

Title: GENERAL ARRANGEMENT/ERECTION DIAGRAM FOR 33kV INTERMEDIATE 'H' POLE STRUCTURE WITH ABSD AND CABLE TERMINATIONS (17m POLE)

Location	LSTC Drawing Number	Sht No	Rev.
MAKRO FAREHAM	15_15112_03	1 of 1	A