
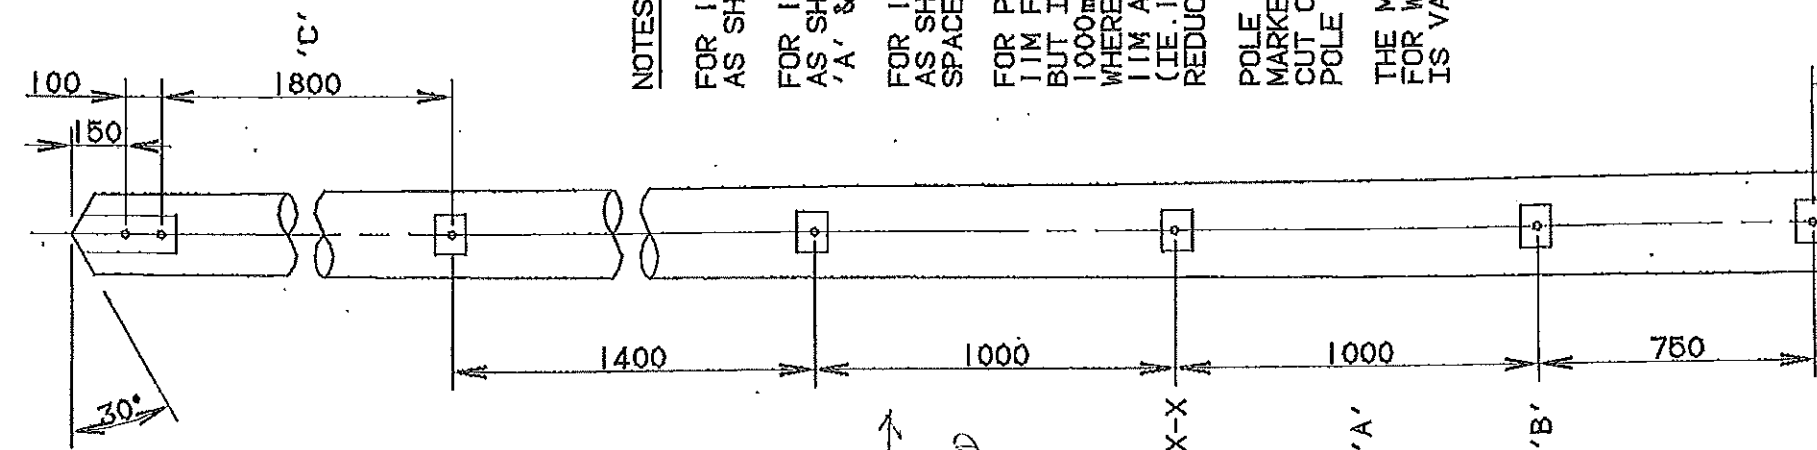


H - TYPE POLE
TWO REQUIRED
L.H. POLE SHOWN

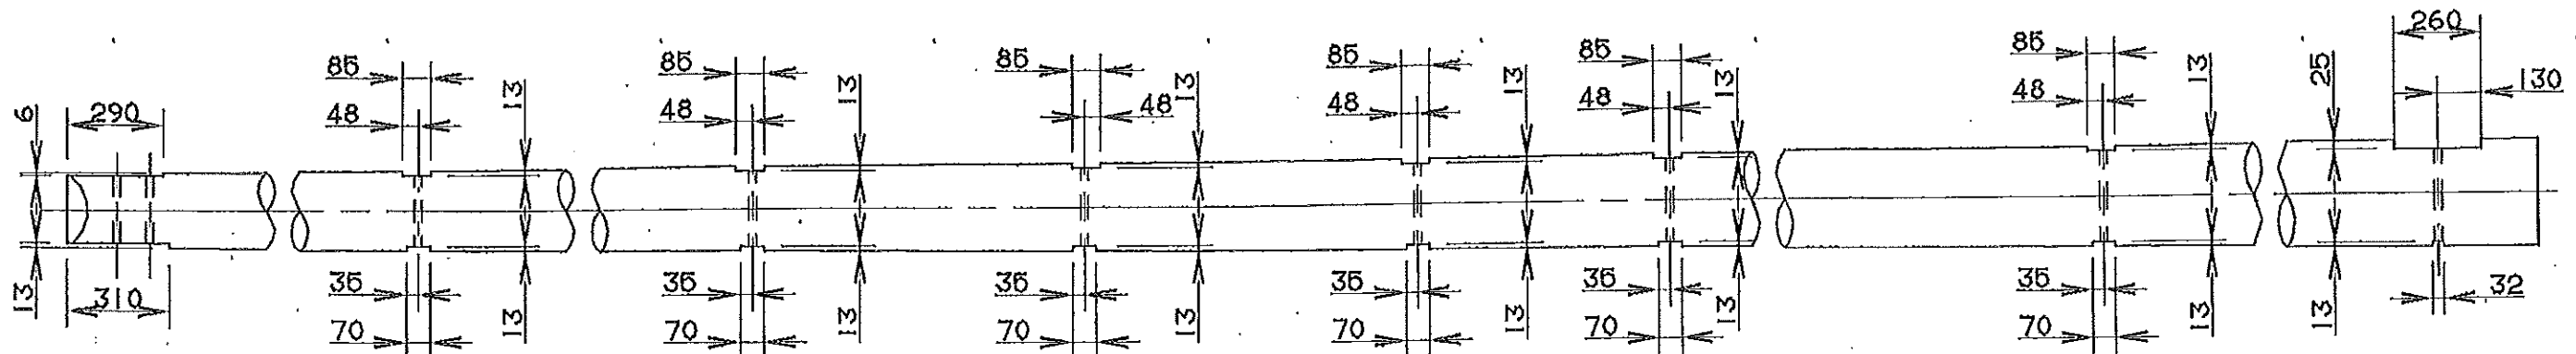

NOTES

- FOR 11M POLES FABRICATE AS SHOWN.
- FOR 10M POLES FABRICATE AS SHOWN, BUT OMIT SPACE 'A' & SCARFING 'B'.
- FOR 10.5M POLES FABRICATE AS SHOWN, BUT REDUCE SPACE 'C' TO 1300mm.
- FOR POLES GREATER THAN 11M FABRICATE AS SHOWN, BUT INSERT APPROPRIATE 1000mm SPACING BELOW X-X, WHERE POLES GREATER THAN 11M ARE HALF SIZES (IE. 11.5M, 12.5M). ALSO REDUCE SPACE 'C' TO 1300mm.
- POLE LOCATION NO. TO BE MARKED ON POLE, MUST BE CUT ON THE FLAT BASE OF POLE ONLY.
- THE MINIMUM POLE SIZE FOR WHICH THIS DRAWING IS VALID IS 10M.

GOUGE AND BUTT MARKINGS TO DRWG. NO. MNW 11D/25000/26

ALL HOLES 22 DIA UNLESS OTHERWISE STATED

POLES SCARFED FOR 2500 x 250 x 125 BAULK

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED

Manweb NETWORK SERVICES DIVISION	DRAWN BY: P.J.H.
	DATE: 30/09/94
	TRACED BY:
	JOB No:
APP'D BY: P.DUMAYNE	
OVERHEAD LINE STANDARD FABRICATION DETAILS OF 33kV TERMINAL H - POLE WITH U/G CABLE, ALL ARRANGEMENTS	
MNW 11D 12001 - 072 A3	SCALE: 1:20

THIS DRAWING SUPERSEDES MNWO/2016/W & MNW 11D12001-019

NO FOR 14m ADD 3x A+B SCARFING AT 1000 (5424)