




ScottishPower
Energy Networks

Uncontrolled Copy

Specification for 11kV And 33kV Overhead
Lines of Unearthed Construction on Single and
“H” Type Wood Poles.

OHL-03-099
Issue 1

Figure 16 Delta Long Span “H” Pole Section or Section Angle (Drawing SP2059372)

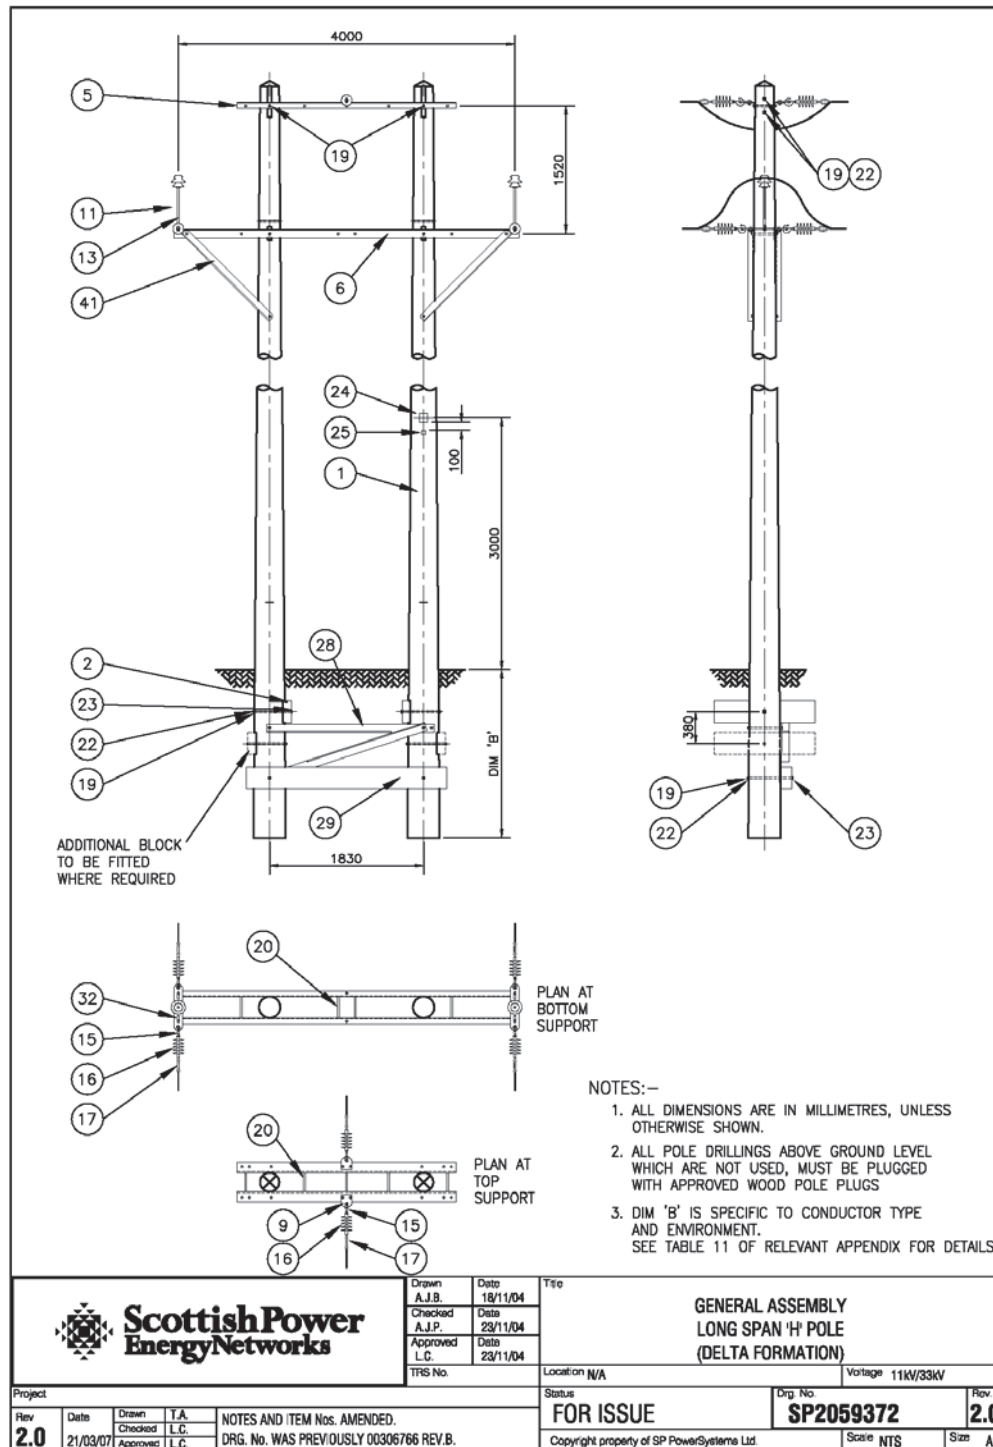



**ScottishPower
EnergyNetworks**

**Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.**

**OHL-03-099
Issue 1**

Uncontrolled Copy

General Assembly Delta Long Span “H” Pole Section or Section Angle (Drawing SP2059372)						
ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.	
01	2	Wood Pole	ENATS 434001	-	-	
02	2 or 4	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342	
05	2	Terminal Crossarm Member	ENATS 439522	SP4018401	C43811080	
06	2	Long Span Crossarm Member	ENATS 439521	SP4017663	C43811079	
09	2	Terminal Strap	ENATS 439528	SP4017664	C43811074	
11	2	Pin Insulator	ENATS 43-93	-	-	
13	2	Pilot Pin 50mm Shank	BS3288 Fig 5, Ref 50	-	C43270177	
14	2	Helical Ties	ENATS 43-15	-	-	
15	6	Ball End Hook	BS3288 Fig 12 Ref 15/32	-	C43238026	
16	6	Tension Insulator	ENATS 43-93	-	C43200548	
17	6	Helical Dead End Assembly	ENATS 43-92	-	-	
18	3	Non Tension Joint	-	-	-	
19	8 or 10	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	-	
20	9	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060	
21	8	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072	
22	6 or 8	M20 Square Curved Washer	ENATS 439605	-	C43602025	
23	4 or 6	M20 Square Flat Washer	ENATS 439604	-	C43602050	
24	2 or 4	Safety Sign English Bilingual	-	-	C06294004 C06293900	
25	As Required	Pole Numbers	-	-	-	
28	2	Foundation Brace Steelwork 1830mm centres	ENATS 439558	SP4017651	C43500935	
29	1	Foundation Brace Block	ENATS 439112 Type 1	SP4019036	C43811796	
32	2	Long Section Strap For Long Span Delta H Pole	-	SP4019183	-	
41	4	Long Span Delta Crossarm Strut	-	SP2143987	-	
	As Required	Hardwood Plugs	ENATS 439516	-	-	