


Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single and “H” Type Wood Poles.

OHL-03-099
Issue 1

Figure 15 Delta “H” Pole Section or Section Angle (Drawing SP2059611)



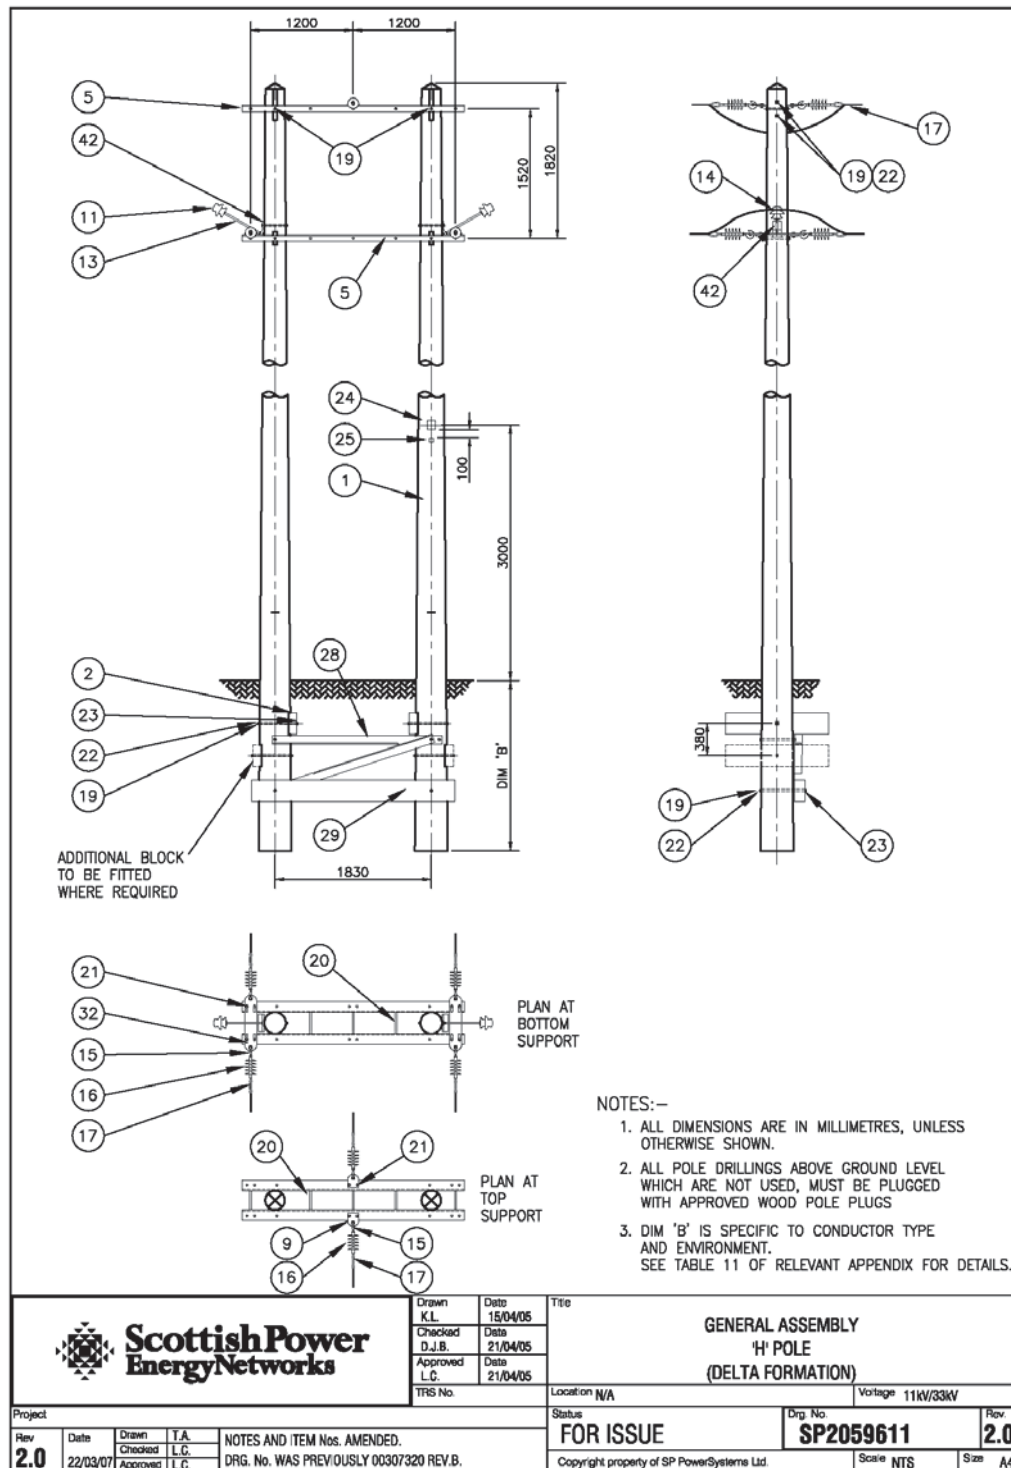

ScottishPower
EnergyNetworks

**Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.**

OHL-03-099
Issue 1

Uncontrolled Copy

General Assembly Delta “H” Pole Section or Section Angle (Drawing SP2059611)

ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.
01	2	Wood Pole	ENATS 434001	-	-
02	2 or 4	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342
05	2	Terminal Crossarm Member	ENATS 439522	SP4018401	C43811080
09	2	Terminal Strap	ENATS 439528	SP4017664	C43811074
11	2	Pin Insulator	ENATS 43-93	-	-
13	2	Pilot Pin 50mm Shank	BS3288 Fig 5, Ref 50	-	C43270177
14	3	Helical Ties	ENATS 43-15	-	-
15	6	Ball End Hook	BS3288 Fig 12 Ref 15/32	-	C43238026
16	6	Tension Insulator	ENATS 43-93	-	C43200548
17	6	Helical Dead End Assembly	ENATS 43-92	-	-
18	3	Non Tension Joint	-	-	-
19	10 or 12	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	-
20	7	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060
21	12	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072
22	6 or 8	M20 Square Curved Washer	ENATS 439605	-	C43602025
23	4 or 6	M20 Square Flat Washer	ENATS 439604	-	C43602050
24	2 or 4	Safety Sign English Bilingual	-	-	C06294004 C06293900
25	As Required	Pole Numbers	-	-	-
28	2	Foundation Brace Steelwork 1830mm centres	ENATS 439558	SP4017651	C43500935
29	1	Foundation Brace Block	ENATS 439112 Type 1	SP4019036	C43811796
32	2	Delta H Section Strap	-	SP2146143	-
42	2	30 Degree Angle Bracket	-	SP4018951	-
	As Required	Hardwood Plugs	ENATS 439516	-	-