



1400 200 1400

11 13 4 21 7 17 21

24 25 1 100 3000 380 DIM 'B'

2 23 22 19

ADDITIONAL BLOCK TO BE FITTED WHERE REQUIRED

14 19 22

WHEN TWO STAYS ARE FITTED THESE MAY BE SPLAYED OR IN TANDEM GIVING A SEPARATION OF 3.0m AT GROUND LEVEL

ANTI-SPLIT BOLTS AND TWO SQUARE-CURVED WASHERS TO BE FITTED ABOVE AND BELOW CROSSARM

17 16 15 21 10 9 9 10

NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS OTHERWISE SHOWN.
2. ALL POLE DRILLINGS ABOVE GROUND LEVEL WHICH ARE NOT USED, MUST BE PLUGGED WITH APPROVED WOOD POLE PLUGS
3. DIM 'B' IS SPECIFIC TO CONDUCTOR TYPE AND ENVIRONMENT. SEE TABLE 11 OF RELEVANT APPENDIX FOR DETAILS.

ScottishPower EnergyNetworks

Drawn T.A. Date 17/03/06
Checked L.C. Date 19/04/06
Approved L.C. Date 19/04/06
TFRS No.

Location OHL SPEC

Status

GENERAL ASSEMBLY SECTION OR SECTION ANGLE POLE

Voltage 11kV/33kV

Project

Rev 2.0 Date 27/02/07

Drawn T.A. Date 17/03/06
Checked L.C. Date 19/04/06
Approved L.C. Date 19/04/06

P/IGTAILS CHANGED TO BALL END HOOKS. HELICAL DEAD ENDS ADDED. NOTES AMENDED.

FOR ISSUE

SP2147476

Copyright property of SP PowerSystems Ltd.

Scale NTS

Size 2.0



ScottishPower
EnergyNetworks


**Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.**

OHL-03-099
Issue 1

Uncontrolled Copy

General Assembly Arrangement Single Pole Straight Line or Angle Section (Drawing reference SP2147476)

ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.
01	1	Wood Pole	ENATS 434001	-	-
02	1 or 2	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342
04	2	Section Crossarm Member	ENATS 439520	SP4018433	C43811077
07	4	Crossarm Strut	ENATS 439526	SP4017649	C43811070
09	2	Terminal Strap	ENATS 439528	SP4017664	C43811074
10	2	Section Strap	ENATS 439525	SP4017666	C43811072
11	2	Pin Insulator	ENATS 43-93	-	-
13	2	Pilot Pin 50mm Shank	BS3288 Fig 5, Ref 50	-	C43270177
14	2	Helical Ties	ENATS 43-15	-	-
15	6	Ball End Hook	BS3288 Fig 12 Ref 15/32	-	C43238026
16	6	Tension Insulator	ENATS 43-93	-	C43200548
17	6	Helical Dead End Assembly	ENATS 43-92	-	-
18	3	Non Tension Joint	-	-	-
19	3 or 4	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	-
20	2	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060
21	12	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072
22	1 or 2	M20 Square Curved Washer	ENATS 439605	-	C43602025
23	1 or 2	M20 Square Flat Washer	ENATS 439604	-	C43602050
24	1 or 2	Safety Sign English Bilingual	-	-	C06294004 C06293900
25	As Required	Pole Numbers	-	-	-
	As Required	Hardwood Plugs	ENATS 439516	-	-

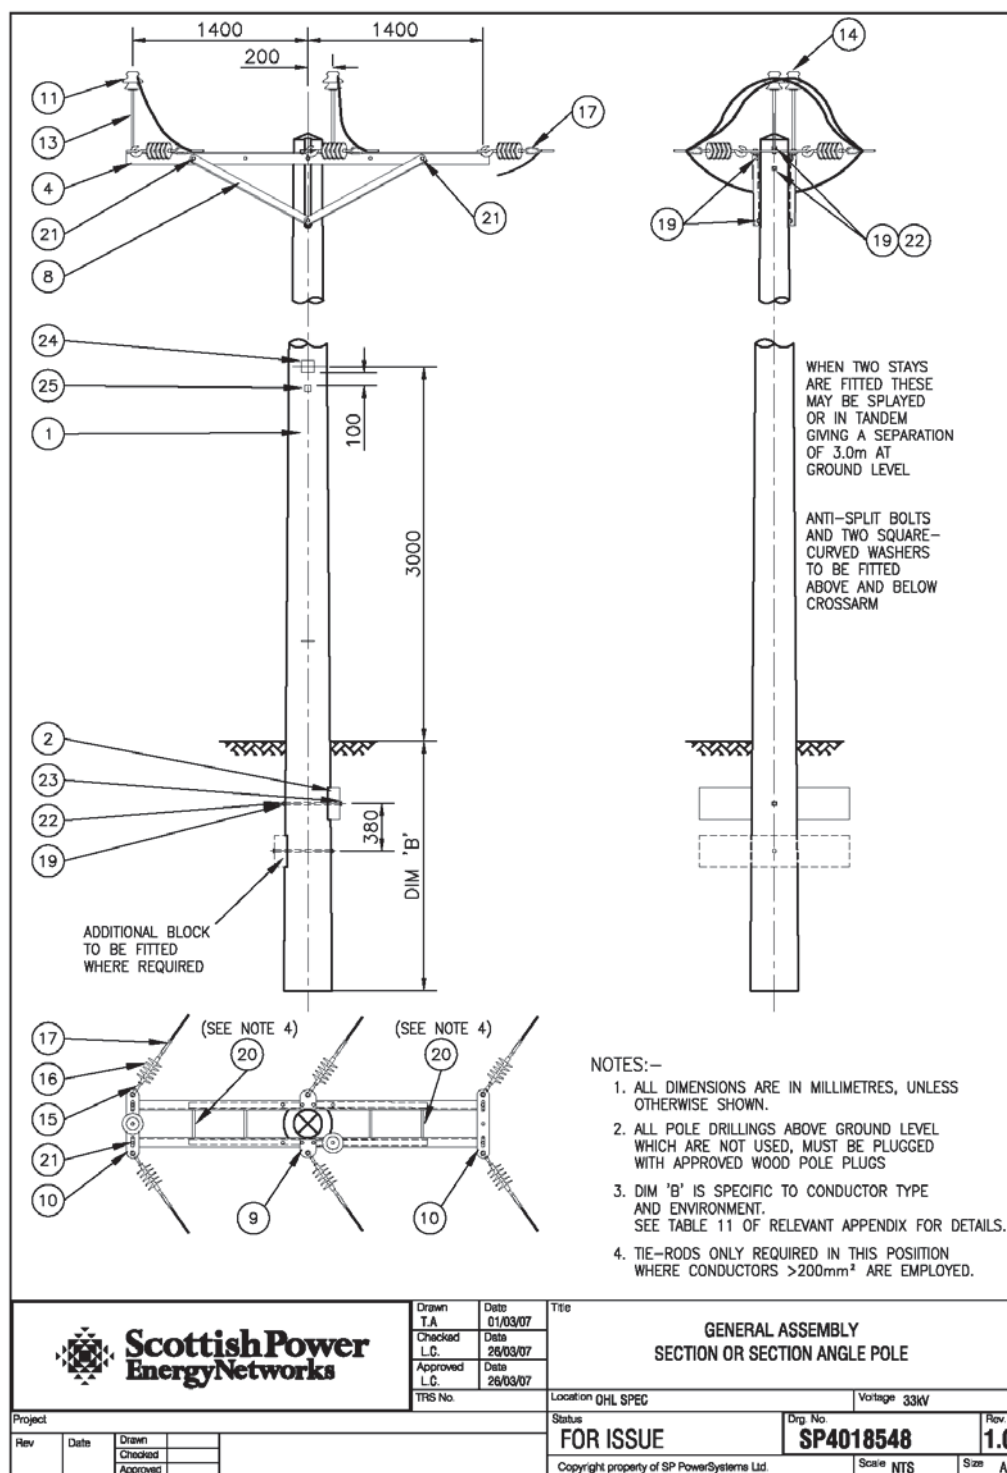



ScottishPower
EnergyNetworks

**Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.**

OHL-03-099
Issue 1

Uncontrolled Copy

General Assembly Arrangement Single Pole Straight Line or Angle Section (Drawing reference SP4018548)

ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.
01	1	Wood Pole	ENATS 434001	-	-
02	1 or 2	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342
04	2	Section Crossarm Member	ENATS 439520	SP4018433	C43811077
08	4	Long Crossarm Strut	-	SP4017635	C43500940
09	2	Terminal Strap	ENATS 439528	SP4017664	C43811074
10	2	Section Strap	ENATS 439525	SP4017666	C43811072
11	2	Pin Insulator	ENATS 43-93	-	-
13	2	Pilot Pin 50mm Shank	BS3288 Fig 5, Ref 50	-	C43270177
14	2	Helical Ties	ENATS 43-15	-	-
15	6	Ball End Hook	BS3288 Fig 12 Ref 15/32	-	C43238026
16	6	Tension Insulator	ENATS 43-93	-	C43200548
17	6	Helical Dead End Assembly	ENATS 43-92	-	-
18	3	Non Tension Joint	-	-	-
19	3 or 4	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	-
20	2 or 4	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060
21	12	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072
22	1 or 2	M20 Square Curved Washer	ENATS 439605	-	C43602025
23	1 or 2	M20 Square Flat Washer	ENATS 439604	-	C43602050
24	1 or 2	Safety Sign English Bilingual	-	-	C06294004 C06293900
25	As Required	Pole Numbers	-	-	-
	As Required	Hardwood Plugs	ENATS 439516	-	-