




ScottishPower
Energy Networks

Uncontrolled Copy

Specification for 11kV And 33kV Overhead
Lines of Unearthed Construction on Single and
"H" Type Wood Poles.

OHL-03-099
Issue 1

Figure 14 Long Span "H" Pole Straight Line or Angle Section (Drawing SP2147486)

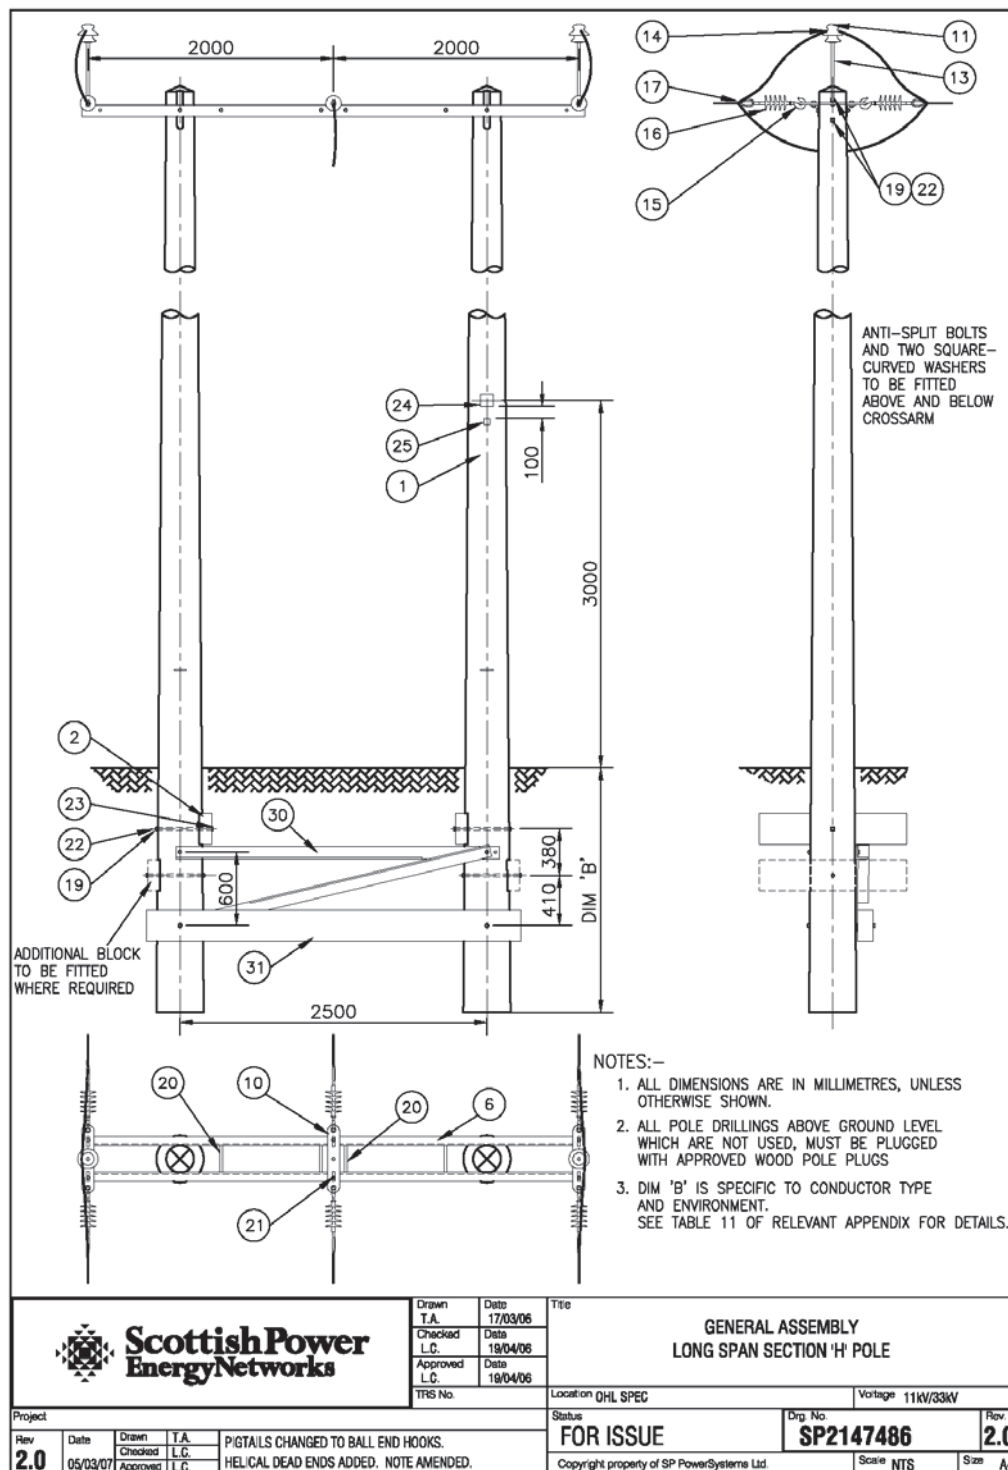



ScottishPower
EnergyNetworks

Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.

OHL-03-099
Issue 1

Uncontrolled Copy

General Assembly Long Span “H” Pole Straight Line or Angle Section (Drawing SP2147486)

ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.
01	2	Wood Pole	ENATS 434001	-	-
02	2 or 4	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342
06	2	Long Span Crossarm Member	ENATS 439521	SP4017663	C43811079
10	3	Section Strap	ENATS 439525	SP4017666	C43811072
11	2	Pin Insulator	ENATS 43-93	-	-
13	2	Pilot Pin 50mm Shank	BS3288 Fig 5, Ref 50	-	C43270177
14	2	Helical Ties	ENATS 43-15	-	-
15	6	Ball End Hook	BS3288 Fig 12 Ref 15/32	-	C43238026
16	6	Tension Insulator	ENATS 43-93	-	C43200548
17	6	Helical Dead End Assembly	ENATS 43-92	-	-
18	3	Non Tension Joint	-	-	-
19	8 or 10	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	-
20	4	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060
21	6	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072
22	6 or 8	M20 Square Curved Washer	ENATS 439605	-	C43602025
23	4 or 6	M20 Square Flat Washer	ENATS 439604	-	C43602050
24	2 or 4	Safety Sign English Bilingual	-	-	C06294004 C06293900
25	As Required	Pole Numbers	-	-	-
30	2	Foundation Brace Steelwork 2500mm centres	ENATS 439559	SP4017652	-
31	1	Foundation Brace Block	ENATS 439112 Type 2	SP4019037	-
	As Required	Hardwood Plugs	ENATS 439516	-	-