




ScottishPower
Energy Networks

Uncontrolled Copy

Specification for 11kV And 33kV Overhead
Lines of Unearthed Construction on Single and
"H" Type Wood Poles.

OHL-03-099
Issue 1

Figure 10 "H" Pole Intermediate Long Span (Drawing SP4019155)

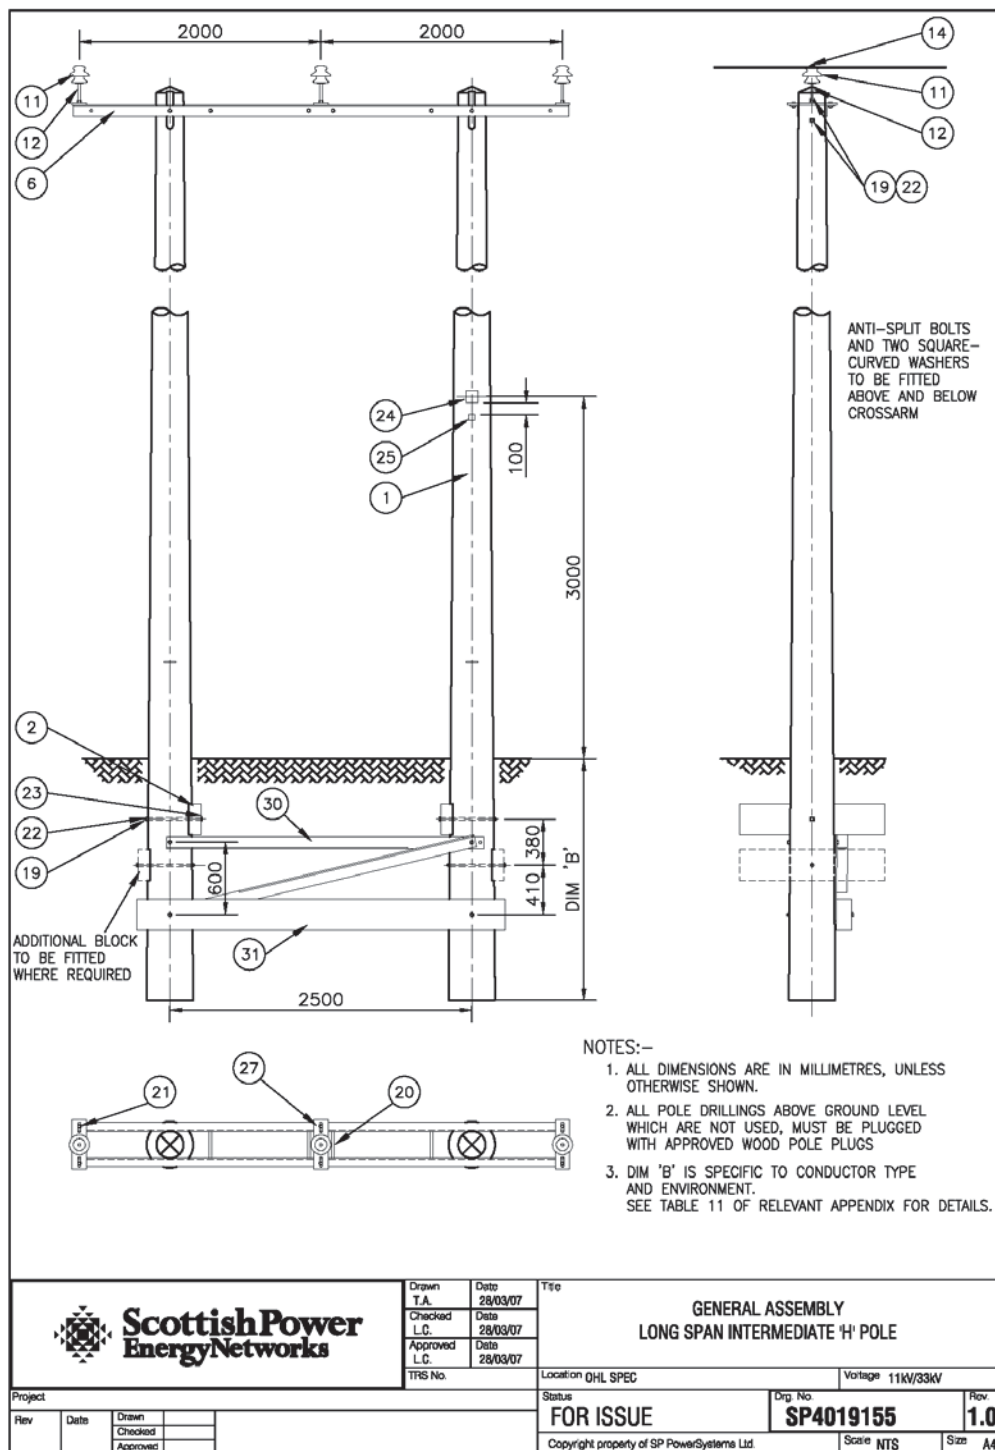



ScottishPower
EnergyNetworks

Specification for 11kV And 33kV Overhead Lines of Unearthed Construction on Single
and “H” Type Wood Poles.

OHL-03-099
Issue 1

Uncontrolled Copy

General Assembly Arrangement “H” Pole Intermediate Long Span (Drawing SP4019155)

ITEM	NUMBER	DESCRIPTION	ENATS, BS or OTHER REFERENCE	DRAWING NUMBER	COMMODITY CODE NO.
01	2	Wood Pole	ENATS 434001	-	-
02	2 or 4	Pole Block	ENATS 439103 Type 2	SP4019020	C43810342
06	2	Long Span Crossarm Member	ENATS 439521	SP4017663	C43811079
11	3	Insulator	ENATS 43-93	-	-
12	3	Insulator Pin	BS3288 Fig 4, Ref 29	-	C43270037
14	3	Helical Ties	ENATS 43-15	-	-
19	8 or 10	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENATS 43- 96 Clause 4.2 (Grade 8.8 HYS)	-	Codes depend on bolt length
20	4	M20 Tie Rods	ENATS 439608 Type 2 or 3	-	C43811060
21	6	M20 x 60mm Assembly Bolt and Nut	ENATS 43- 96 Clause 4.2	-	C43602072
22	6 or 8	M20 Square Curved Washer	ENATS 439605	-	C43602025
23	4 or 6	M20 Square Flat Washer	ENATS 439604	-	C43602050
24	2 or 4	Safety Sign English Bilingual	-	-	C06294004 C06293900
25	As Required	Pole Numbers	-	-	-
27	3	Insulator Plate	-	SP4017637	C43500930
30	2	Foundation Brace Steelwork 2500mm centres	ENATS 439559	SP4017652	-
31	1	Foundation Brace Block	ENATS 439112 Type 2	SP4019037	-
	As Required	Hardwood Plugs	ENATS 439516		