


22.23 Figure 23 General Arrangement Single Pole Stub Leg Tee-off 100mm² to 300mm²
(Drawing No. SP4147861)

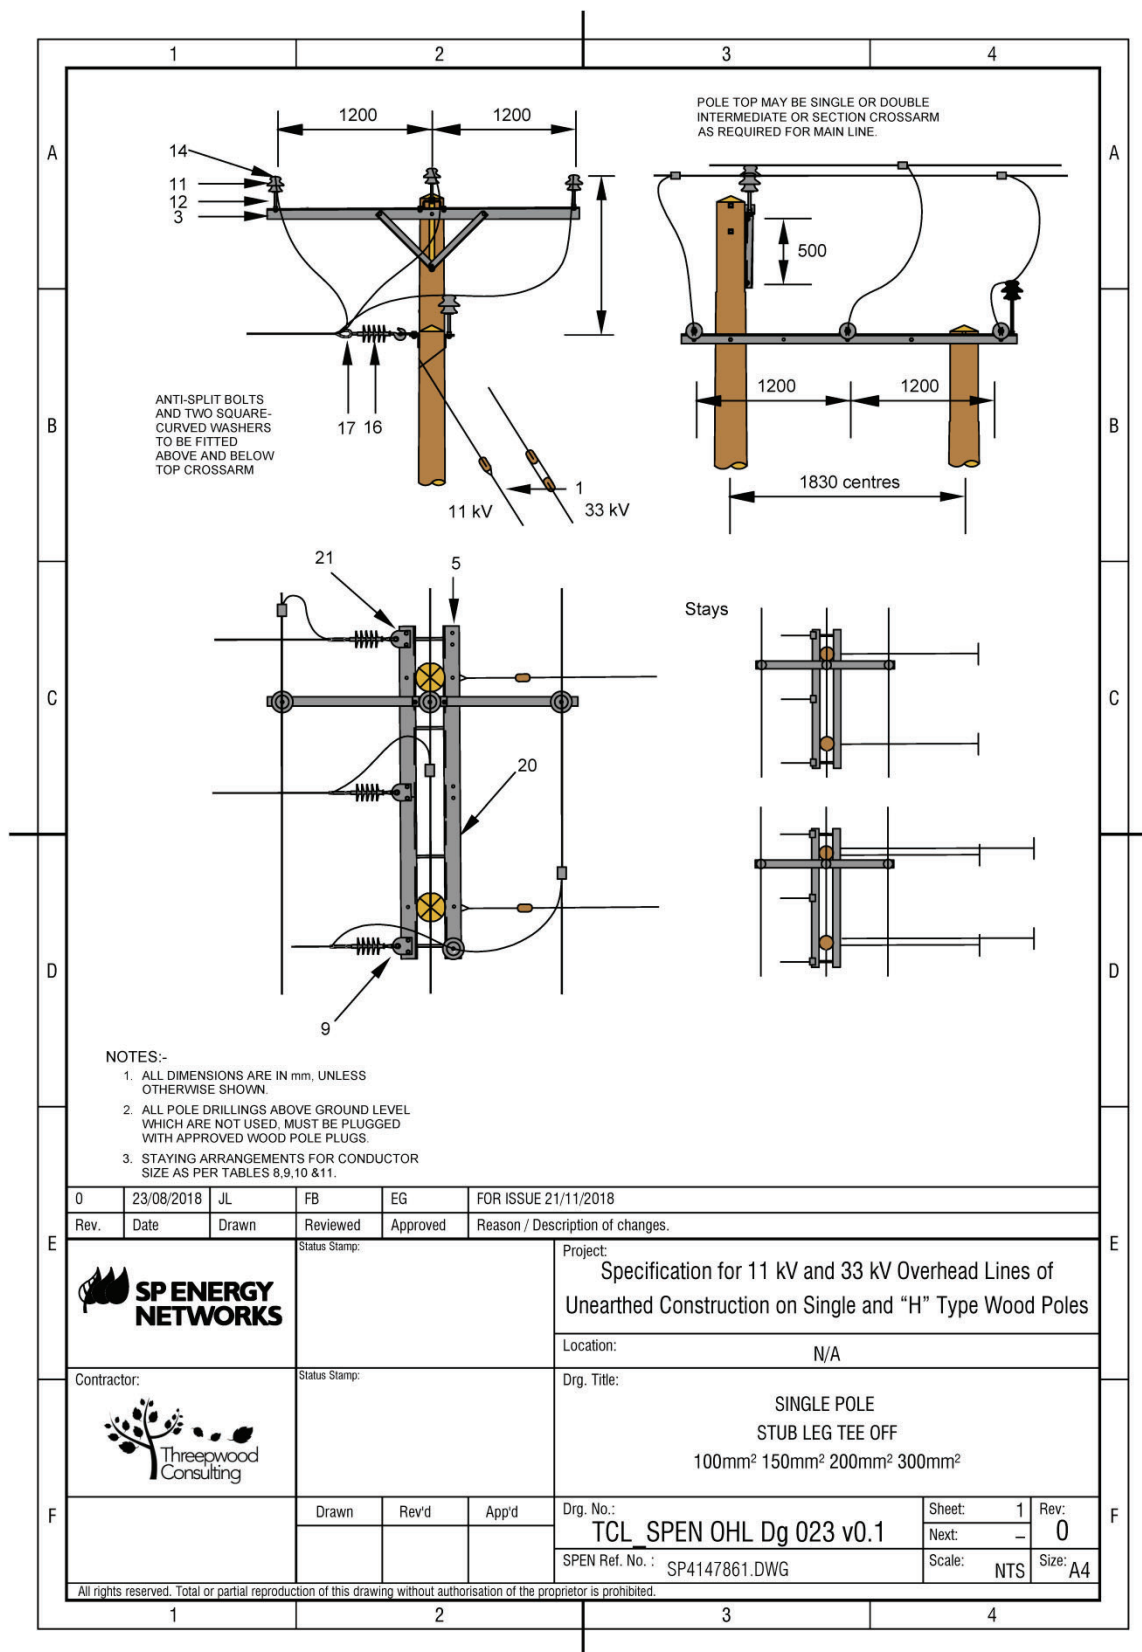

22.23.1 Schedule of Materials – Single Pole Stub Leg Tee-off 100mm² to 300mm² (Drawing No. SP4147861)

ITEM	NUMBER	DESCRIPTION	ENA TS, BS or OTHER REFERENCE	DRAWING NUMBER
01	1	Wood Pole	ENA Drawing No. 434001	SP4147690 or SP4147692
02	1 or 2	Pole Block	ENA Drawing No. 439103 Type 3	SP4019020
03	1 or 2	Intermediate Crossarm Member	ENA Drawing No. 439519	SP4018402
05	2	Terminal Crossarm Member	ENA Drawing No. 439522	SP4018401
07	2 or 4	Crossarm Strut	ENA Drawing No. 439526	SP4017649
09	3	Terminal Strap 50mm ² , 100mm ² , 150mm ² Terminal Strap 200mm ² Terminal Strap 300mm ²	ENA Drawing No. 439528 N/A N/A	SP4017664 SP4020576 SP4015138
15	3	Ball End Hook 70kN (up to 200mm ²) Shackle 125kN (300mm ²) Ball End Eye Link 125kN (300mm ²)	BS 3288 Fig 12 Ref 15/32 BS 3288 Fig 12 Ref 28/29 BS 3288 Fig 12 Ref 28/30	-
16	3	Tension Insulator	ENA TS 43-93	-
17	3	Helical Dead End Assembly	ENA TS 43-92	-
19	6	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENA TS 43-96 Clause 4.2 (Grade 8.8 HYS)	-
20	4	M20 Tie Rods	ENA Drawing No. 439608 Type 2 or 3	-
21	10 or 14	M20 x 60mm Assembly Bolt and Nut	ENA TS 43-96 Clause 4.2	-
22	4 or 6	M20 Square Curved Washer	ENA Drawing No. 439605	-
23	1 or 2	M20 Square Flat Washer	ENA Drawing No. 439604	-
24	1 or 2	Safety Sign - English - Bilingual	-	-
25	As Required	Pole Numbers	-	-
27	2	Insulator Plate	-	SP4017637
-	As Required	Hardwood Plugs	ENA Drawing No. 439516	-