


22.24 Figure 24 General Arrangement Transformer Single Bolt Fixing up to 50kVA (Drawing No. SP4147878)

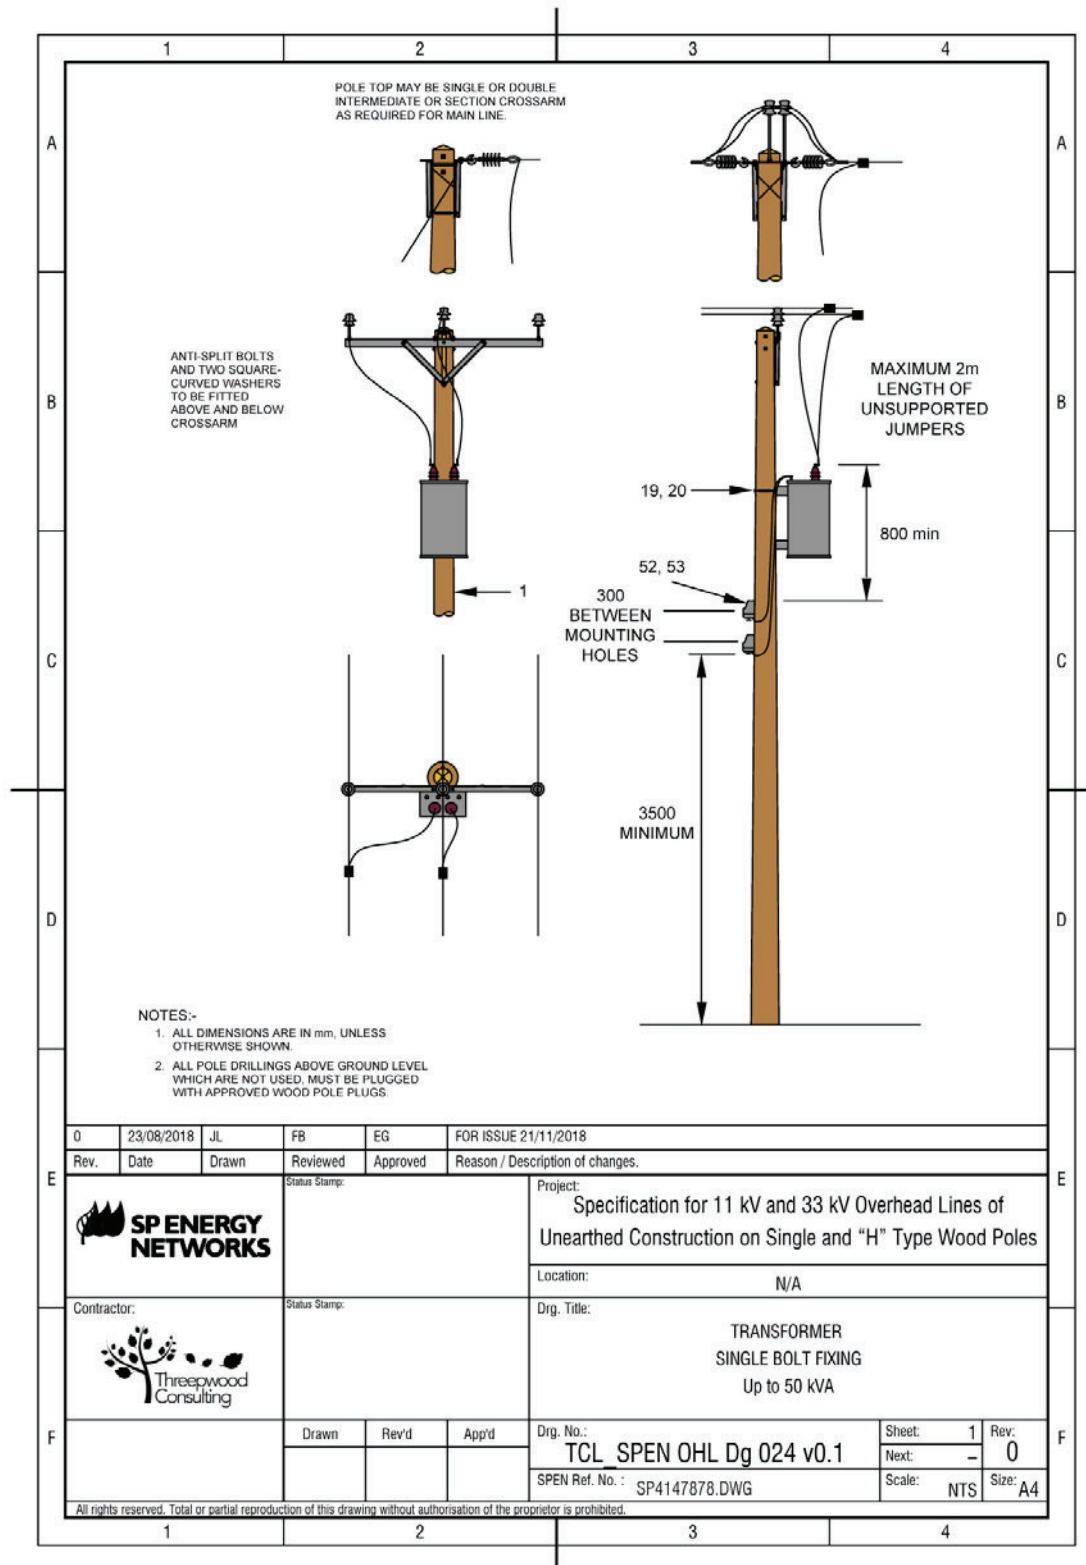

22.24.1 Schedule of Materials – Transformer Single Bolt Fixing up to 50kVA (Drawing No. SP4147878)

ITEM	NUMBER	DESCRIPTION	ENA TS, BS or OTHER REFERENCE	DRAWING NUMBER
-	-	See General Arrangement for pole top materials relevant to conductor size and application	-	-
19	1	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENA TS 43-96 Clause 4.2 (Grade 8.8 HYS)	-
22	1	M20 Square Curved Washer	ENA Drawing No. 439605	-
24	1 or 2	Safety Sign - English - Bilingual	-	-
25	As Required	Pole Numbers	-	-
-	As Required	Hardwood Plugs	ENA Drawing No. 439516	-
52	1 or 2	LV Fuses	-	-
53	3	Coach Screws	-	-
-	4	Coach Screws	-	-
-	2	Anti-climbing guard	ENA Drawing No. 439516	-
-	-	Barbed Wire	-	-