


22.28 Figure 28 General Arrangement Cable Single and "H" Pole (Drawing No. SP4147882)

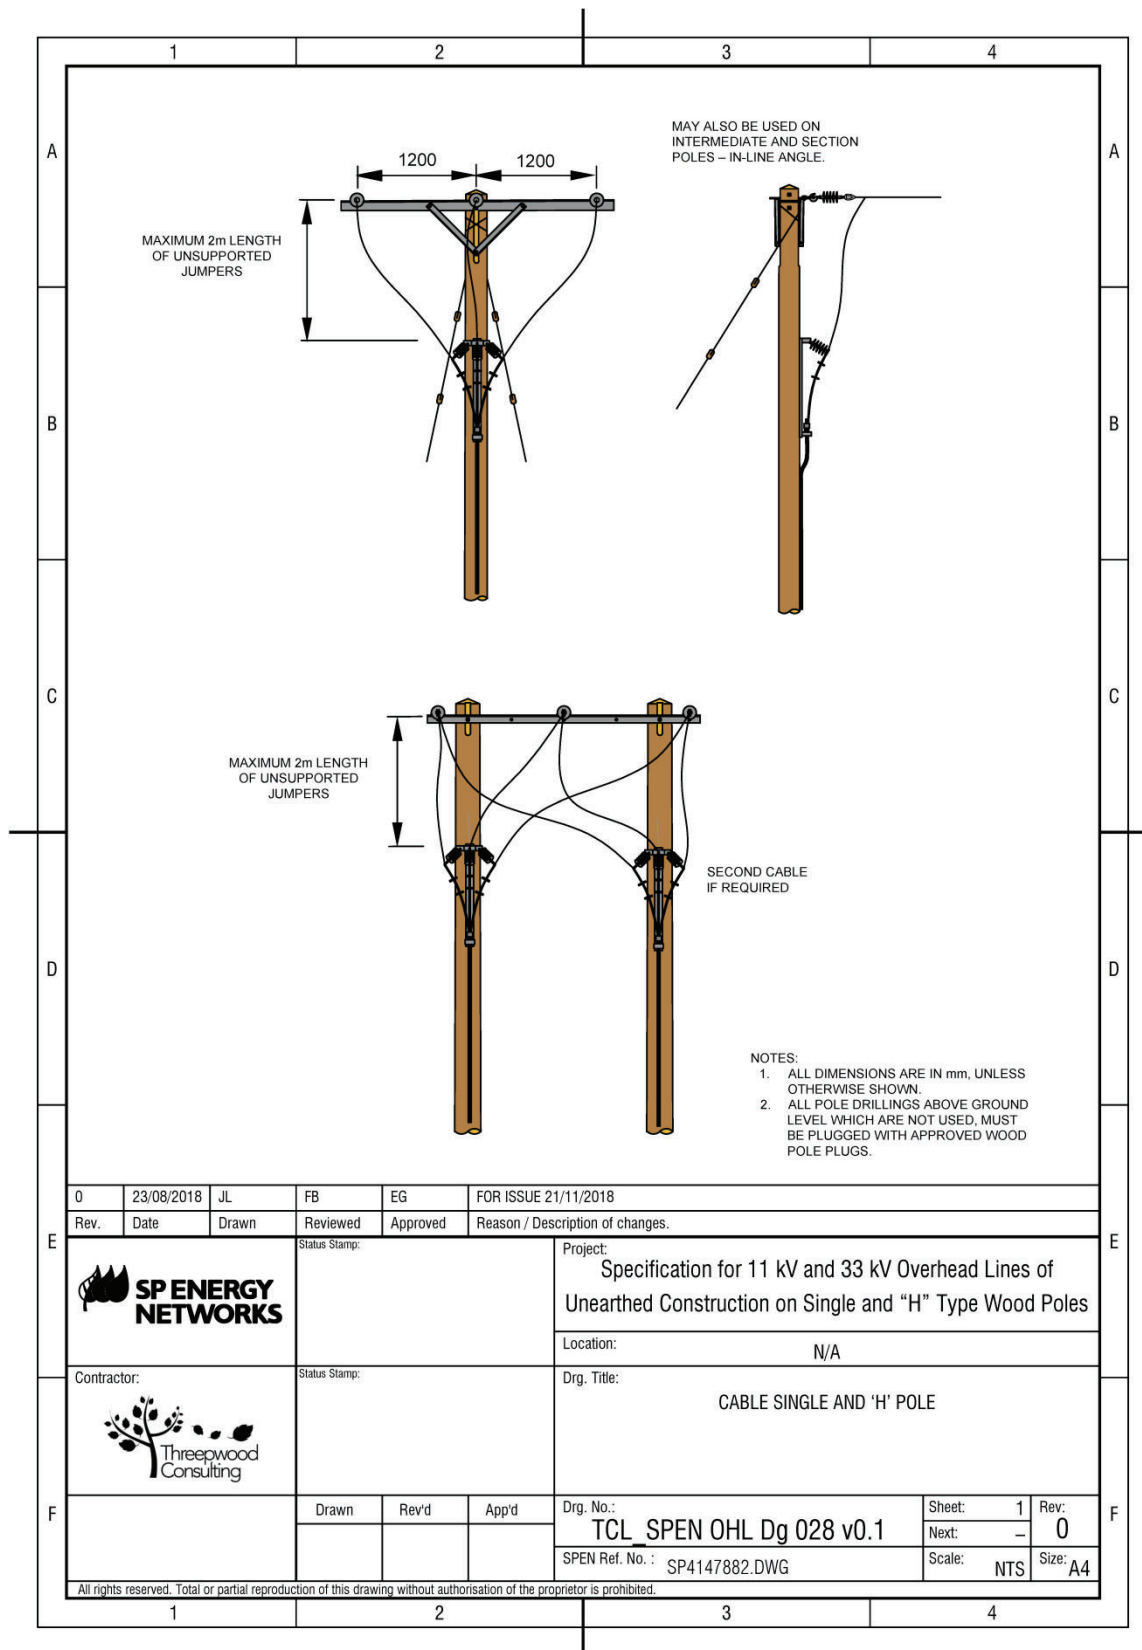

22.28.1 Schedule of Materials – Cable Single and “H” Pole (Drawing No. SP4147882)

ITEM	NUMBER	DESCRIPTION	ENA TS, BS or OTHER REFERENCE	DRAWING NUMBER
-	-	See General Arrangement for pole top materials relevant to conductor size and application	-	-
-	-	Pole termination	See OHL-18-017	-
-	-	Cable Guard	-	-
-	4	Coach Screws	-	-
-	2	Anti-climbing guard	ENA Drawing No. 439516	-
-	-	Barbed Wire	-	-
25	As Required	Pole Numbers	-	-
-	As Required	Hardwood Plugs	ENA Drawing No. 439516	-

Note: For guidance on 33kV cable termination see OHL-18-019. The assembly in Fig is not suitable for 33kV cable terminations.