


22.25 Figure 25 General Arrangement Transformer Single Pole Platform up to 100kVA
(Drawing No. SP4147901)

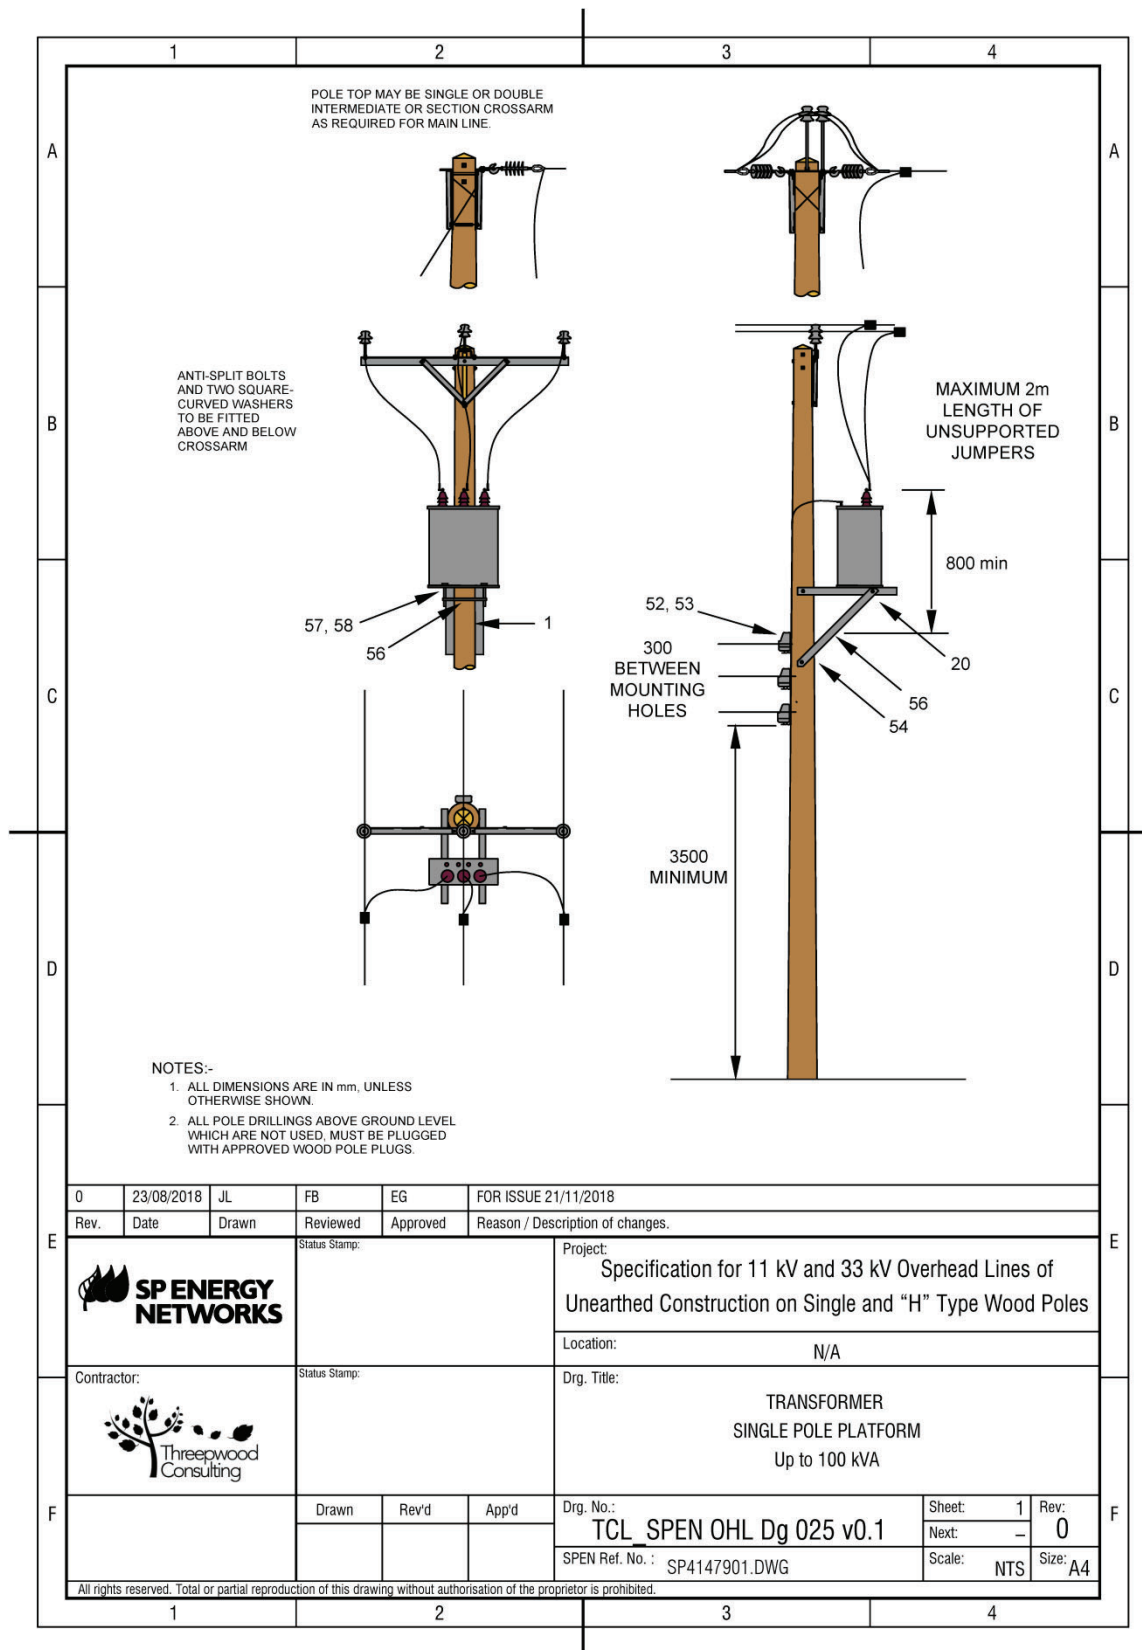

22.25.1 Schedule of Materials – Transformer Single Pole Platform up to 100kVA (Drawing No. SP4147901)

ITEM	NUMBER	DESCRIPTION	ENA TS, BS or OTHER REFERENCE	DRAWING NUMBER
-	-	See General Arrangement for pole top materials relevant to conductor size and application	-	-
19	2	M20 Pole Bolt (HYS) and Nut. Length to suit Pole diameter	ENA TS 43-96 Clause 4.2 (Grade 8.8 HYS)	-
20	1	M20 Tie Rods	ENA Drawing No. 439608 Type 2	-
21	2	M20 x 60mm Assembly Bolt and Nut	ENA TS 43-96 Clause 4.2	-
24	1 or 2	Safety Sign - English - Bilingual	-	-
25	As Required	Pole Numbers	-	-
-	As Required	Hardwood Plugs	ENA Drawing No. 439516	-
52	3	LV Fuses	-	-
53	3	Coach Screws	-	-
54	2	Platform & Strut – Transformer – Single Pole	ENA Drawing No. 439523	-
56	2	Transformer Clamping Plate	ENA Drawing No. 439529	-
57	4	Bolt & Nut M20 x 100	ENA TS 43-96 Clause 4.2	-
58	4	Washer Round M20	ENA TS 43-96 Clause 4.2	-
-	4	Coach Screws	-	-
-	2	Anti-climbing guard	ENA Drawing No. 439516	-
-	-	Barbed Wire	-	-