


No 321

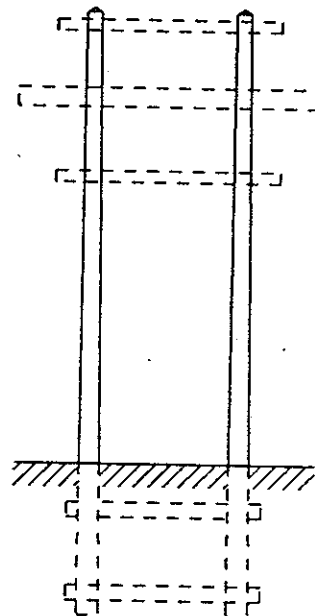

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE
1200mm FOR POLES UP TO 11m.
1500mm FOR POLES FROM 12m. TO 16m.
1800mm FOR POLES OVER 16m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

INTERMEDIATE H POLE
33KV DOUBLE CCT LINES

© SEEBOARD plc 1994

DRN.	JTM 27.06.94	SPECIFICATION DRAWING NUMBER	ISSUE
CKD.	DCM 18.07.94		
APP.	DCM 18.07.94		
		ES 1-9000.20	1

No 22

SEEBOARD



DISTRIBUTION

EQUIPMENT SPECIFICATION

ISSUED

- 3 JUL 1996

No 22

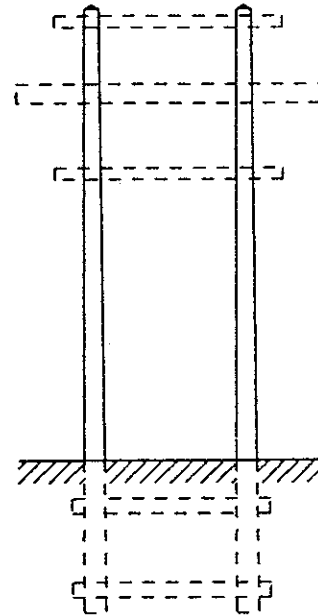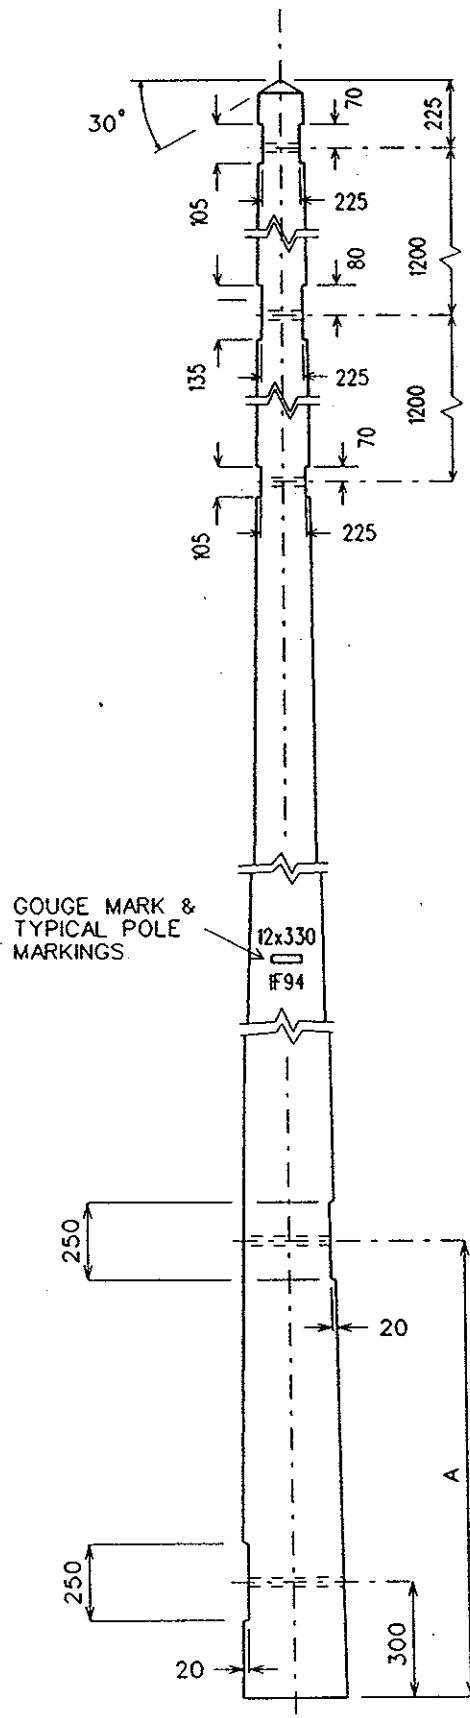

NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 1200mm FOR POLES UP TO 11m. 1500mm FOR POLES FROM 12m. TO 16m. 1800mm FOR POLES OVER 16m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHERE POLE DIAMETERS AT CROSSARM POSITIONS ARE 225mm OR LESS, THE SCARFING AT THESE POSITIONS SHALL BE OMITTED.

ALL DIMENSIONS SHOWN ARE IN mm.

SECTION H POLE
33kV DOUBLE CCT LINES

© SEEBOARD plc 1994

DRN.	JTM 27.06.94	SPECIFICATION DRAWING NUMBER	ISSUE
CKD.	DCM 18.07.94	ES 1-9000.21	1
APP.	DCM 18.07.94		