

DESIGN NOTES:
 FOR 200 sq. mm. (18/1/3.86) A.C.S.R.
 NORMAL SPAN - 106 m.
 MAXIMUM SPAN - 135 m.
 BARE COVERED CONDUCTOR - 120 m.
 FOR STRAIGHT LINE POSITIONS AND ANGLES
 OF DEVIATION UP TO 5°

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG. No.
1	POLE	TO SPECIFICATION
2	CROSSARM 2-102x51x10.42 kg/m CHANNEL - 4670 mm. LONG.	SI8643A
4	LINE POST INSULATOR 33 kV	SI9114R
5	LINE POST INSULATOR MOUNTING PLATE	SI9228H
6	M20 DOUBLE ENDED STUD	SI7770Y
7	CIRCUIT IDENTIFICATION PLATES	SI9184U
8	WARNING NOTICE	SI9197D
9	DANGER NOTICE	SI9214V
10	NUMBER/LETTER PLATE	SI9260-61 SI9272-9
11	KICKING/BRAKE BLOCK 2400x200x100 mm.	SI8057R
12	CURVED WASHER FOR M20 DIA. BOLTS	SI9910R
13	POLE TOP MAKE OFF	SI9426E
14	GUY GRIP DEAD END	SI9427N
15	STAY INSULATOR	SI9162M
16	INSULATOR LINK	IS9400M
17	STAY WIRE	SI9984E
18	22 mm. DIA. ADJUSTABLE STAY ROD	SI9391K
19	STAY BLOCK	SI8065G
20	STRAIGHT LINE STIRRUP	SI9590K
21	ANGLE STIRRUP	SI9592C
22	32 mm (3/5.75) H.D. BARE COPPER	OS291V
23	COPPER LUG	21137R

B	28.3.85	STAY INSULATOR CHANGED.	JS
A	10.1.80	REDRAWN TO METRIC DIMENSIONS. DRG. No. WAS 4/A8	M.C. D.W.
Issue	Date	Revision	C.A.F. Dns. App

eastern electricity

ENGINEERING DIVISION

33 kV. DOUBLE CIRCUIT
(UNEARTHED)
INTERMEDIATE POLE


SCALE 1:20

DRAWING NO.

4/B1093


ISSUE

B

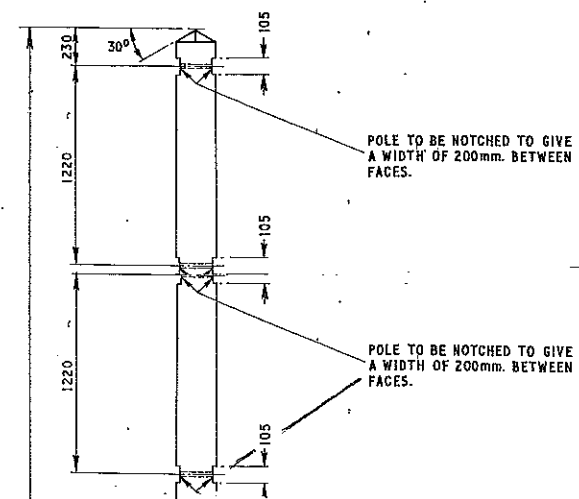

- DRILLINGS AND MARKINGS
- ALL HOLES TO BE 22 mm. DIA. UNLESS OTHERWISE STATED.
 - 75x6x6 mm. GOUGE MARK 3000 mm. UP FROM BUTT ON INSIDE OF LEGS.
 - BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
 - POLE TO BE MARKED AS PER INSET.
 - IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
 - LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.
 - THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:-
 - LENGTH AND DIAMETER OF POLE.
 - POLE NUMBER IN ACCORDANCE WITH SCHEDULE.
 NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

TYPICAL MARKINGS FOR WOOD POLES



- 11 = LENGTH OF POLE IN METRES.
 300 = DIAMETER OF POLE IN MILLIMETRES AT 1500 mm. FROM THE BUTT.
 1F = SPECIES CODE.
 79 = YEAR OF IMPREGNATION.
 6 = NAME OR MARK OF CREOSOTING FIRM.

POLE TO BE SCARFED TO GIVE A 100 mm. FACE.

1350 mm. FOR POLES UP TO AND INCLUDING 13 m.
 1650 mm. FOR POLES OVER 13 m.

