

DESIGN NOTES :
FOR 200sq mm. (18/1/3.86) A.C.S.R.
FOR SPANS OF BARE CONDUCTOR UP TO 170 m
AND SPANS OF P.V.C. COVERED CONDUCTORS UP TO 150 m.
FOR ANGLES OF DEVIATION NOT EXCEEDING 60°

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG. No.
1	POLE	TO SPECIFICATION
2	CROSSARM	S.18634 B
3	10" (254mm) DISC INSULATOR	S.19042 S
4	LINE POST INSULATOR - 33KV	S.19114 R
5	CONDUCTOR TERMINATING CLAMP	S.20202 C
6	BALL ENDED HOOK	S.19003 V
7	SOCKET TONGUE	S.18040 X
8	DANGER NOTICE	S.19214 V
9	BRACE BLOCK 2100 x 200 x 100 mm.	S.18059 J
10	CURVED WASHER FOR M20 DIA. BOLT	S.19910 R
11	PHASE IDENTIFICATION PLATES	S.19231-33
12	NON-TENSION COMPRESSION JOINT	21101 R
13	TRUSSING TACKLE (TYPE 'B' ONLY)	S.18145 V
14	NUMBER / LETTER PLATE	S.19260-69 S.19272-97
15	POLE TOP MAKE OFF	S.19426 E
16	GUY GRIP DEAD END	S.19427 N
17	STAY INSULATOR	S.19162 M
18	INSULATOR LINK	19400 M
19	STAY WIRE	S.19984 E
20	22mm DIA. ADJUSTABLE STAY ROD	S.19391 K
21	STAY BLOCK	S.18065 G
22	BARBED WIRE	S.19977 X
23	STRAIGHT LINE STIRRUP	S.19590 K


DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II. 75x6x6 mm GOUGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET.
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- VI. LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.
- VII. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE :
(a) LENGTH AND DIAMETER OF POLE
(b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.

NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.



X in m	Y in mm
10	3000
10.5	3300
11	3500
11.5	3800
12	4000
13	4500
14	4900
15	5400
16	5900
17	6400

TYPE B ONLY



II LENGTH OF POLE IN METRES
275 DIAMETER OF POLE IN MILLIMETRES AT 500mm FROM THE BUTT.
IF SPECIES CODE
77 YEAR OF IMPREGNATION
6 NAME OR MARK OF CREOSOTING FIRM.

POLE TO BE SCARFED TO GIVE 100mm FACE.

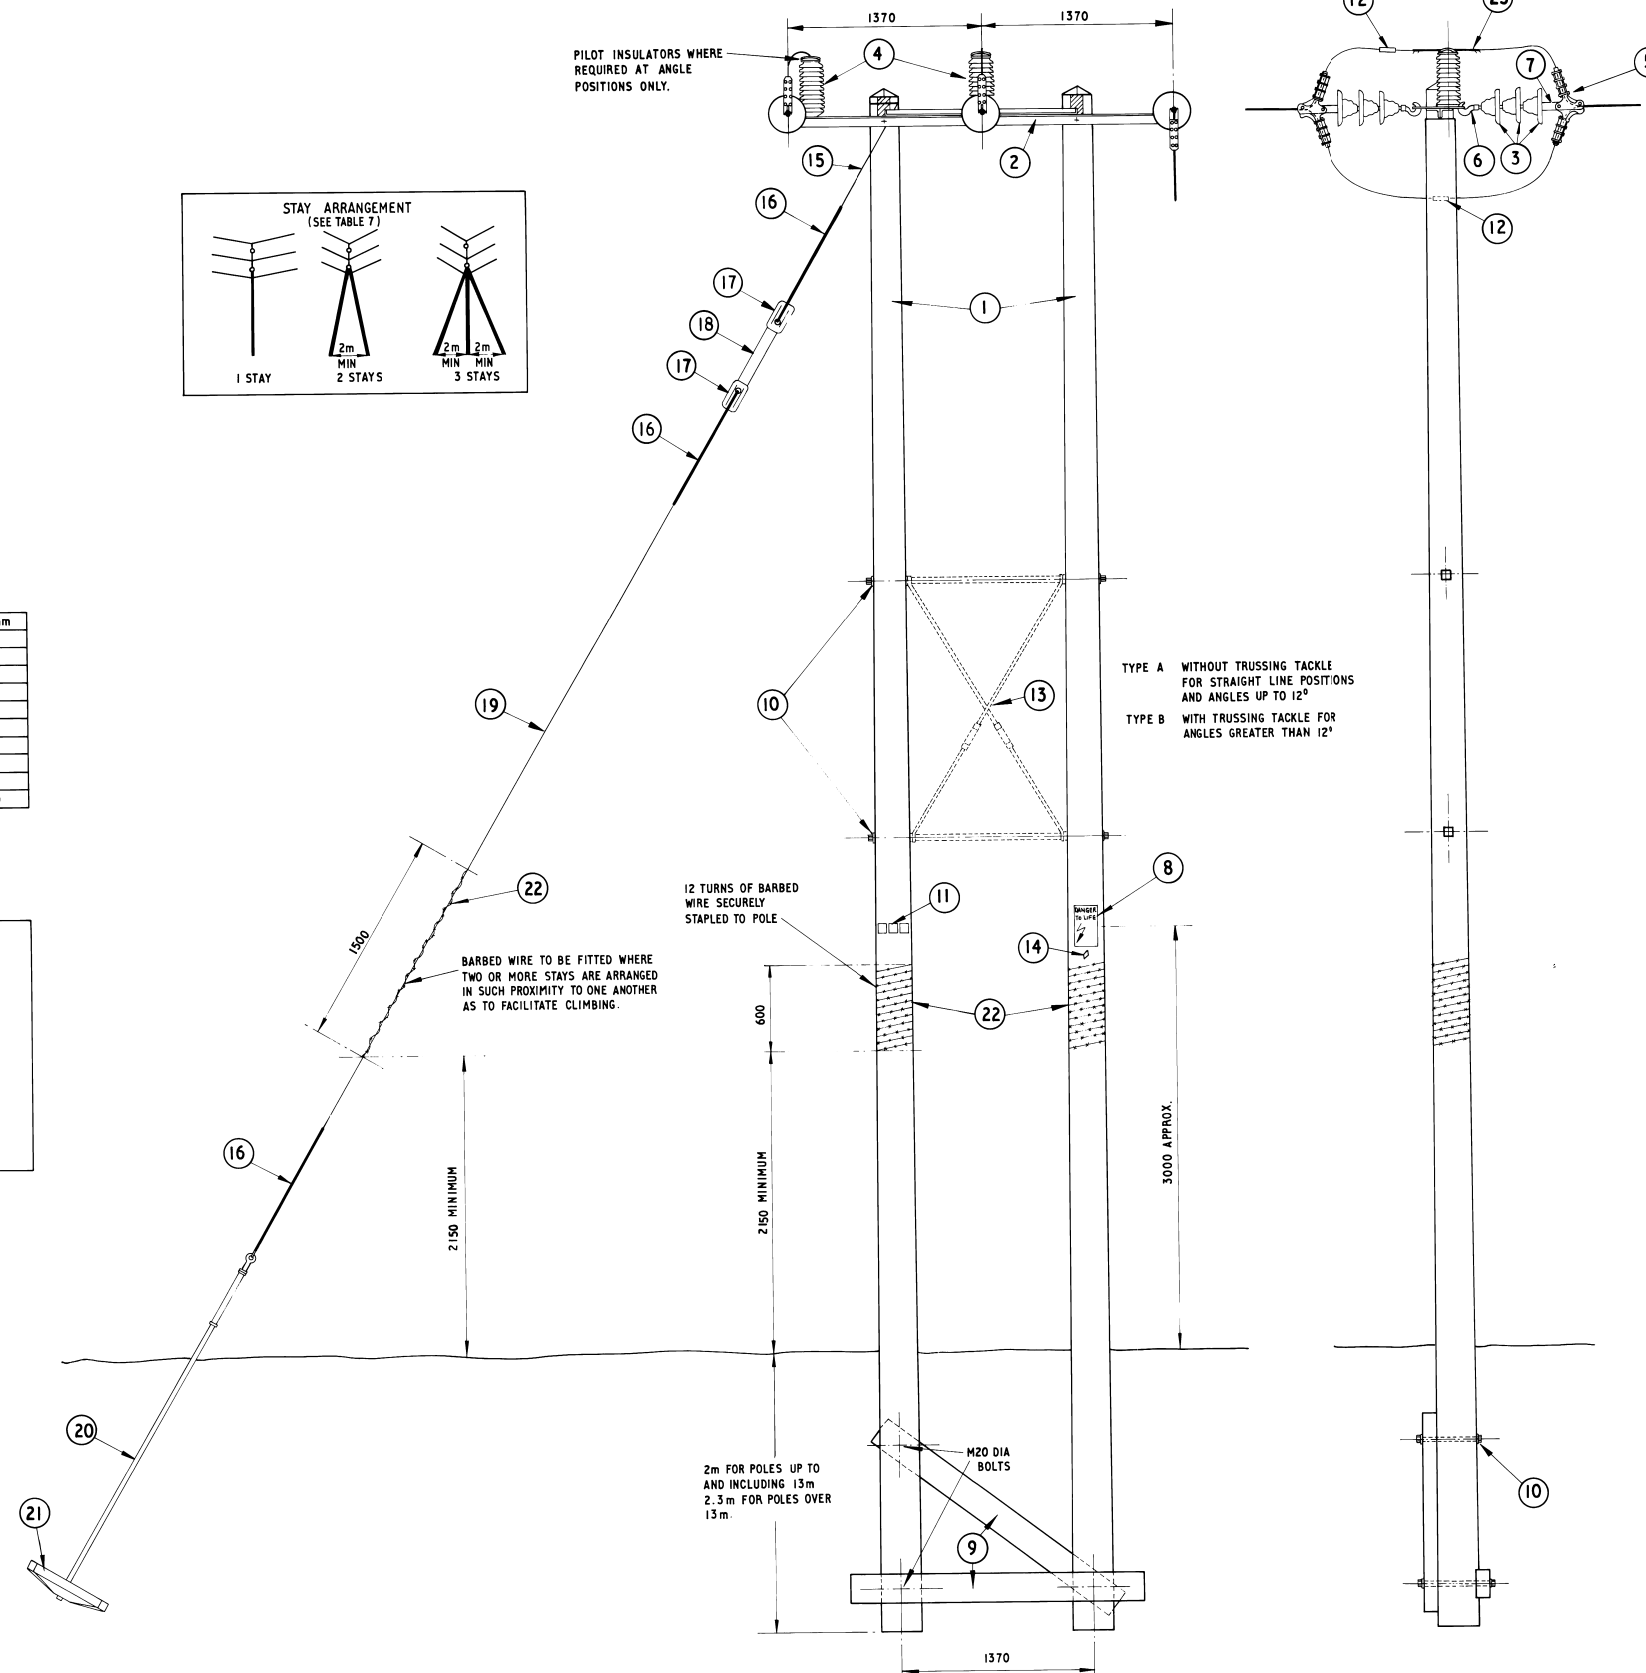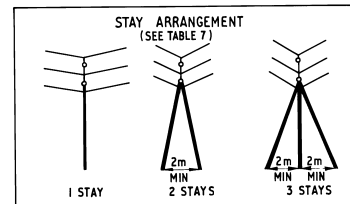

B	29.3.85	STAY INSULATOR AND TERMINATING CLAMP CHANGED	HL JP
A	16-12-77	REDRAWN TO METRIC DIMENSIONS. DRG. No. WAS 4/A5	MAC
Issue	Date	Revision	C.A.F. Dnn. App.

eastern electricity

ENGINEERING DIVISION

33KV SINGLE CIRCUIT
ANGLE / SECTION POLE

SCALE 1:20

DRAWING NO.

4/B1002

ISSUE

B

