


EQUIPMENT SCHEDULE		
ITEM No.	DESCRIPTION	DRG. No.
1	POLE	TO SPECIFICATION
2	CROSSARM	S18634 B
3	10" (254mm) DISC INSULATOR	S19042S
4	DEAD END CLAMP FOR 200sq. mm. A.C.S.R.	S20207V
5	BALL ENDED HOOK	S19003V
6	SOCKET TONGUE	S18040X
7	ARCING HORNS	S19018W-9F
8	SUPPORTING STEELWORK FOR 33kV. ROCKING TYPE ISOLATOR.	S18221A
9	SWITCHGEAR SUPPORTING GUSSET PLATE	S19224D
10	33kV. ROCKING TYPE ISOLATOR (SEE E.P. & E.S.S.M. VOL. 5 - SECT. 4)	—
11	ANGER NOTICE	S19214V
12	NUMBER/ LETTER PLATE	S19260-68 S19272-97
13	PHASE IDENTIFICATION PLATES	S19231-33
14	BARBED WIRE	S19977X
15	BRACE BLOCK 2100x200 x 100mm.	S18059J
16	CURVED WASHER FOR M20 DIA. BOLTS	S19910R
17	P.V.C. EARTH WIRE GUARD 2400mm. LONG	S18942E
18	BULL DOG GRIP (2 No. REQUIRED)	S19358Q
19	COUPLING	S19359Y
20	1500mm. LONG EXTENSIBLE EARTH ROD	S19455P
21	DRIVING POINT	S19357G
22	BI-METAL COMPRESSION LUG	
23	CATEGORY IDENTIFICATION LABEL	SEE E.I.OM6
24	RECOVERED 0-1in ² (17/136) H.D. BARE COPPER	05299Q
25	70mm ² (19/2.14) S.D. BARE ANNEALED COPPER	05300X
26	COPPER CRIMPIT (YC 26 C26)	21207X
27	70 mm ² (19/2.14) P.V.C. COVERED ANNEALED COPPER	41756T
28	32mm ² (5/3.75) H.D. BARE COPPER	05291V
29	'DEHSO' TAPE, 50 mm. WIDE	I2891R

A	12-12-77	ORIGINAL		MAC	<i>[Signature]</i>
Issue	Date	Revision	C.A.F.	Dr.	App.

CHIEF ENGINEER'S DEPARTMENT

SCALE 1 : 20

A

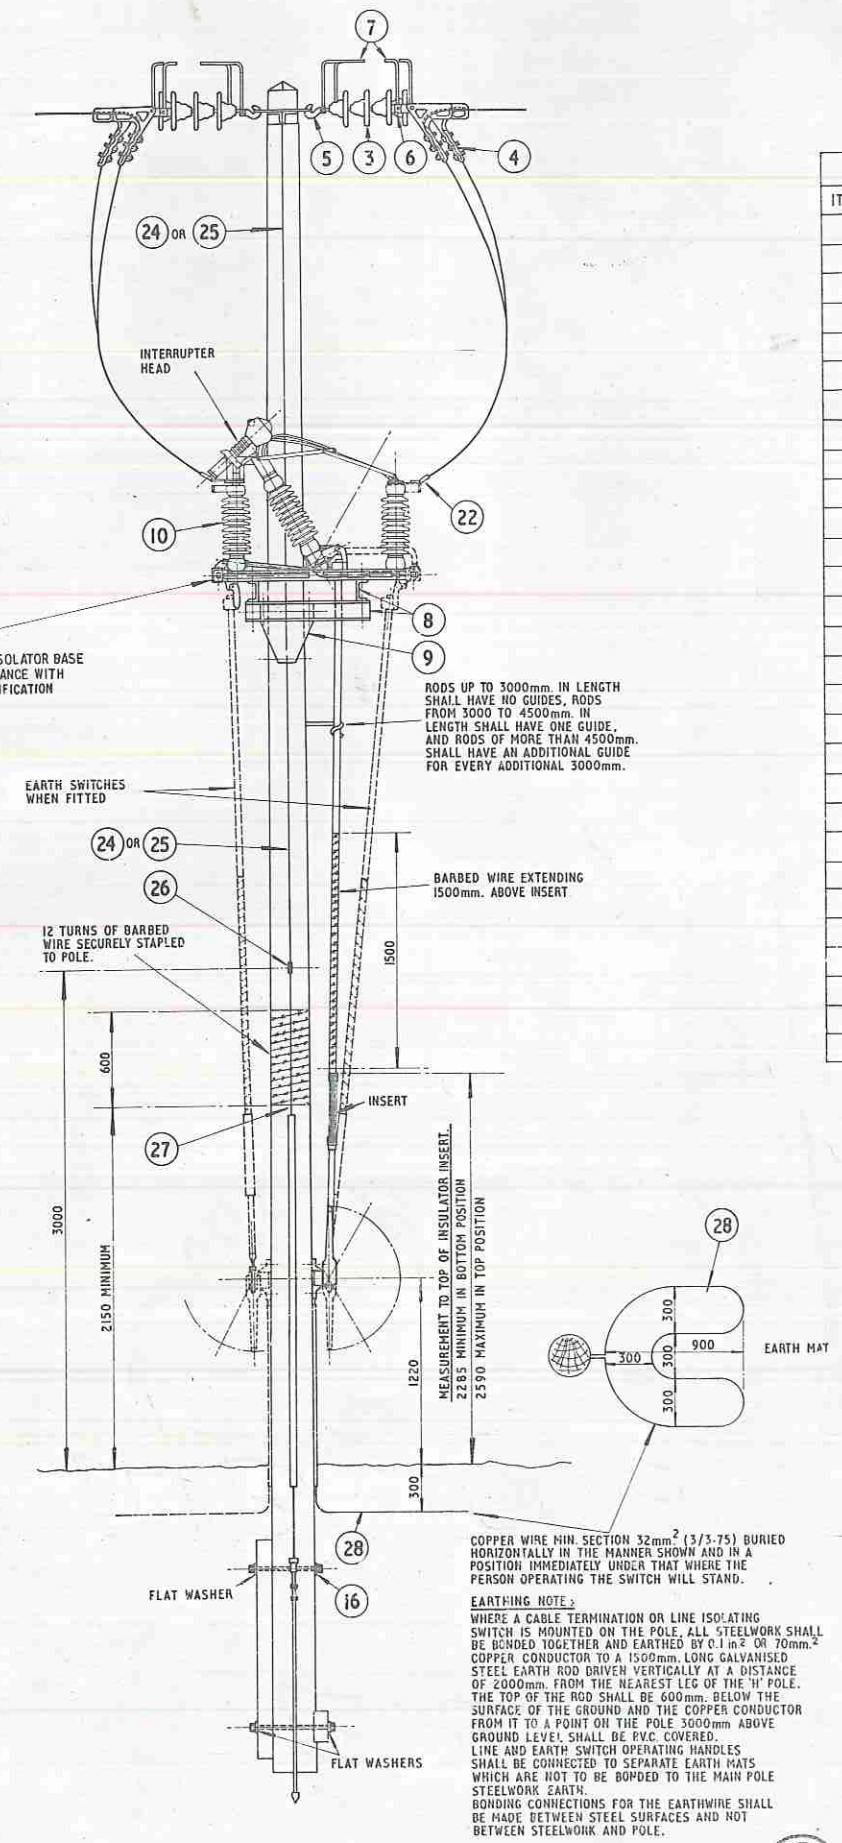

COPPER WIRE MIN. SECTION 32mm^2 (3/3-75) BURIED HORIZONTALLY IN THE MANNER SHOWN AND IN A POSITION IMMEDIATELY UNDER THE TOWER OF THE PERSON OPERATING THE SWITCH WILL STAND.

EARTHING NOTE:

WHERE A CABLE TERMINATION OR LINE ISOLATING SWITCH IS MOUNTED ON THE POLE, ALL STEELWORK SHALL BE BUNDLED TOGETHER AND EARTHED BY 0.1m^2 OR 70mm^2 COPPER CONDUCTOR TO A 1500mm LONG GALVANIZED STEEL EARTH ROD DRIVEN VERTICALLY AT A DISTANCE OF 2000mm FROM THE NEAREST LEG OF THE H.P. POLE. THE TOP OF THE ROD SHALL BE 900mm ABOVE THE SURFACE OF THE GROUND. THE CABLE CONDUCTOR FROM IT TO A POINT ON THE POLE 3000mm ABOVE GROUND LEVEL SHALL BE P.V.C. COVERED.

LINE AND EARTH SWITCH OPERATING HANDLES SHALL BE CONNECTED TO SEPARATE EARTH MATS WHICH ARE NOT TO BE BOPED TO THE MAIN POLE STEELWORK EARTH.

BONDING CONNECTIONS FOR THE EARTHWIRE SHALL BE MADE BETWEEN STEEL SURFACES AND NOT BETWEEN STEELWORK AND POLE.