


DESIGN NOTES:

THIS ARRANGEMENT IS SUITABLE ONLY WHEN THERE IS NO LINE DEVIATION. FOR LINE DEVIATIONS THE JUMPER CONNECTIONS ON TWO PHASES MUST BE TAKEN ABOVE THE CROSSARM AND SUPPORTED ON LINE POST INSULATORS TO MAINTAIN ADEQUATE CLEARANCES (SIMILAR TO ANGLE/SECTION POLE DRG. No. 4/B1002).

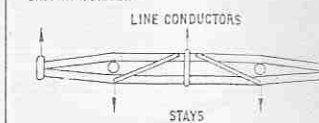

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG. No.
1	POLE	SPECIFICATION
2	CROSSARM	S.18634 B
3	10" (254mm) DISC INSULATOR	S.190425
4	DEAD END CLAMP FOR 200 sq. mm. A.C.S.R.	S.20207 V
5	BALL ENDED HOOK	S.19003 V
6	SOCKET TONGUE	S.18040 X
7	DANGER NOTICE	S.19214 V
8	BRACE BLOCK, 2100 x 200 x 100 mm	S.18055 J
9	CURVED WASHER FOR M20 DIA. BOLTS	S.19910 R
10	PHASE IDENTIFICATION PLATES	S.19231-33
11	NON-TENSION COMPRESSION JOINT	S.19250-03
12	NUMBER/LETTER PLATE	S.19272-97
13	POLE TOP MAKE OFF	S.19426 E
14	GUY GRIP DEAD END	S.19427 N
15	STAY INSULATOR	S.19586 G
16	STAY WIRE	S.19984 E
17	22 mm DIA. ADJUSTABLE STAY ROD	S.19391 K
18	STAY BLOCK	S.18065 G
19	BARBED WIRE	S.19977 X
-	LINE POST INSULATORS-33KV (SEE NOTE ABOVE)	S.19114 R
-	STRAIGHT LINE STIRRUP (SEE NOTE ABOVE)	S.19590 K


POLE TO BE SCARFED FOR A DISTANCE OF 280mm FROM THE POLE TOP TO GIVE A WIDTH OF 190mm BETWEEN FACES.

DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II. 75x6x6mm GOUGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET.
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- VI. LEGS OF 'H' POLE TO BE CAREFULLY MATCHED.
- VII. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:
(a) LENGTH AND DIAMETER OF POLE
(b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE


NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

TYPICAL MARKINGS FOR WOOD POLES



POLE TO BE SCARFED TO GIVE A 100mm FACE.

OVERALL LENGTH AND DIAMETER AS SPECIFIED

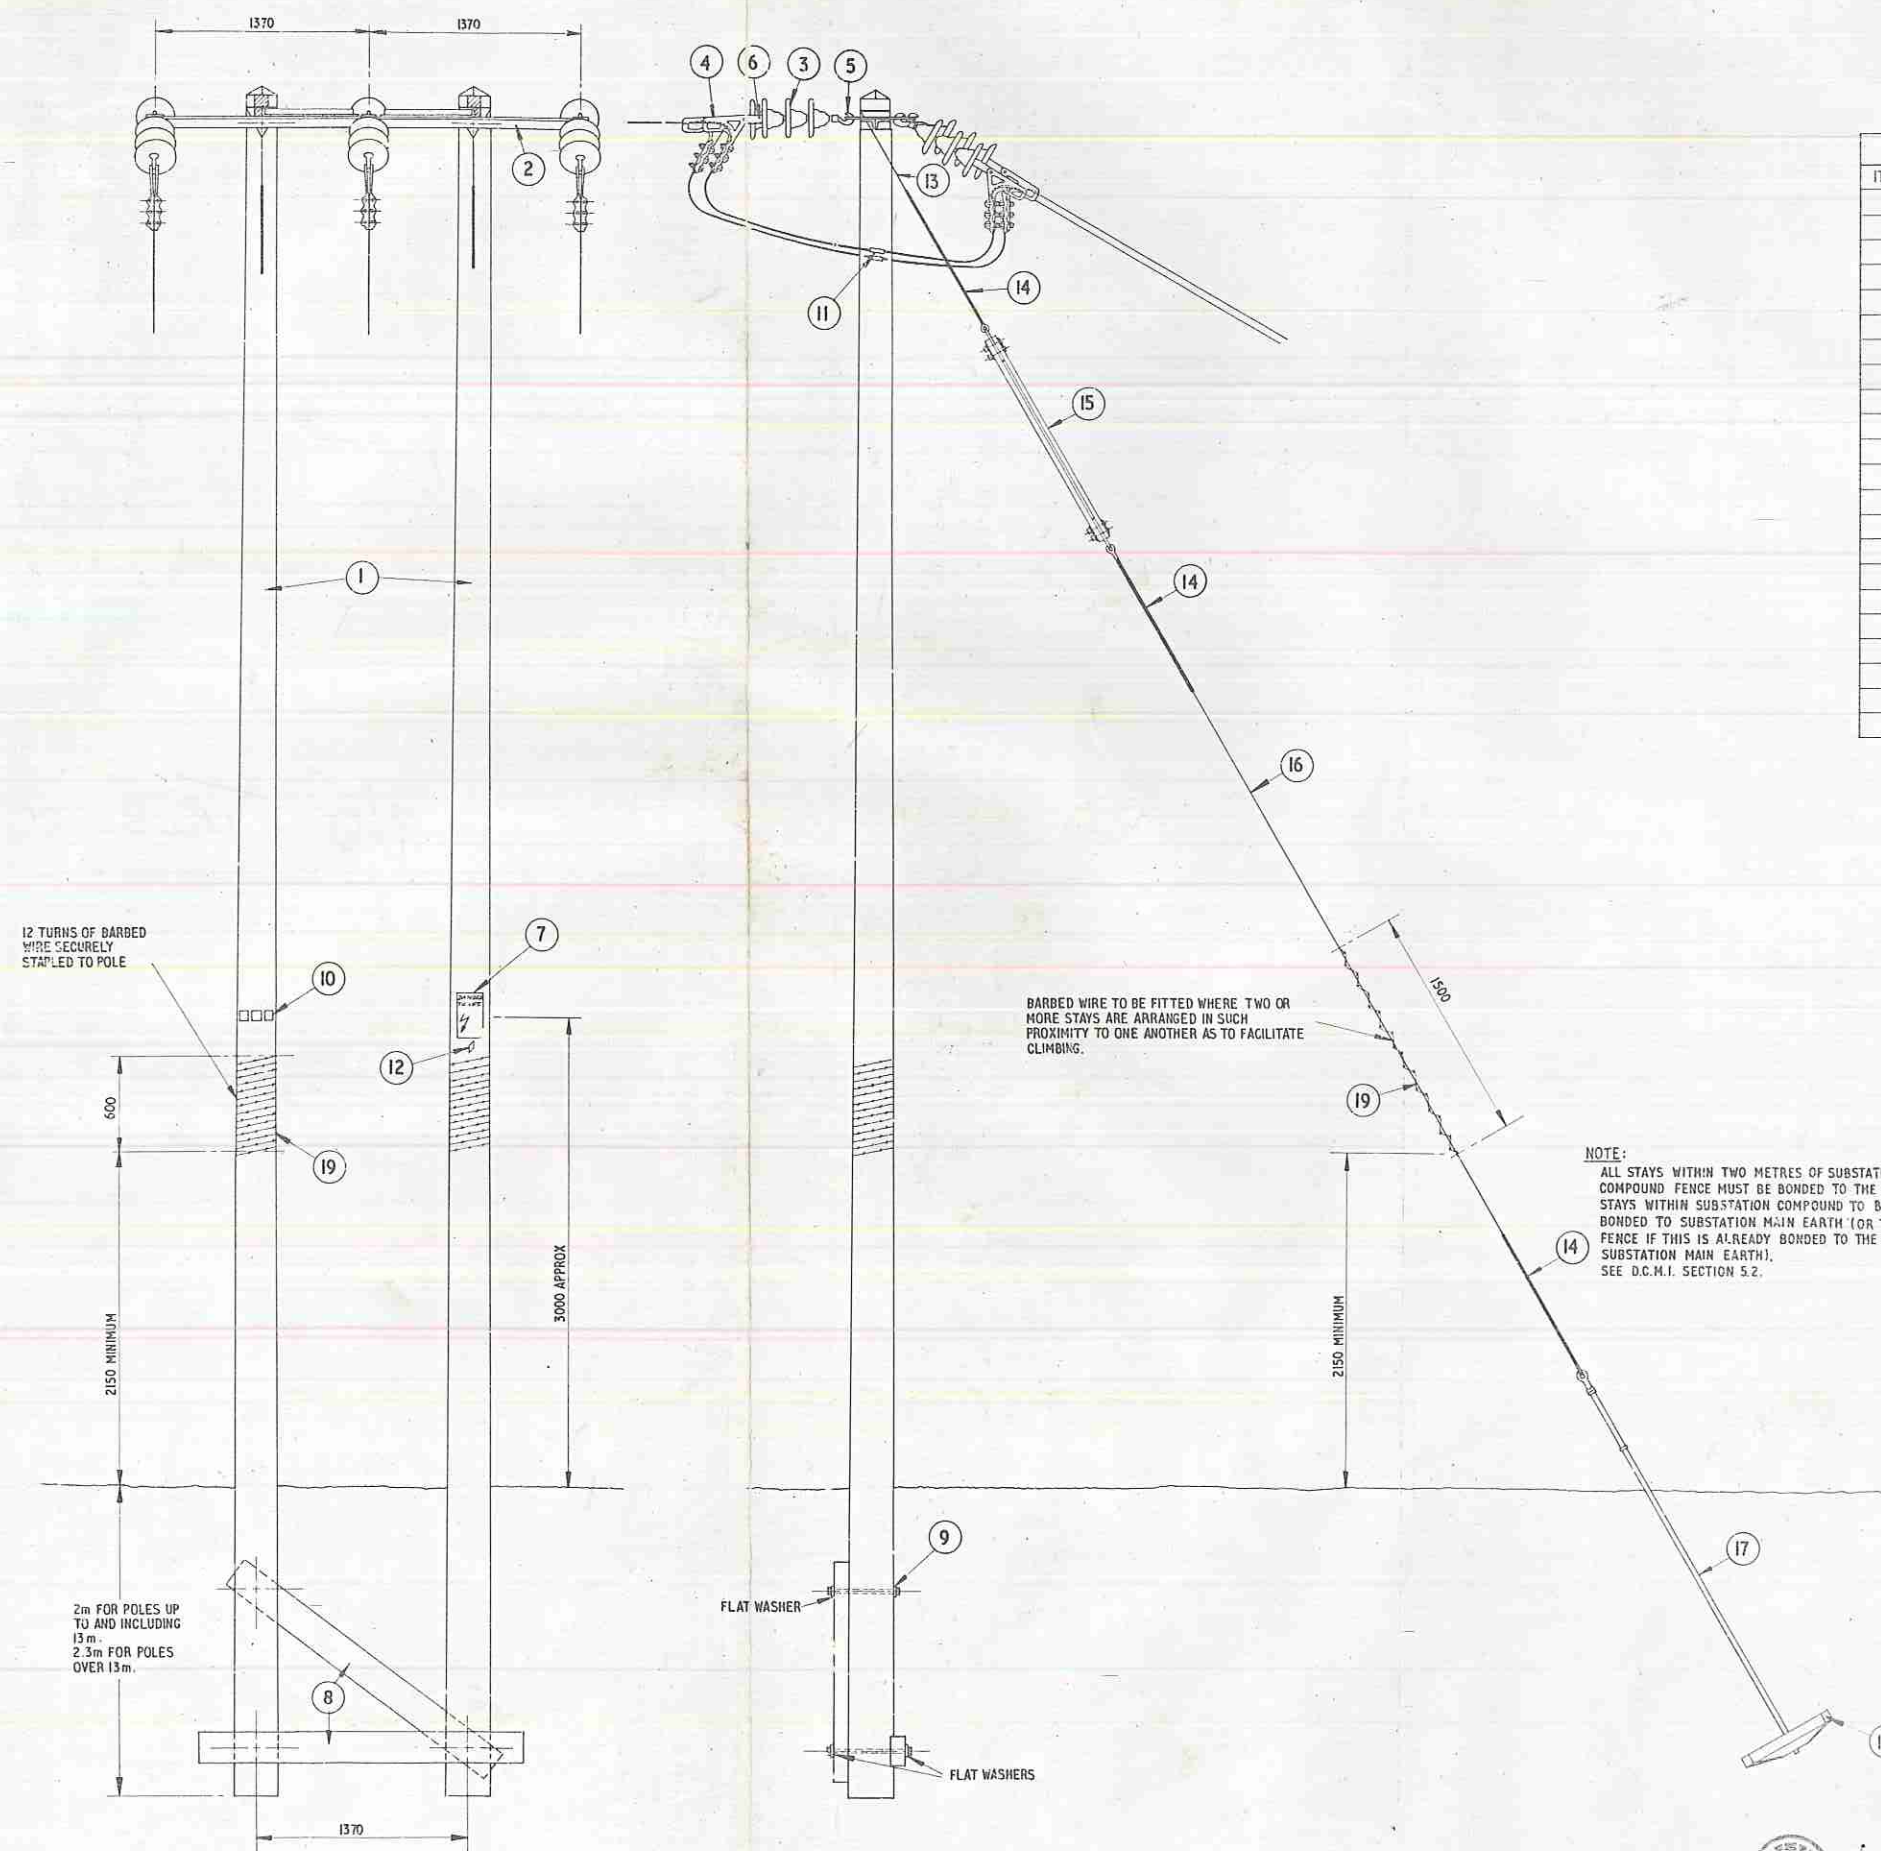

BARBED WIRE TO BE FITTED WHERE TWO OR MORE STAYS ARE ARRANGED IN SUCH PROXIMITY TO ONE ANOTHER AS TO FACILITATE CLIMBING.

NOTE:

ALL STAYS WITHIN TWO METRES OF SUBSTATION COMPOUND FENCE MUST BE BONDED TO THE FENCE. STAYS WITHIN SUBSTATION COMPOUND TO BE BONDED TO SUBSTATION MAIN EARTH (OR TO THE FENCE IF THIS IS ALREADY BONDED TO THE SUBSTATION MAIN EARTH). SEE D.C.M.1. SECTION 5.2.

A	19.1.78	ORIGINAL	MAC
Issue	Date	Revision	CAT

eastern electricity

CHIEF ENGINEER'S DEPARTMENT

33KV TERMINAL POLE
OVERHEAD CONNECTION

SCALE 1:20
DRAWING NO.

4/B1009

