

12

DESIGN NOTES:  
FOR 200sq. mm. (18/1/3.86) A.C.S.R.  
NORMAL SPAN - 106 m.  
MAXIMUM SPAN:  
BARE CONDUCTOR - 135 m.  
P.V.C. COVERED CONDUCTOR - 120 m.  
FOR STRAIGHT LINE POSITIONS AND ANGLES  
OF DEVIATION UP TO 5°

EQUIPMENT SCHEDULE

| ITEM No. | DESCRIPTION                                                | DRG. No.              |
|----------|------------------------------------------------------------|-----------------------|
| 1        | POLE                                                       | TO SPECIFICATION      |
| 2        | CROSSARM 2-102 x 51 x 10.42 kg/m CHANNEL - 4670 mm. LONG.  | SI8643A               |
| 3        | CROSSARM 2-102 x 51 x 10.42 kg/m. CHANNEL - 5890 mm. LONG. | SI8642R               |
| 4        | LINE POST INSULATOR 33 kV                                  | SI9114R               |
| 5        | LINE POST INSULATOR MOUNTING PLATE                         | SI9228N               |
| 6        | M20 DOUBLE ENDED STUD                                      | SI7770Y               |
| 7        | CIRCUIT IDENTIFICATION PLATES                              | SI9184U               |
| 8        | WARNING NOTICE                                             | SI9197D               |
| 9        | DANGER NOTICE                                              | SI9214V               |
| 10       | NUMBER/LETTER PLATE                                        | SI9260-69<br>SI922-97 |
| 11       | KICKING/BRACE BLOCK 2400 x 200 x 100 mm.                   | SI8057R               |
| 12       | CURVED WASHER FOR M20 DIA. BOLTS                           | SI9910R               |
| 13       | POLE TOP MAKE OFF                                          | SI9426E               |
| 14       | GUY GRIP DEAD END                                          | SI9427N               |
| 15       | STAY INSULATOR                                             | SI9158J               |
| 16       | STAY WIRE                                                  | SI9924E               |
| 17       | 22 mm. DIA. ADJUSTABLE STAY ROD                            | SI9331K               |
| 18       | STAY BLOCK                                                 | SI8055G               |
| 19       | STRAIGHT LINE STIRRUP                                      | SI9590K               |
| 20       | ANGLE STIRRUP                                              | SI9592C               |
| 21       | 32mm <sup>2</sup> (3/3.75) H.D. BARE COPPER                | 05291 T               |
| 22       | COPPER LUG (B.I.C.C. BRAND) - YCA2C5-50                    | 21137 R               |

|     |         |                                                     |            |
|-----|---------|-----------------------------------------------------|------------|
| A   | 10-1-80 | REDRAWN TO METRIC<br>DIMENSIONS<br>DRG. No WAS 4/A8 | MC<br>D.W. |
| Rev | Date    | Revision                                            | Drawn App  |

eastern electricity

CHIEF ENGINEER'S DEPARTMENT

33 kV. DOUBLE CIRCUIT  
(UNEARTHED)  
INTERMEDIATE POLE


SCALE 1:10

DRAWING NO.


4/B1093

ISSUE

A

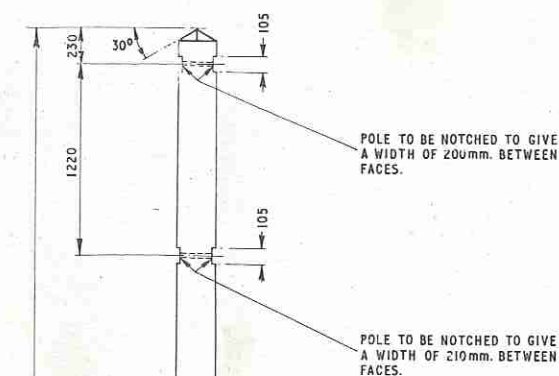

DRILLINGS AND MARKINGS  
I. ALL HOLES TO BE 22mm. DIA. UNLESS OTHERWISE STATED.  
II. 75 x 6 x 6 mm. GOUGE MARK 3000 mm. UP FROM BUTT ON INSIDE OF LEGS.  
III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.  
IV. POLE TO BE MARKED AS PER INSET.  
V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.  
VI. LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.  
VII. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:  
(a) LENGTH AND DIAMETER OF POLE.  
(b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.  
NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

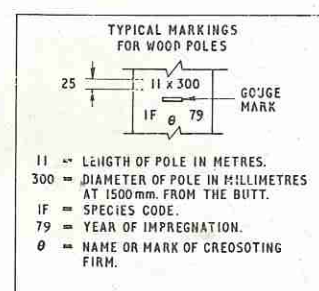

POLE TO BE SCARFED TO GIVE A 100mm. FACE.  
1350mm. FOR POLES UP TO AND INCLUDING 13m.  
1650mm. FOR POLES OVER 13m.

