


DRILLINGS


ARRANGEMENT 'A' ARRANGEMENT 'B'

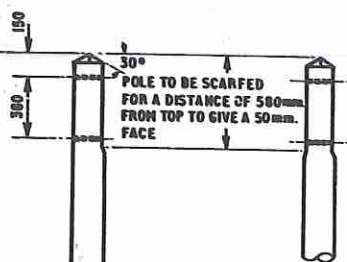

DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm. DIA. UNLESS OTHERWISE STATED.
- II. 75 x 6 x 6 mm. GOUGE MARK 3000mm. UP FROM BUTT.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET.
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRAL.
- VI. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE.
 - (a) LENGTH AND DIAMETER OF POLE.
 - (b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.


NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.




9.5 = LENGTH OF POLE IN METRES.
225 = DIAMETER OF POLE IN MILLIMETRES
AT 1500 mm. FROM THE BUTT.
IF = SPECIES CODE
80 = YEAR OF IMPREGNATION
0 = NAME OR MARK OF CREOSOTING
FIRM.

POLE TO BE SCARFED
TO GIVE A 100mm. FACE.
(THIS DRILLING AND SCARFING
TO BE PROVIDED ONLY WHEN SPECIFIED)


1000 mm. FOR POLES UP TO & INCLUDING 10.5m.
1300 mm. FOR POLES OVER 10.5m. UP TO AND
INCLUDING 14m.
1600 mm. FOR POLES OVER 14m.

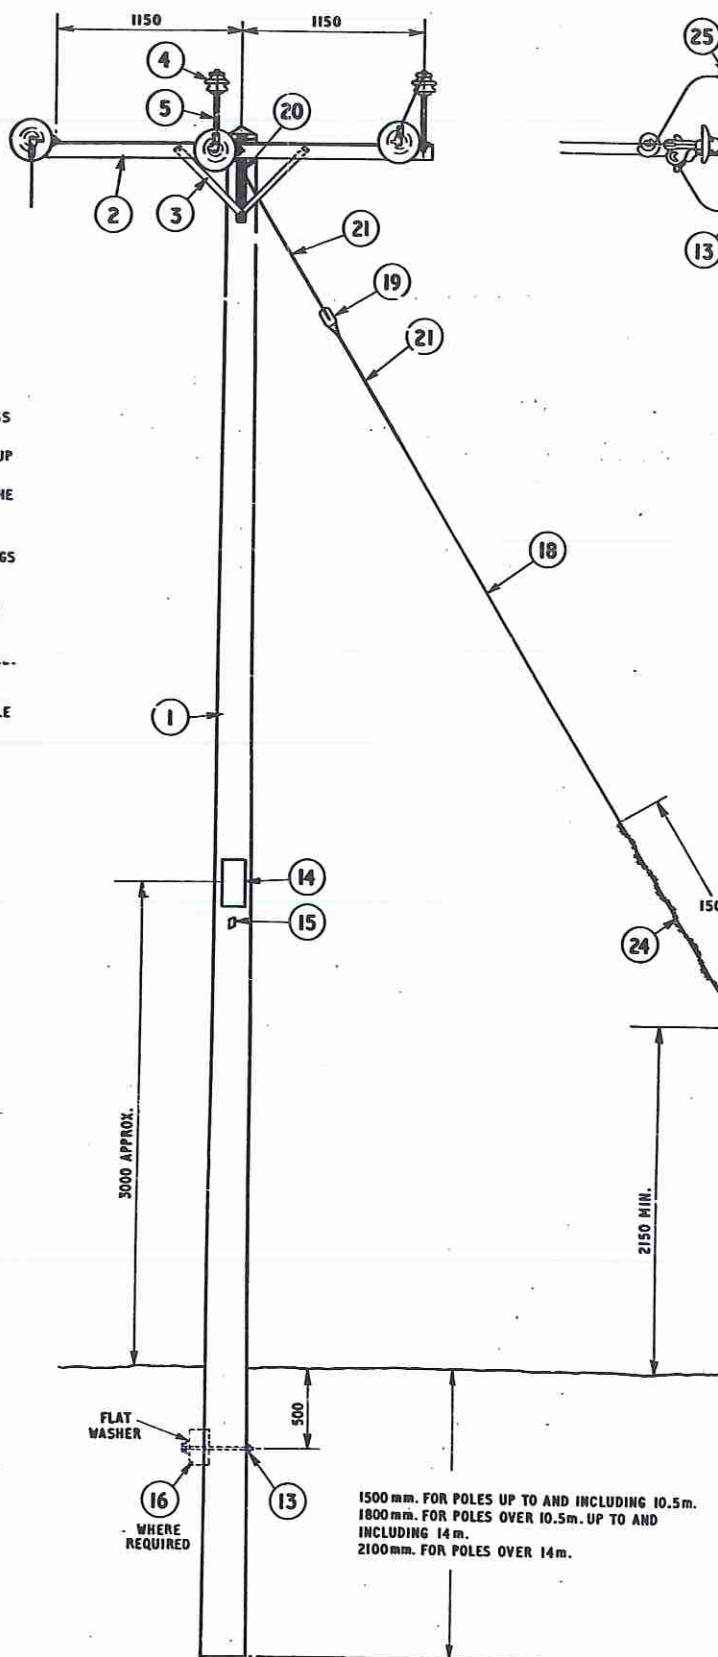


NO ANTI-CLIMBING DEVICES ARE REQUIRED ON SINGLE WOOD POLES WITH AN UNBROKEN SURFACE WITHIN 3000mm OF THE GROUND. BARBED WIRE TO BE FITTED TO STAYS WHERE TWO OR MORE ARE ARRANGED IN SUCH PROXIMITY TO ONE ANOTHER AS TO FACILITATE CLIMBING.

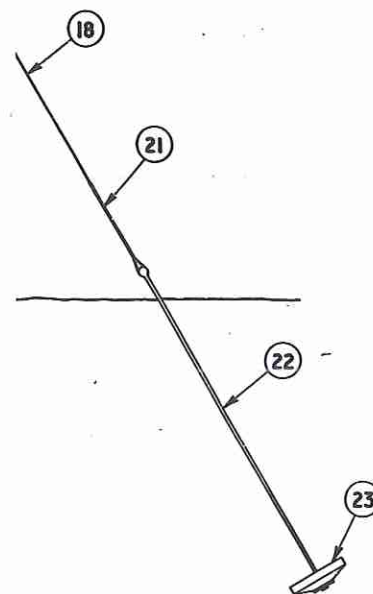



ARRANGEMENT 'A' FOR LINE DEVIATIONS UP TO 30°

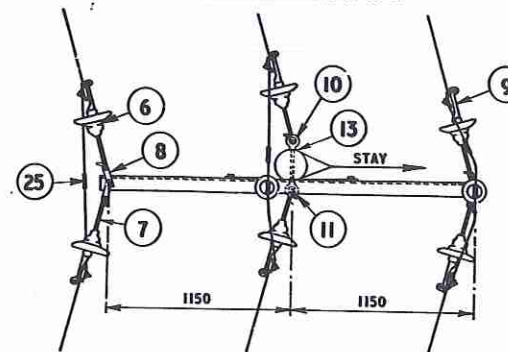

ARRANGEMENT 'B' FOR DEVIATIONS ABOVE 30° AND UP TO 75°

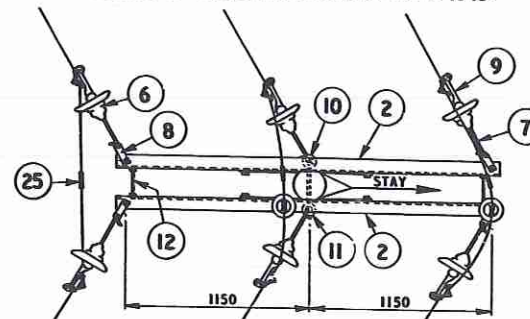

ARRANGEMENT 'C' FOR DEVIATIONS ABOVE 75°

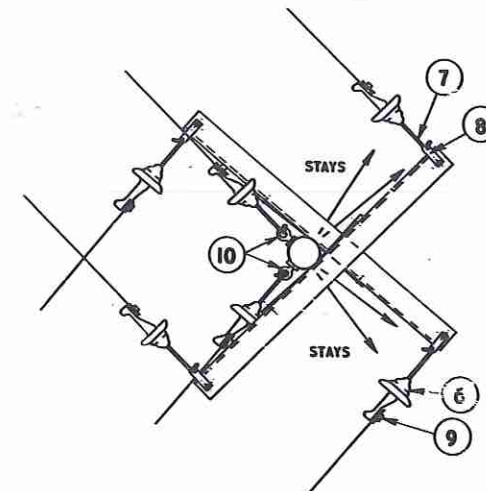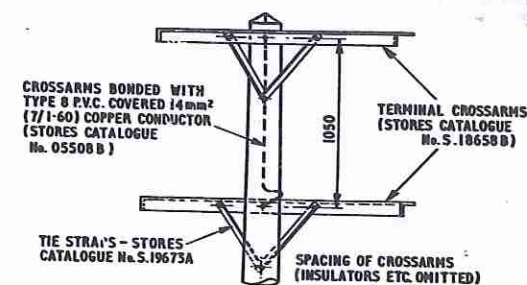

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRAW'ING No.
1	POLE	TO SPECIFICATION
2	CROSSARM 100x75x10mm, M.S. ANGLE 2400mm. LONG.	S 18657 S
3	TIE STRAP	S 19673 A
4	INSULATOR - PIN TYPE	S 19075 R
5	INSULATOR PIN - PILOT	S 19455 T
6	255mm. DIA. DISC INSULATOR	S 19042 S
7	BALL-ENDED HOOK	S 19010 C
8	TERMINATING STRAP	S 19716 K
9	TERMINATING CLAMP	S 20268 A
10	EYEBOLT	S 16464 L
11	EYE	S 16541 Y
12	TIE BOLT	S 17770 Y
13	CURVED WASHER FOR M20 BOLT	S 19910 R
14	DANGER NOTICE	S 19214 V
15	NUMBER / LETTER PLATE	S 19260 - 69 S 19272 - 97
16	KICKING BLOCK 1300 x 250 x 125 mm.	S 18064 X
17	STIRRUP BINDING	S 19585 V
18	STAYWIRE	S 19985 H
19	STAY INSULATOR	S 19164 E
20	POLE TOP MAKE OFF	S 19402 E
21	GUY GRIP DEAD END	S 19401 V
22	NON - ADJUSTABLE STAY ROD	S 19398 V
23	STAYBLOCK	S 18069 R
24	BARBED WIRE	S 19977 X
25	NON-TENSION COMPRESSION JOINT	S 21096 Y

NOTE:
FOR SCHEDULE OF NUTS AND BOLTS REQUIRED
REFER TO DCM 4 SECTION 7.5.

A	31-7-81	ORIGINAL		R.H. D.W.
Issue	Date	Revision	C.A.F.	Dr. App.

eastern electricity

CHIEF ENGINEER'S DEPARTMENT

11KV LIGHT CONSTRUCTION
ANGLE/SECTION POLE

SCALE 1:20

DRAWING NO.

4/B1127

ISSUE	A
-------	---