

EQUIPMENT SCHEDULE	
ITEM NO.	DESCRIPTION
1	POLE
2	CROSSARM 150x75x10mm H.S. ANGLE 2100mm LONG
3	TIE STRAP
4	255 DIA. DISC INSULATOR
5	BALL ENDED HOOK
6	TERMINATING STRAP
7	TERMINATING CLAMP
8	EYEBOLT
9	CURVED WASHER FOR H20 BOLT
10	DANGER NOTICE
11	NUMBER/LETTER PLATE
12	PHASE IDENTIFICATION PLATES
13	KICKING BLOCK 1300 x 250 x 125mm
14	STAYWIRE
15	STAYWIRE INSULATOR
16	POLE TOP MAKE-OFF
17	LINE SPICE
18	GUY GRIP DEAD END
19	NON-ADJUSTABLE STAY ROD
20	STAY BLOCK
21	BARBED WIRE
22	ANTI-CLIMBING BRACKET
23	11kV CABLE BOX
24	CABLE BOX MOUNTING PLATE
25	CABLE SADDLE
26	TYPE B PVC COVERED 14mm ² (7/160) COPPER CONDUCTOR
27	EARTH WIRE GUARD
28	CABLE GUARD
29	EXTENSIBLE EARTH ROD
30	EARTH ROD DRIVING POINT
31	EARTH ROD COUPLING
32	BULL DOG GNP
33	DEMISO TAPE - 50mm WIDE
34	CABLELOCK CUMPIPT
35	BI-METAL COMPRESSION LUG
36	50mm ² (7/3.10) BARE ALUMINIUM
37	11kV SURGE DIVERTER
38	SURGE DIVERTER MOUNTING STEELWORK
39	COACHSCREW 3in x 7/8 in DIA.

NOTE: FOR SCHEDULE OF NUTS AND BOLTS REQUIRED REFER TO D.C.M.4 SECTION 7-5.

eastern electricity

CHIEF ENGINEER'S DEPARTMENT

11kV LIGHT CONSTRUCTION TERMINAL POLE



SCALE 1:20

DRAWING NO. 4/81128

ISSUE A

EARTHING NOTE:
WHERE A CABLE BOX OR OTHER HIGH-VOLTAGE APPARATUS IS MOUNTED ON THE POLE, ALL STEELWORK SHALL BE BONDED AND EARTHED BY TYPE B PVC COVERED 14mm² (7/160) COPPER CONDUCTOR.
SECTION 7-2.
THE STAY IS TO BE BONDED TO THE EARTHED STEELWORK IN ACCORDANCE WITH D.C.M.4 BONDING AND EARTHING CONNECTIONS SHALL BE CLAMPED BETWEEN STEEL SURFACES AND NOT BETWEEN STEELWORK AND POLE.

ISSUED
- 6 AUG 2001

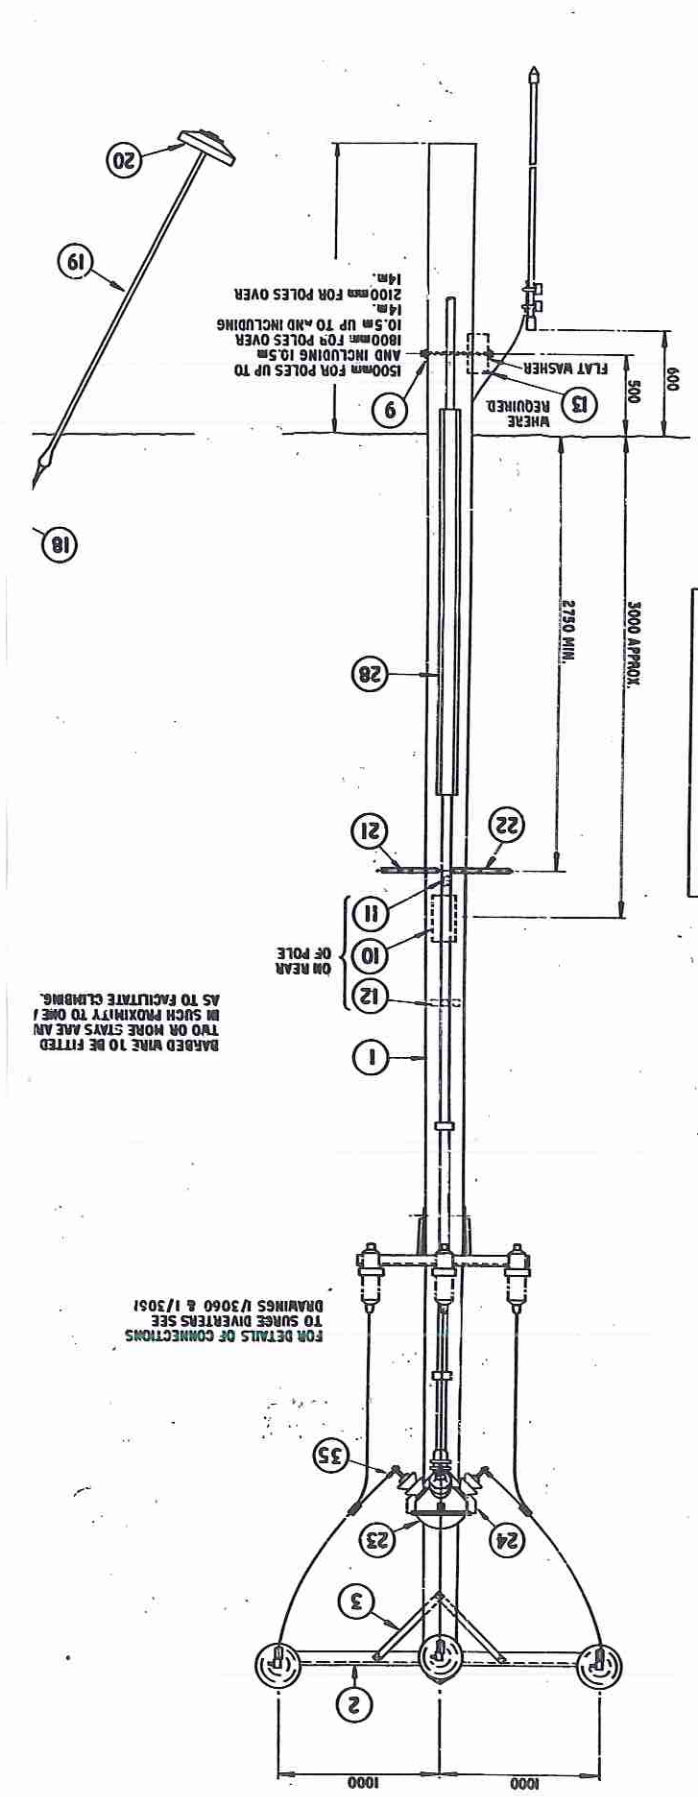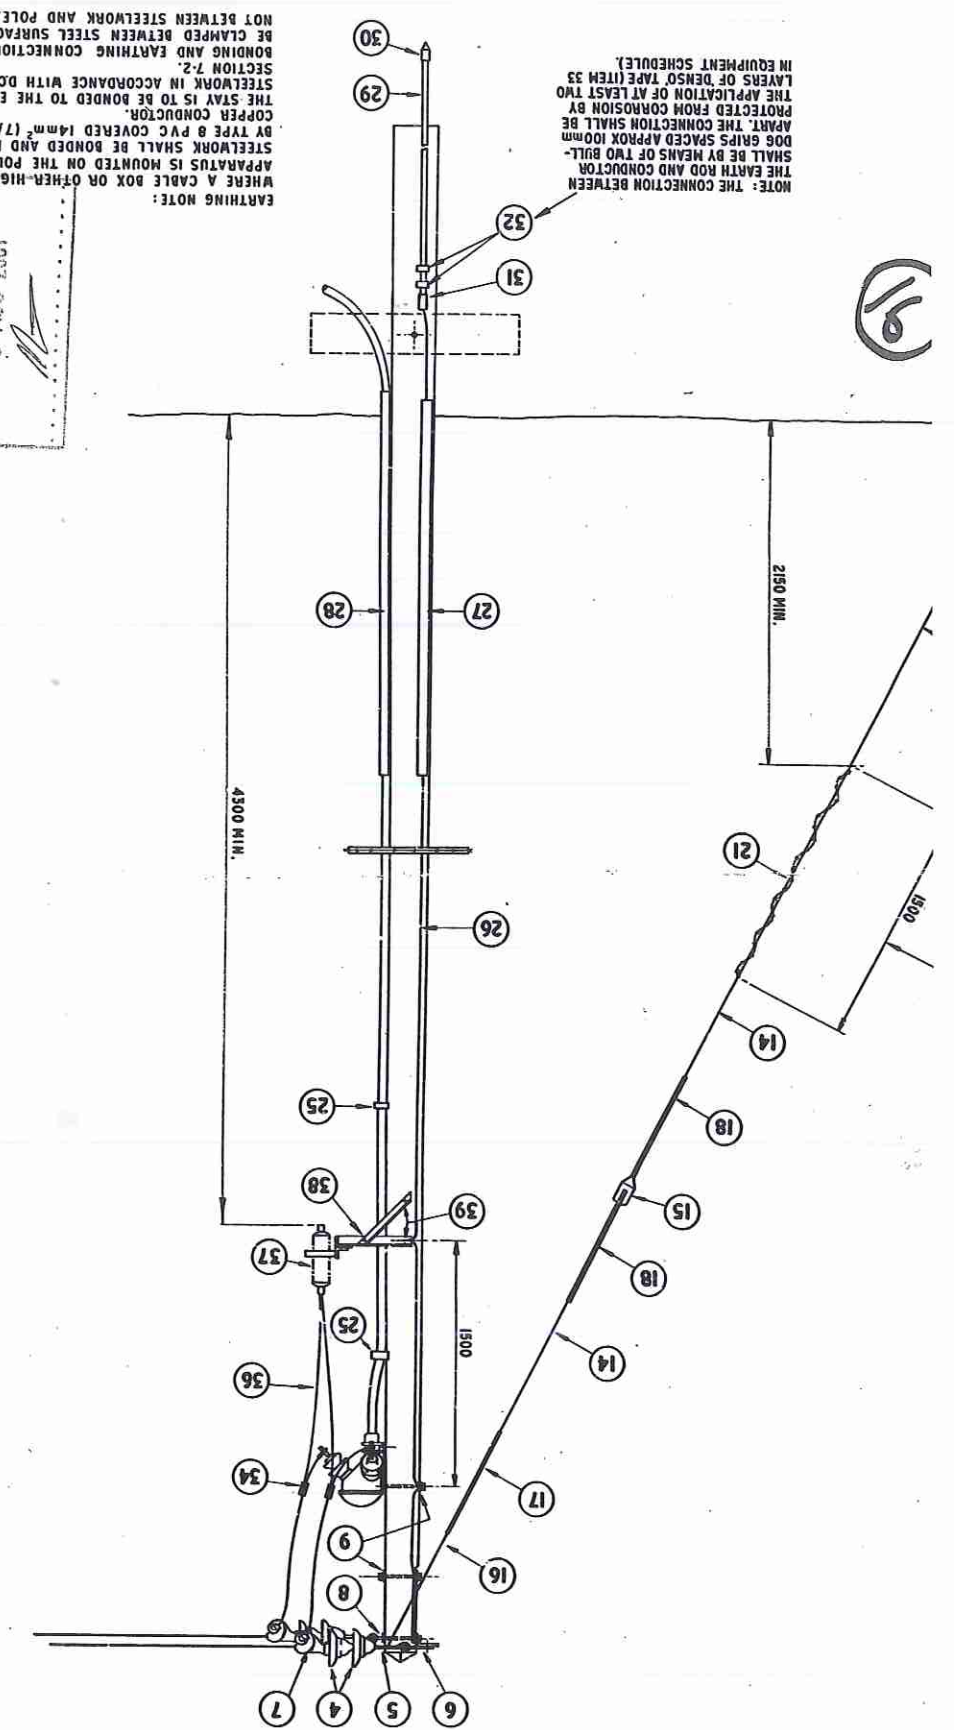

DRILLINGS AND MARKINGS:

I. ALL HOLES TO BE 22mm DIA UNLESS OTHERWISE STATED.

II. 75x6x6mm GOUGE MARK 3000mm UP FROM BUTT.

III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.

IV. POLE TO BE MARKED AS PER INSET.

V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.

VI. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRANT OF BUTT OF POLE: (a) LENGTH AND DIAMETER OF POLE; (b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.

NOTE - THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

TYPICAL MARKINGS FOR WOOD POLES:

9.5 = LENGTH OF POLE IN METRES.
225 = DIAMETER OF POLE IN MILLIMETRES.
AT 1500mm FROM BUTT.
IF = SPECIES CODE.
00 = YEAR OF IMPREGNATION.
0 = FIRM.
NAME ON MARK OF CROSBOTING

POLE TO BE SCARFED FOR A DISTANCE OF 500mm FROM POLE TOP TO GIVE A 50mm FACE.

30°

DRILLINGS

OVERALL LENGTH AND DIAMETER AS SPECIFIED