

DESIGN NOTES:
 FOR 300sq. mm. (19/4-75) A.C.A.R.
 FOR SPANS OF BARE CONDUCTOR UP TO 165m
 AND SPANS OF PVC COVERED CONDUCTORS UP TO 145m
 FOR ANGLES OF DEVIATION NOT EXCEEDING 60°

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG No.
1	POLE	TO SPECIFICATION
2	CROSSARM	S.18634 B
3	10" (254mm) DISC INSULATOR	S.19042 S
4	LINE POST INSULATOR - 33kv LARGE TOP	S.19113 M
5	CONDUCTOR WEDGE CLAMP	20180 R
6	BALL ENDED HOOK	S.19003 V
7	SOCKET TONGUE	S.18040 X
8	DANGER NOTICE	S.19214 V
9	BRAC BLOCK 2100 x 200 x 100 mm.	S.18059 J
10	CURVED WASHER FOR M20 DIA. BOLT	S.19910 R
11	PHASE IDENTIFICATION PLATES	S.19231-33
12	NON-TENSION COMPRESSION JOINT	21031 K
13	TRUSSING TACKLE (TYPE 'B' ONLY)	S.18145 V
14	NUMBER / LETTER PLATE	S.19260-69 S.19272-97
15	POLE TOP MAKE OFF	S.19426 E
16	GUY GRIP DEAD END	S.19427 N
17	STAY INSULATOR	S.19162 M
18	INSULATOR LINK	19400 M
19	STAY WIRE	S.19984 E
20	22mm DIA. ADJUSTABLE STAY ROD	S.19391 K
21	STAY BLOCK	S.18065 G
22	BARBED WIRE	S.19977 X
23	DOUBLE DISTRIBUTION TIE	19624 V
24	SOCKET CLEVIS	S.18022 A
25	COMPRESSION DEADEND	20930 N
26	ALUMINIUM LUG	21126 A

DRILLINGS AND MARKINGS


- ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- 75x6x6mm GOUGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
- BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- POLE TO BE MARKED AS PER INSET.
- IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.
- THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:
 - LENGTH AND DIAMETER OF POLE
 - POLE NUMBER IN ACCORDANCE WITH SCHEDULE.

NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.



X in m	Y in mm
10	3000
10.5	3300
11	3500
11.5	3800
12	4000
13	4500
14	4900
15	5400
16	5900
17	6400

TYPE B ONLY

TYPICAL MARKINGS FOR WOOD POLES



II
275
LENGTH OF POLE IN METRES
 DIAMETER OF POLE IN MILLIMETRES AT 1500mm FROM THE BUTT.
 IF
SPECIES CODE
 87
YEAR OF IMPREGNATION
 0
NAME OR MARK OF CREOSOTING FIRM.

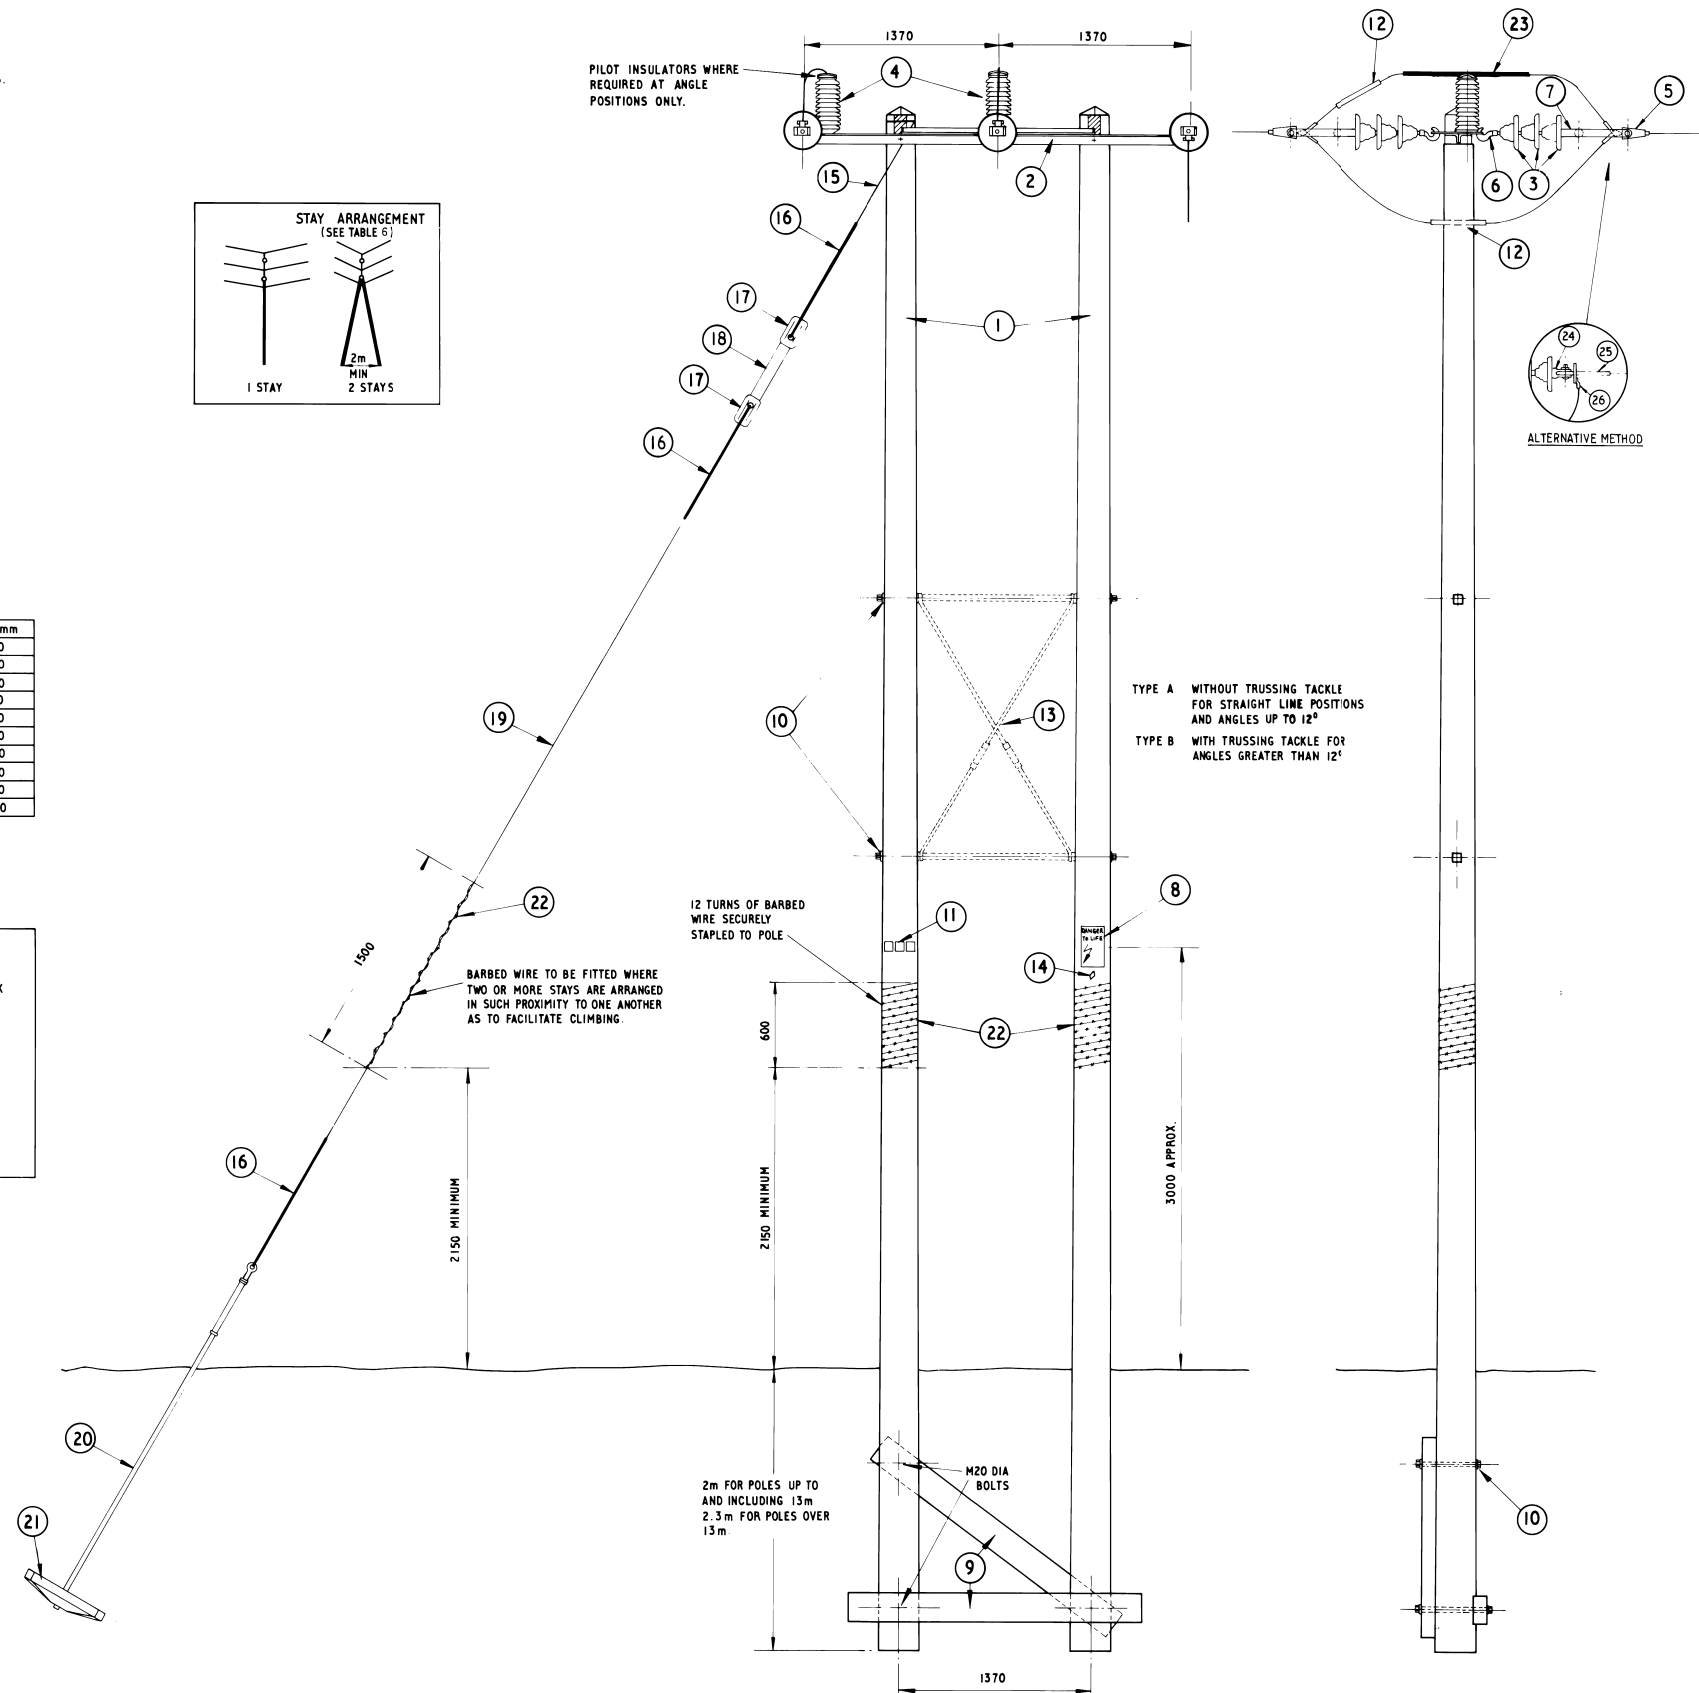

A	10-9-87	ORIGINAL	DL
Issue	Date	Revision	C.A.F. Drn. App.

eastern electricity

ENGINEERING DIVISION

33kV HEAVY CONSTRUCTION
 ANGLE/SECTION POLE

SCALE 1:20
 DRAWING NO.

41B 1272

ISSUE
A