


DESIGN NOTES:

THIS ARRANGEMENT IS SUITABLE ONLY WHEN THERE IS NO LINE DEVIATION. FOR LINE DEVIATIONS THE JUMPER CONNECTIONS ON TWO PHASES MUST BE TAKEN ABOVE THE CROSSARM AND SUPPORTED ON LINE POST INSULATORS TO MAINTAIN ADEQUATE CLEARANCES (SIMILAR TO ANGLE/SECTION POLE DRG. No. 4/81272).



EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG. No.
1	POLE	TO SPECIFICATION
2	CROSSARM	S.18634 B
3	10" (254mm) DISC INSULATOR	S.19042 S
4	CONDUCTOR WEDGE CLAMP	20180 R
5	BALL ENDED HOOK	S.19003 V
6	SOCKET TONGUE	S.18040 X
7	DANGER NOTICE	S.19214 V
8	BRACE BLOCK, 2100 x 200 x 100 mm	S.18059 J
9	CURVED WASHER FOR M20 DIA. BOLTS	S.19910 R
10	PHASE IDENTIFICATION PLATES	S.19231-33
11	NON-TENSION COMPRESSION JOINT	21031 K
12	NUMBER/LETTER PLATE	S.19241-49 S.19272-97
13	POLE TOP MAKE OFF	S.19426 E
14	GUY GRIP DEAD END	S.19427 N
15	STAY INSULATOR	S.19162 M
16	INSULATOR LINK	19400 M
17	STAY WIRE	S.19984 E
18	22mm DIA. ADJUSTABLE STAY ROD	S.19391 K
19	STAY BLOCK	S.18065 G
20	BARBED WIRE	S.19977 X
21	SOCKET CLEVIS	S.18022 A
22	COMPRESSION DEADEND	20930 N
23	ALUMINIUM LUG	21126 A
—	LINE POST INSULATORS - 33kV (SEE NOTE ABOVE)	S.19113 H
—	DOUBLE DISTRIBUTION TIE (SEE NOTE ABOVE)	19624 V


POLE TO BE SCARFED FOR A DISTANCE OF 280mm FROM THE POLE TOP TO GIVE A WIDTH OF 190mm BETWEEN FACES.

DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II. 75x6x6mm GOUGE MARK 1000mm UP FROM BUTT ON INSIDE OF LEGS.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET.
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- VI. LEGS OF 'H' POLE TO BE CAREFULLY MATCHED.
- VII. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:
 - (a) LENGTH AND DIAMETER OF POLE
 - (b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE


NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

TYPICAL MARKINGS FOR WOOD POLES



- 11 LENGTH OF POLE IN METRES
- 275 DIAMETER OF POLE IN MILLIMETRES AT 1500mm FROM THE BUTT
- IF SPECIES CODE
- 87 YEAR OF IMPREGNATION
- 0 NAME OR MARK OF CREOSOTING FIRM

OVERALL LENGTH AND DIAMETER AS SPECIFIED

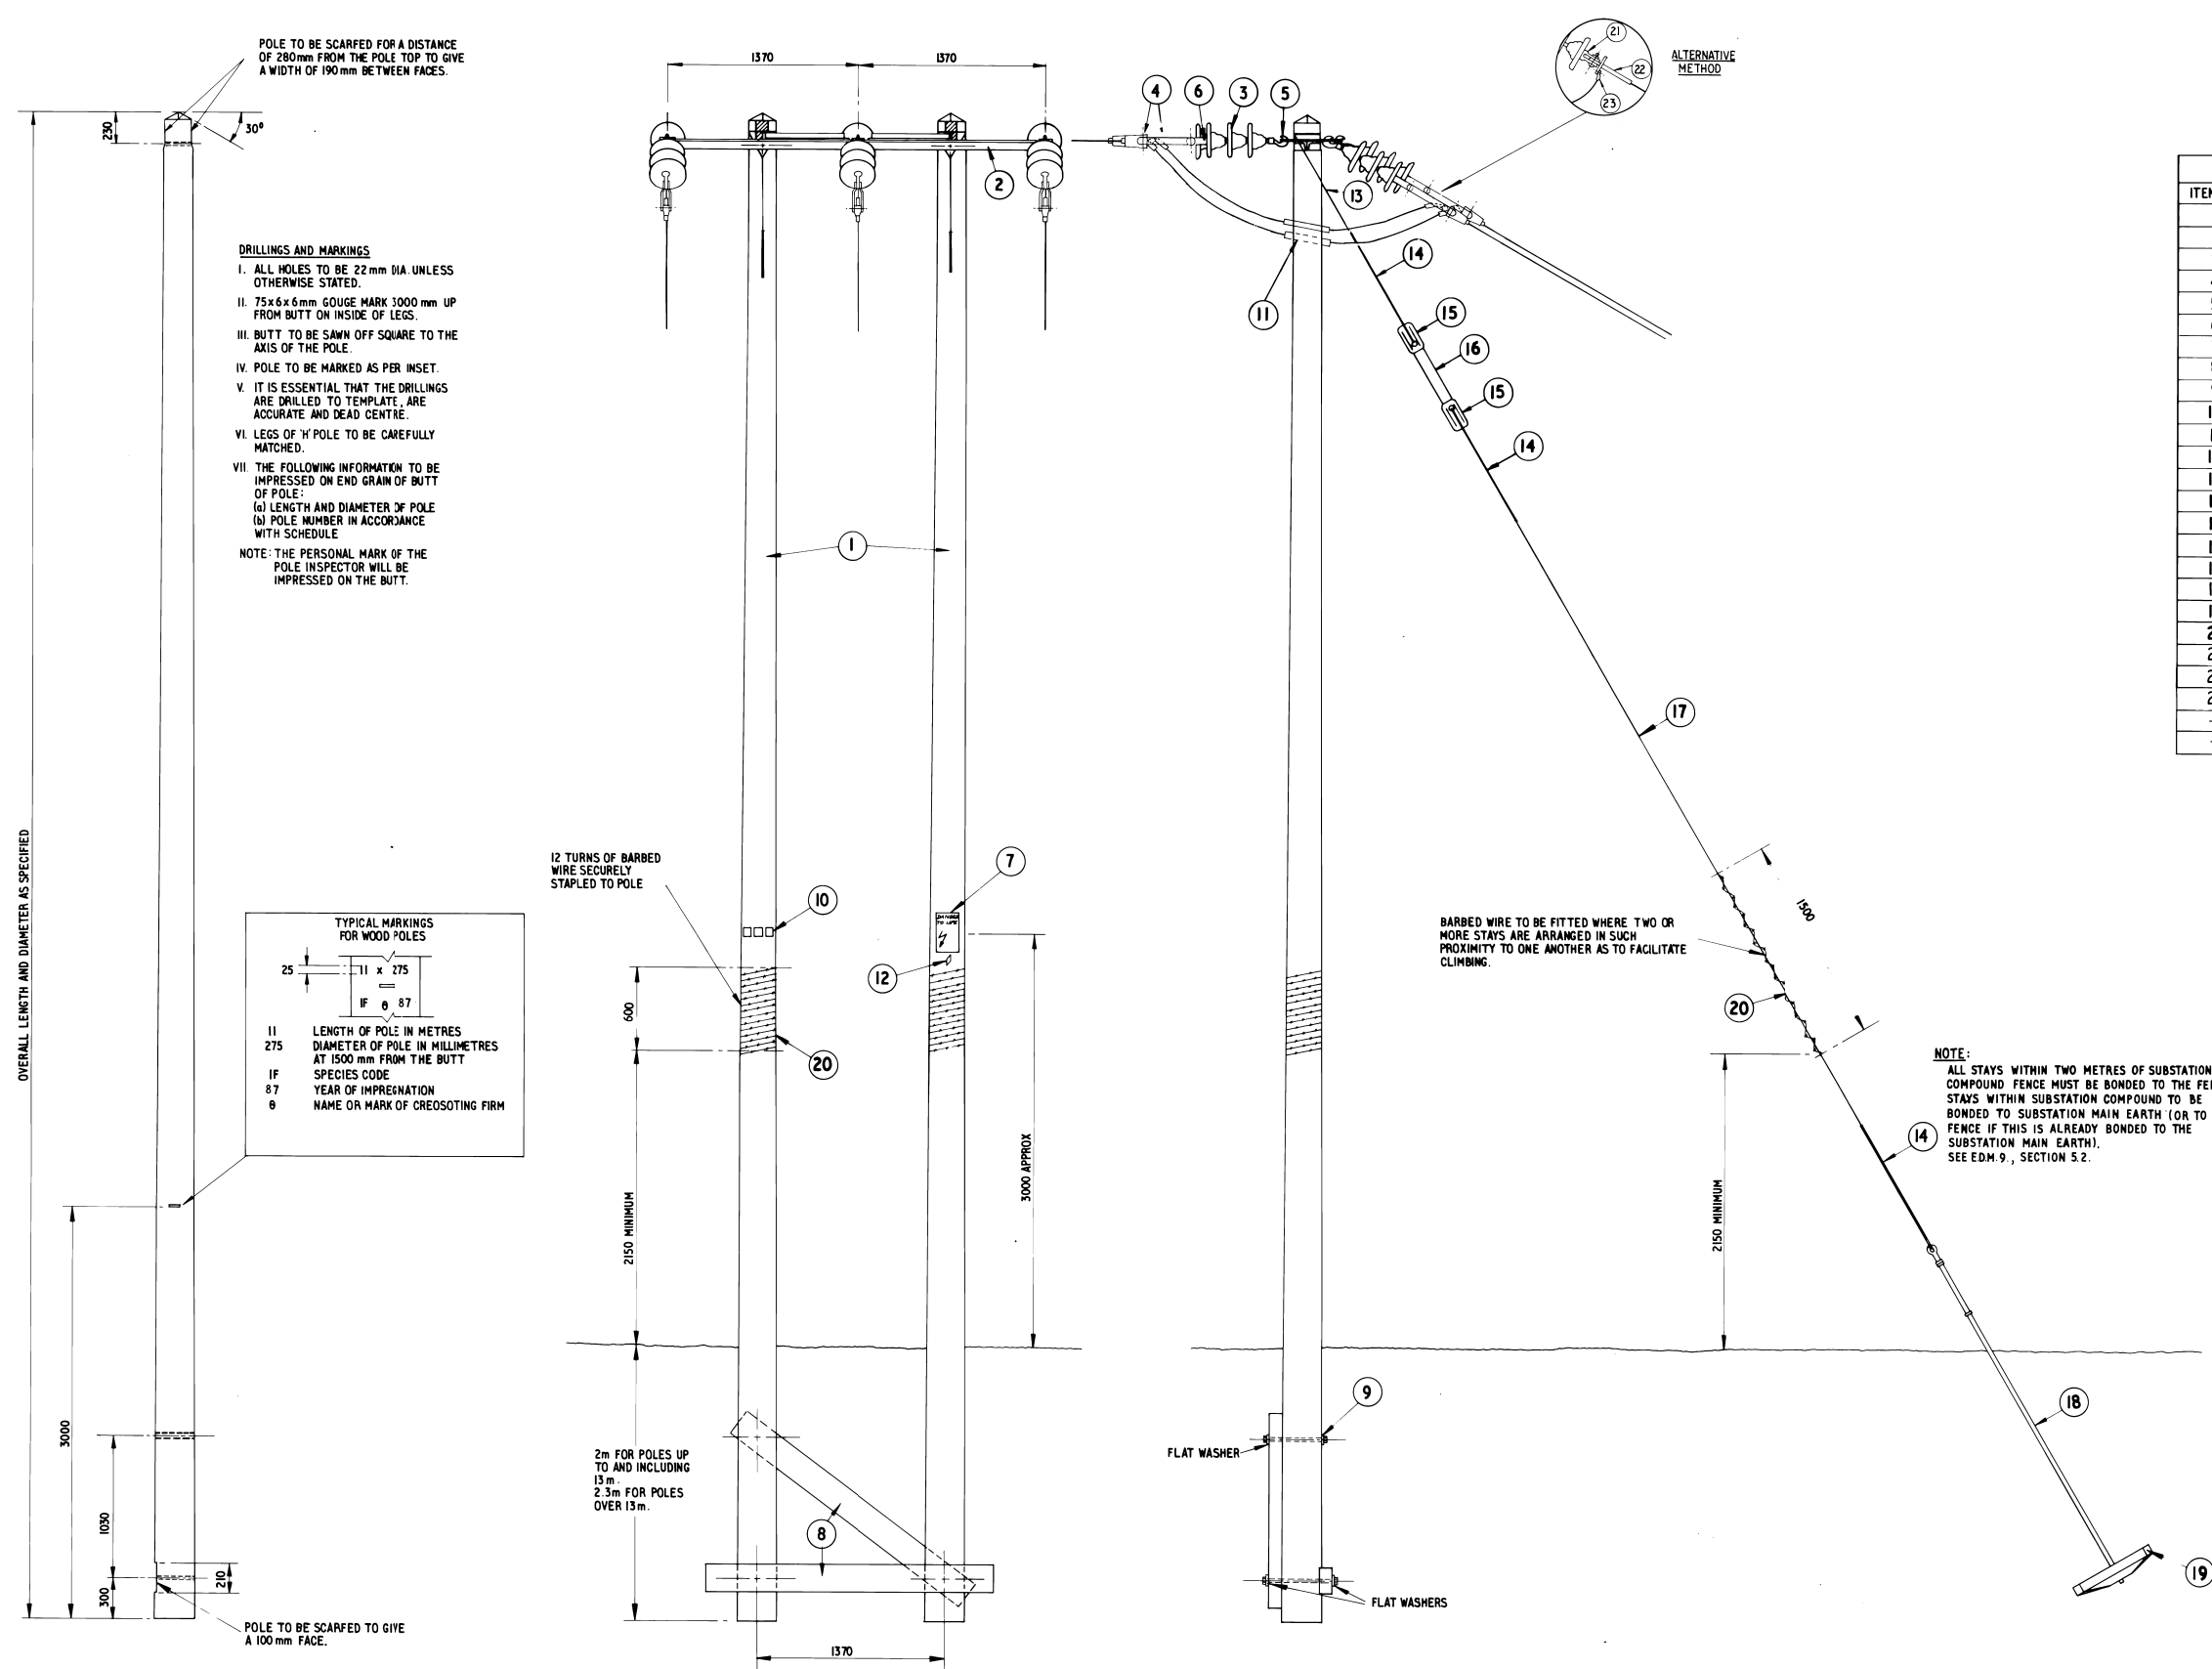

NOTE:

ALL STAYS WITHIN TWO METRES OF SUBSTATION COMPOUND FENCE MUST BE BONDED TO THE FENCE. STAYS WITHIN SUBSTATION COMPOUND TO BE BONDED TO SUBSTATION MAIN EARTH (OR TO THE FENCE IF THIS IS ALREADY BONDED TO THE SUBSTATION MAIN EARTH). SEE EDM 9, SECTION 5.2.

A	10/9/87	ORIGINAL	101
Issue	Date	Revision	C.A.F. Drf. App.

eastern electricity 

ENGINEERING DIVISION

33kV HEAVY CONSTRUCTION
TERMINAL POLE WITH
OVERHEAD CONNECTION

SCALE 1:20

DRAWING NO.

4 B 1275

15/1/87

A