


4

DESIGN NOTES:-
FOR 200sqmm (18/17/2 BA) A.C.S.R. FOR SPANS OF
BARE CONDUCTOR UP TO 170m AND SPANS OF
P.V.C. COVERED CONDUCTORS UP TO 150m.
FOR ANGLES OF DEVIATION NOT EXCEEDING 90°



EQUIPMENT SCHEDULE		
ITEM No.	DESCRIPTION	QTY. No.
1	POLE	TO SPECIFICATION
2	CROSSARM 100 x 75 x 10mm ANGLE	5.18641.1
3	CENTRE PHASE STRAP	5.19678.1
4	10" (254mm) DISC INSULATOR	5.19047.5
5	LINE POST INSULATOR - 33KV	5.19114.1
6	DEAD END CLAMP FOR 200sqmm A.C.S.R.	5.27250.1
7	BALL END OF HOOK	5.19003.1
8	SOCKET TONGUE	5.18040.1
9	DANGER NOTICE	5.19214.1
10	BRACE BLOCK, 3300 x 250 x 125mm	5.19056.1
11	CURVED WASHER FOR M20 DIA. BOLTS	5.19110.1
12	PHASE IDENTIFICATION PLATES	5.19251-33
13	NON-TENSION COMPRESSION JOINT	2101.1
14	TRUSSING TACKLE	5.18154.1
15	NUMBER/LETTER PLATE	5.19266-05 5.19272-07
16	STRAIGHT LINE STIRUP	5.19590.1
17	POLE TOP MAKE G.F.	5.19474.1
18	GUY GRIP DEAD END	5.19427.1
19	STAY INSULATOR	5.19158.1
20	STAY WIRE	5.19984.1
21	22mm DIA. ADJUSTABLE STAY ROD	5.19391.1
22	STAY BLOCK	5.18065.1

POLE TO BE SCARFED FOR A DISTANCE
OF 280mm FROM THE POLE TOP TO GIVE
A WIDTH OF 250mm BETWEEN FACES


DRILLINGS AND MARKINGS

- I ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II 75 x 6mm GOUGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
- III BUTT TO BE SAWN-OFF SQUARE TO THE AXIS OF THE POLE.
- IV POLE TO BE MARKED AS PER INSET.
- V IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- VI LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.
- VII THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:
(a) LENGTH AND DIAMETER OF POLE.
(b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.

NOTE: THE PERSONAL MARK OF THE
POLE INSPECTOR WILL BE
IMPRESSED ON THE BUTT.


X' IN m	Y' IN mm
10	2200
10.5	2700
11	3100
11.5	3350
12	3600
13	4100
14	4450
15	4950
16	5450
17	5950

22mm DIA. HOLES
FOR TRUSSING
TACKLE



POLE TO BE SCARFED TO GIVE
A 100mm FACE.

1550mm FOR POLES UP TO
AND INCLUDING 13m.
1850mm FOR POLES OVER
13m

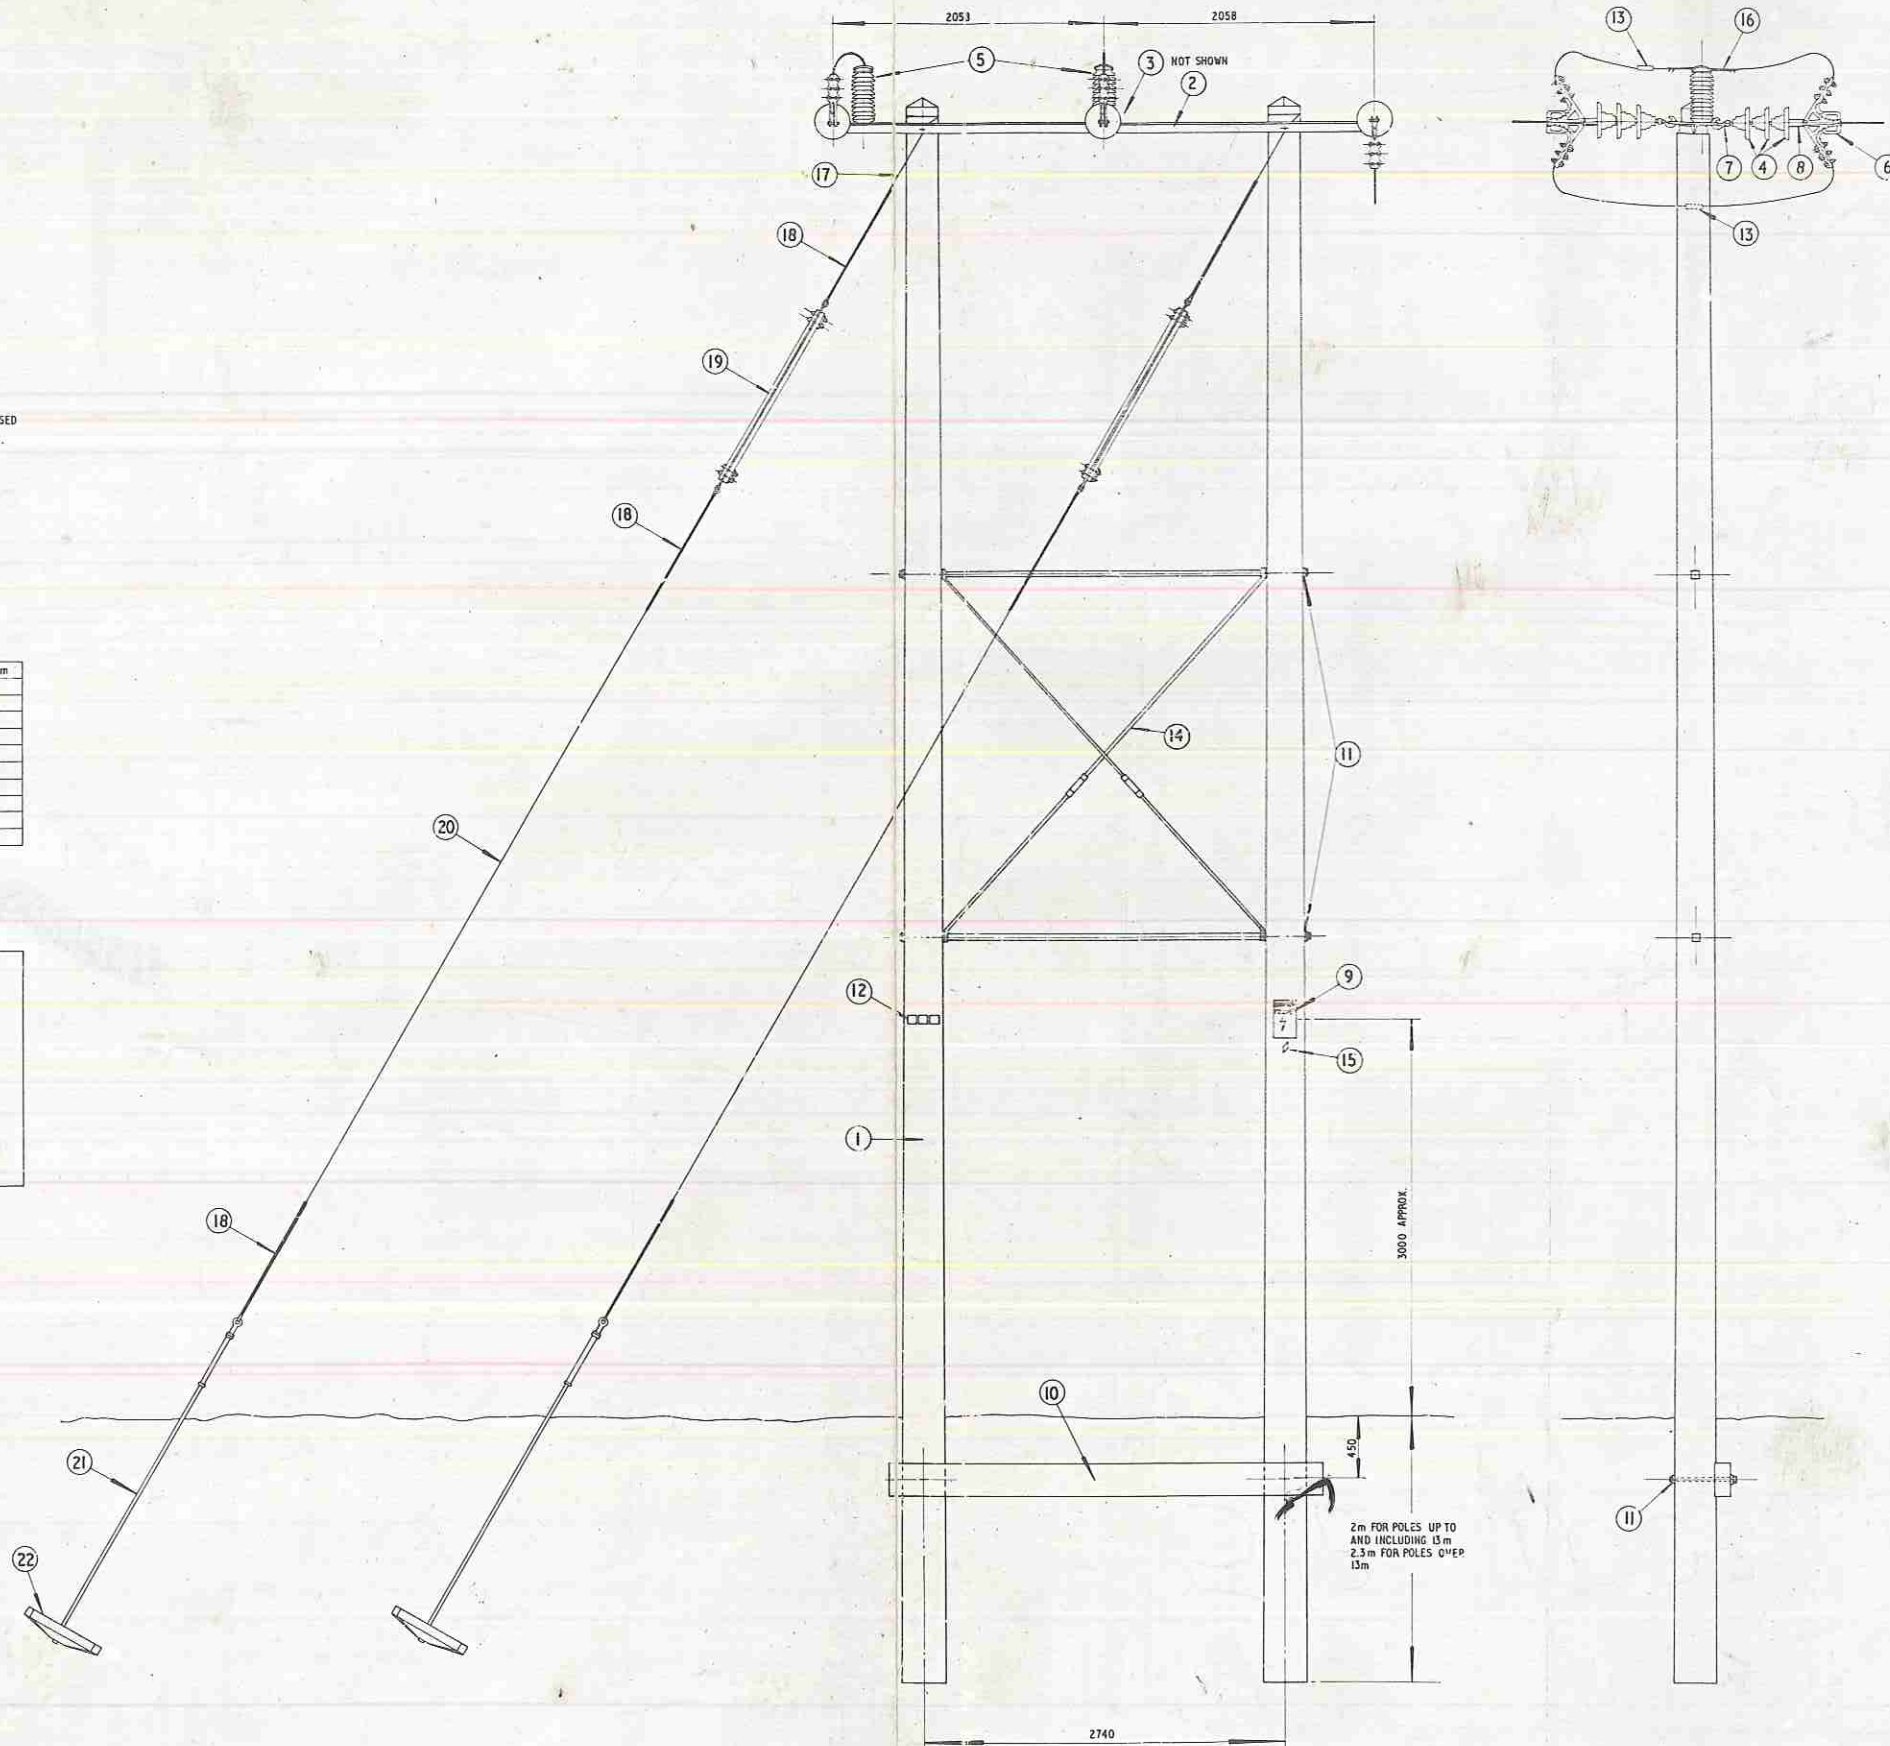

A	13-12-77	ORIGINAL	1/1
REV.	DATE	REASON	BY

eastern electricity

CHIEF ENGINEER'S DEPARTMENT

33KV SINGLE CIRCUIT
HEAVY ANGLE POLE

SCALE 1:20

DRAWING NO. 5/B1003