



NOTES -
THIS ARRANGEMENT TO BE USED AT STRAIGHT LINE POSITIONS ONLY.
WHERE THE ANGLE θ BETWEEN THE MAIN LINE AND THE TEE-OFF IS LESS THAN 75° THE TEE-OFF CROSSARM IS TO BE MOUNTED AS SHOWN IN SKETCH 'A' BELOW.
WHERE THE ANGLE θ OF TEE-OFF IS GREATER THAN 75° THE TEE-OFF CROSSARM IS TO BE MOUNTED AS SHOWN IN SKETCH 'B' BELOW.



EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG No.
1	POLE	TO SPECIFICATION
2	TEE-OFF CROSSARM	S.18750L
3	10" (254mm) DISC INSULATOR	S.19042.5
4	LINE POST INSULATOR - 33KV	S.19114R
5	DEAD END CLAMP FOR 200 sq. mm A.C.S.R.	S.20207 V
6	BALL ENDED HOOK	S.19025 V
7	SOCKET TONGUE	S.18040 X
8	CROSSARM STRAP	S.19681Q
9	TRUSSING TACKLE	S.18148 W
10	WARNING NOTICE	S.19197D
11	DANGER NOTICE	S.19214 V
12	NUMBER / LETTER PLATE	S.19250-69 S.19272-97
13	KICKING BLOCK 1200x200x100mm	S.18060 N
14	CURVED WASHER FOR M20 DIA. BOLTS	S.19910R
15	POLE TOP MAKE OFF	S.19422 E
16	GUY GRIP DEAD END	S.19422 N
17	STAY INSULATOR	S.19158 G
18	STAY WIRE	S.19984 E
19	22 mm DIA. ADJUSTABLE STAY ROD	S.19391 K
20	STAY BLOCK	S.18065 G
21	BARBED WIRE	S.19777 X
22	RECOVERED 0.1in ² (7.136) H.D. BARE COPPER	05299 Q
23	70mm ² (19/2 14) S.D. BARE ANNEALED COPPER	05300 X
24	STRAIGHT LINE STIRRUP	S.19590 K
25	COMPRESSION CONNECTOR	21215 N
26	INSULATOR STOOL	S.18160 S

A 14-12-77 ORIGINAL
Date: 14-12-77
By: [Signature]
C.A.T. [Signature]

eastern electricity


CHIEF ENGINEER'S DEPARTMENT

33KV SINGLE CIRCUIT
TEE-OFF FROM
H' POLE

SCALE 1:20

DRAWING NO. 5/1005

A

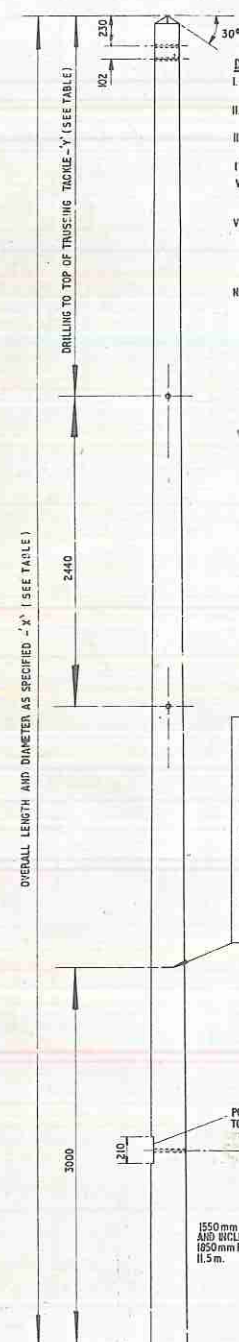


DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II. 75 x 6 x 6mm GOUGE MARK 3000mm IF FROM BUTT.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET.
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
- VI. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:
 - a) LENGTH AND DIAMETER OF POLE
 - b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.


NOTE: THE PERSONAL MARK OF THE POLE INSPECTOR WILL BE IMPRESSED ON THE BUTT.

X' IN m	Y' IN mm
9.5	2000
10	2500
10.5	3000
11	3250
11.5	3500
12	3600
13	4100
14	4600
15	5100
16	5600



POLE TO BE SCARFED TO GIVE A 100mm FACE

150mm FOR POLES UP TO AND INCLUDING 11.5m
185mm FOR POLES OVER 11.5m

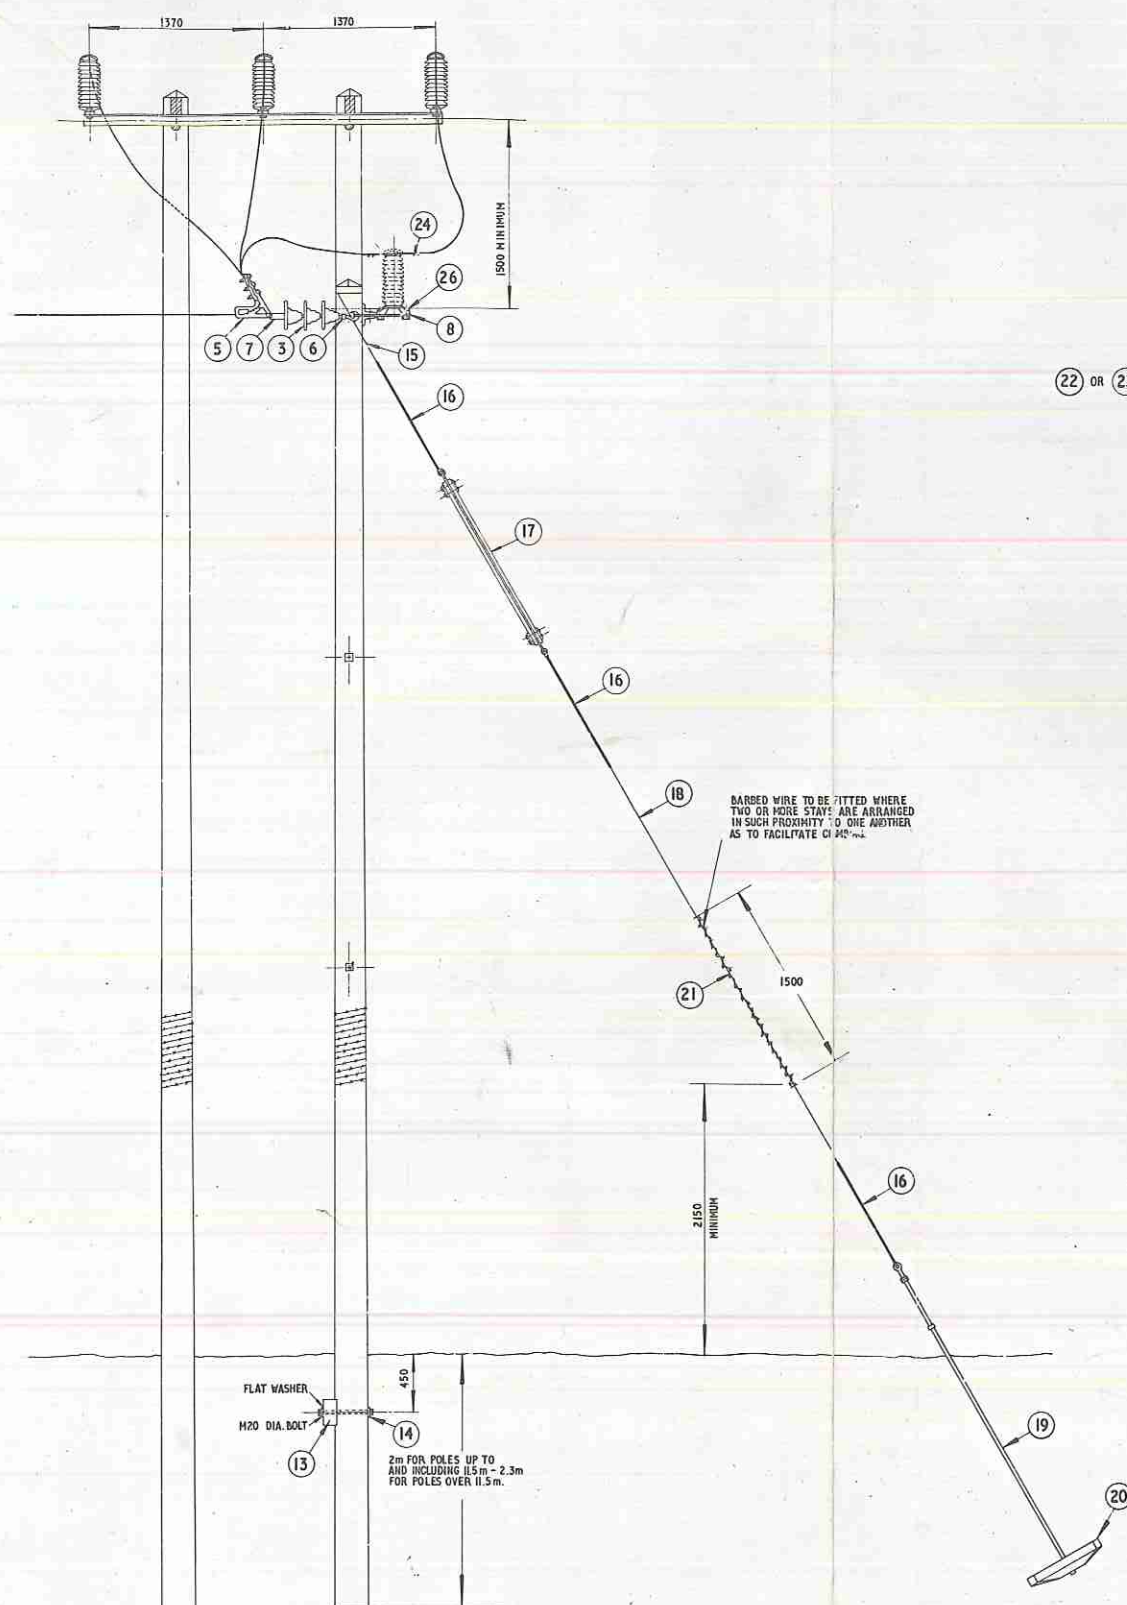


BARBED WIRE TO BE FITTED WHERE TWO OR MORE STAYS ARE ARRANGED IN SUCH PROXIMITY TO ONE ANOTHER AS TO FACILITATE CLIPPING

2150 MINIMUM

FLAT WASHER
M20 DIA. BOLT

450

2m FOR POLES UP TO AND INCLUDING 11.5m - 2.3m FOR POLES OVER 11.5m

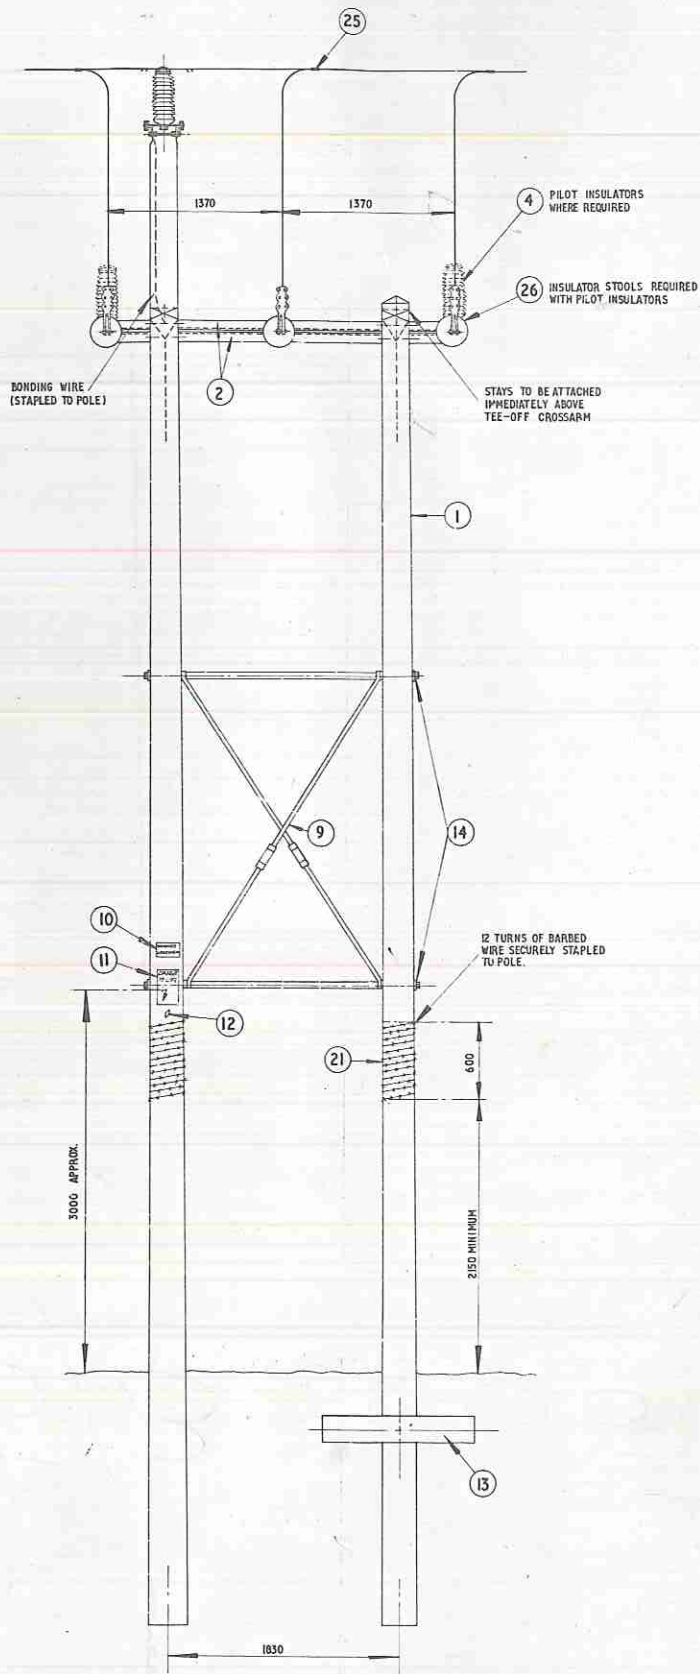

(22) OR (23) BONDING WIRE (STAPLED TO POLE)

PILOT INSULATORS WHERE REQUIRED

INSULATOR STOOLS REQUIRED WITH PILOT INSULATORS

STAYS TO BE ATTACHED IMMEDIATELY ABOVE TEE-OFF CROSSARM

12 TURNS OF BARBED WIRE SECURELY STAPLED TO POLE