



APPLICATION
FOR 100sqmm (6/4.72 + 7/157) A.C.S.R.
MAXIMUM SPAN 5 165m BARE, 145m
P.V.C. COVERED.
10kV INSULATOR PINS TO BE USED.
TO BE USED FOR STRAIGHT LINE POSITIONS
AND ANGLES OF DEVIATION UP TO 6°.





DRILLINGS

POLES TO BE SCARFED FOR A
DISTANCE OF 230mm FROM POLE
TOP TO GIVE A 50mm FACE

FOR POLES OF 14m
AND OVER.

X	Y
14m	4.8m
15m	5.1m
16m	5.6m
17m	6.1m
18m	6.6m

- DRILLINGS AND MARKINGS**
- ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
 - 75 x 6 x 6mm GOUGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
 - BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
 - POLE TO BE MARKED AS PER INSET.
 - IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE.
 - LEGS OF H POLE TO BE CAREFULLY MATCHED.
 - THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE:-
(a) LENGTH AND DIAMETER OF POLE.
(b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.
- NOTE:-
THE PERSONAL MARK OF THE POLE INSPECTOR
WILL BE IMPRESSED ON THE BUTT.

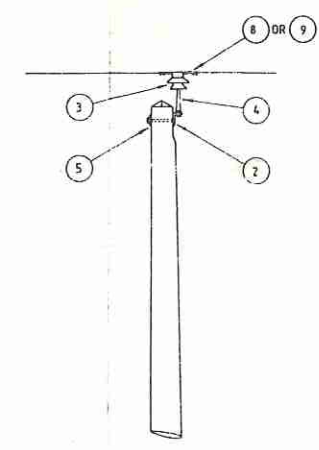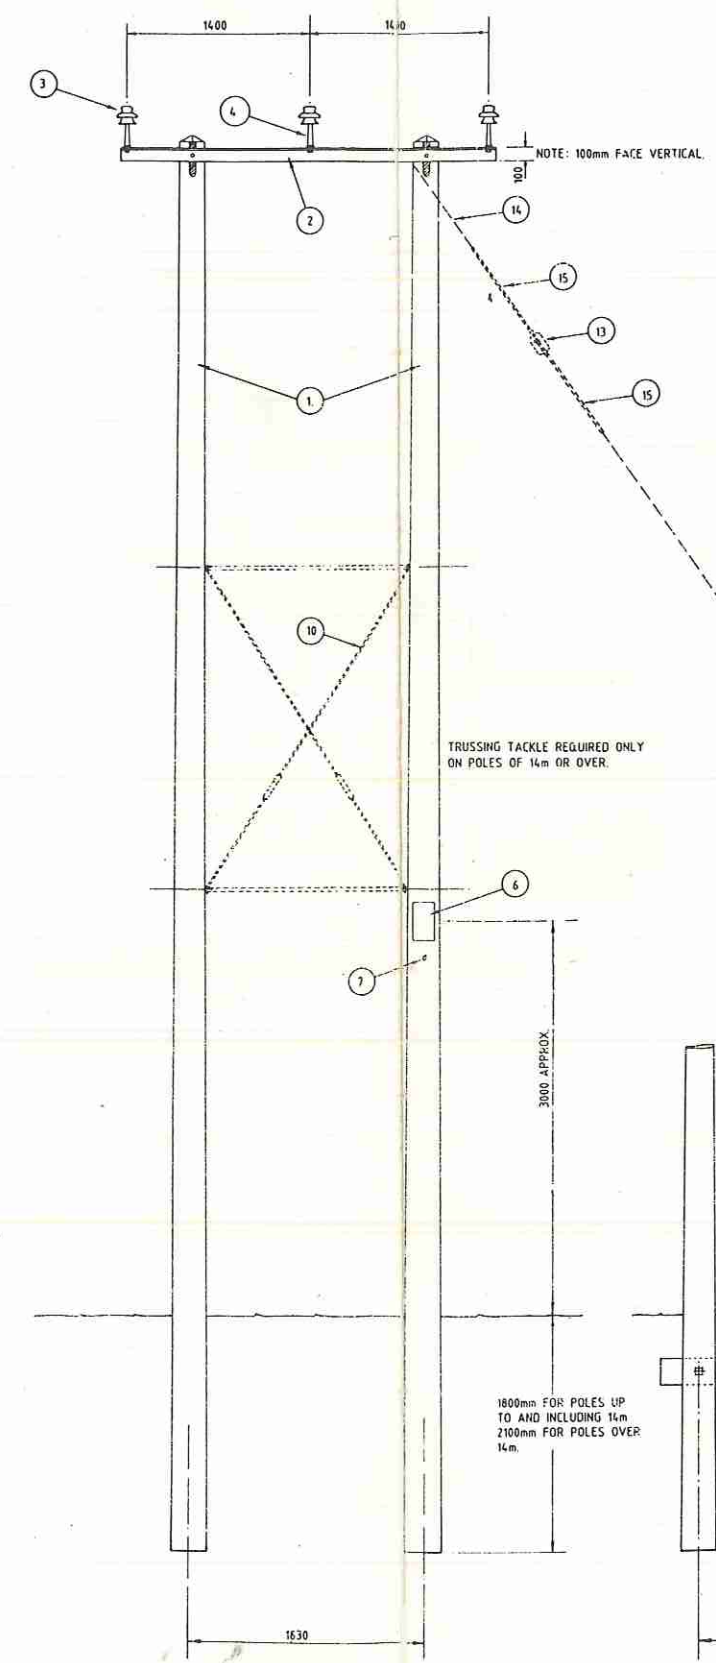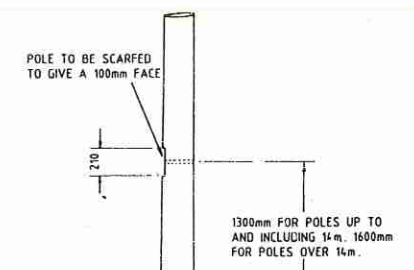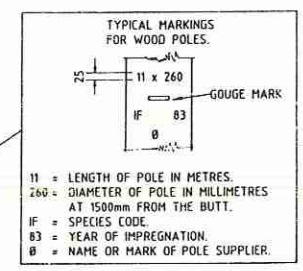

EQUIPMENT SCHEDULE.		
ITEM No.	DESCRIPTION	DRG. No.
1.	POLE.	
2.	CROSSARM 100 x 75 x 10mm M.S. ANGLE	S18751U
3.	11kV PIN TYPE INSULATOR	S19075R
4.	INSULATOR PIN - 10kV	S19441B
5.	CURVED WASHER FOR M20 BOLT	S19910R
6.	DANGER NOTICE.	S19214V
7.	NUMBER/LETTER PLATE.	S19260-69 S19272-97
8.	STIRRUP BINDING (STRAIGHT LINE POLES)	S19585V
9.	STIRRUP BINDING (ANGLE POLES)	S19586E
10.	TRUSSING TACKLE	S18148W
11.	DRACE BLOCK 2400 x 200 x 100mm	S18057R
12.	STAYWIRE	S19985W
13.	STAY INSULATOR	S19163V
14.	POLE TOP MAKE OFF	S19402E
15.	GUY GRIP DEAD END	S19401V
16.	NON-ADJUSTABLE STAY ROD	S19398V
17.	STAY BLOCK	S18069R

FOR SCHEDULE OF NUTS AND BOLTS REQUIRED REFER TO OHL MANUAL SECTION 7/B

TYPE A

TYPE B

TYPE A

TYPE B
(FOR ABNORMAL
SITE CONDITIONS)

was 4/A11

A	112.83	REVISED DESIGN WITH METRIC DIMENSIONS	HLL
ISSUE	DATE	REVISION	C.A.P. DRG. APP.
eastern electricity			
ENGINEERING DIVISION			
11kV HEAVY CONSTRUCTION H THROUGH POLE.			
SCALE 1 : 20			
DRAWING NUMBER 5/B1185			
A			