

DESIGN NOTES :
FOR 200sq.mm. (18/1/3.86) A.C.S.R.
FOR SPANS OF BARE CONDUCTOR UP TO 170 m
AND SPANS OF P.V.C. COVERED CONDUCTORS UP TO
150 m.
FOR ANGLES OF DEVIATION NOT EXCEEDING 60°

EQUIPMENT SCHEDULE

ITEM No.	DESCRIPTION	DRG. No.
1	POLE	TO SPECIFICATION
2	CROSSARM	S.18634 B
3	10" (254mm) DISC INSULATOR	S.19042 S
4	LINE POST INSULATOR-33kV	S.19114 R
5	CONDUCTOR TERMINATING CLAMP	S.20202 C
6	BALL ENDED HOOK	S.19003 V
7	SOCKET TONGUE	S.18040 X
8	DANGER NOTICE	S.19214 V
9	BRACE BLOCK 2100 x 200 x 100 mm.	S.18059 J
10	CURVED WASHER FOR M20 DIA. BOLT	S.19910 R
11	PHASE IDENTIFICATION PLATES	S.19231-33
12	NON-TENSION COMPRESSION JOINT	21101 R
13	TRUSSING TACKLE (TYPE 'B' ONLY)	S.18145 V
14	NUMBER / LETTER PLATE	S.19260-69 S.19272-97
15	POLE TOP MAKE OFF	S.19426 E
16	GUY GRIP DEAD END	S.19427 N
17	STAY INSULATOR	S.19162 M
18	INSULATOR LINK	19400 M
19	STAY WIRE	S.19984 E
20	22mm DIA. ADJUSTABLE STAY ROD	S.19391 K
21	STAY BLOCK	S.18065 G
22	BARBED WIRE	S.19977 X
23	STRAIGHT LINE STIRRUP	S.19590 K

B	29/03/1985	STAY INSURLATOR AND TERMINATING CLAMP CHANGED	HL JP
A	16/12/1977	ORIGINAL	MA
Version	Date	DESCRIPTION	Design Drawn

33kV SINGLE CIRCUIT
ANGLE / SECTION POLE

SCALE	1:20	@ B1	AS ERECTED	Checked		
				Approved		

DRAWING NO.	B1002	Version	B
SITE	Standard Drawings		




DRILLINGS AND MARKINGS

- I. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED.
- II. 75x6x6mm GUAGE MARK 3000mm UP FROM BUTT ON INSIDE OF LEGS.
- III. BUTT TO BE SAWN OFF SQUARE TO THE AXIS OF THE POLE.
- IV. POLE TO BE MARKED AS PER INSET
- V. IT IS ESSENTIAL THAT THE DRILLINGS ARE DRILLED TO TEMPLATE, ARE ACCURATE AND DEAD CENTRE
- VI. LEGS OF 'H' POLES TO BE CAREFULLY MATCHED.
- VII. THE FOLLOWING INFORMATION TO BE IMPRESSED ON END GRAIN OF BUTT OF POLE :
 - (a) LENGTH AND DIAMETER OF POLE
 - (b) POLE NUMBER IN ACCORDANCE WITH SCHEDULE.

NOTE: THE PERSONAL MARK OF THE POLE
INSPECTOR WILL BE IMPRESSED ON
THE BUTT.


X in m	Y in mm
10	3000
10.5	3300
11	3500
11.5	3800
12	4000
13	4500
14	4900
15	5400
16	5900
17	6400

TYPICAL MARKINGS FOR WOOD POLES

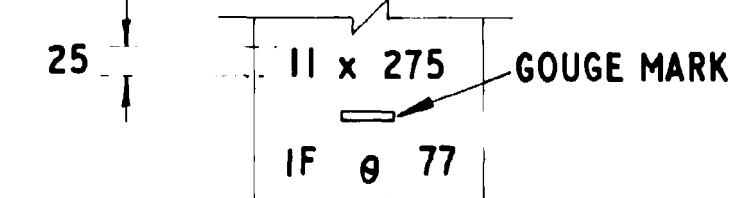


11	LENGTH OF POLE IN METRES
275	DIAMETER OF POLE IN MILLIMETRES AT 1500mm FROM THE BUTT.
1F	SPECIES CODE
77	YEAR OF IMPREGNATION
9	NAME OR MARK OF CREOSOTING FIRM.

POLE TO BE SCARFED
TO GIVE 100 mm FACE.

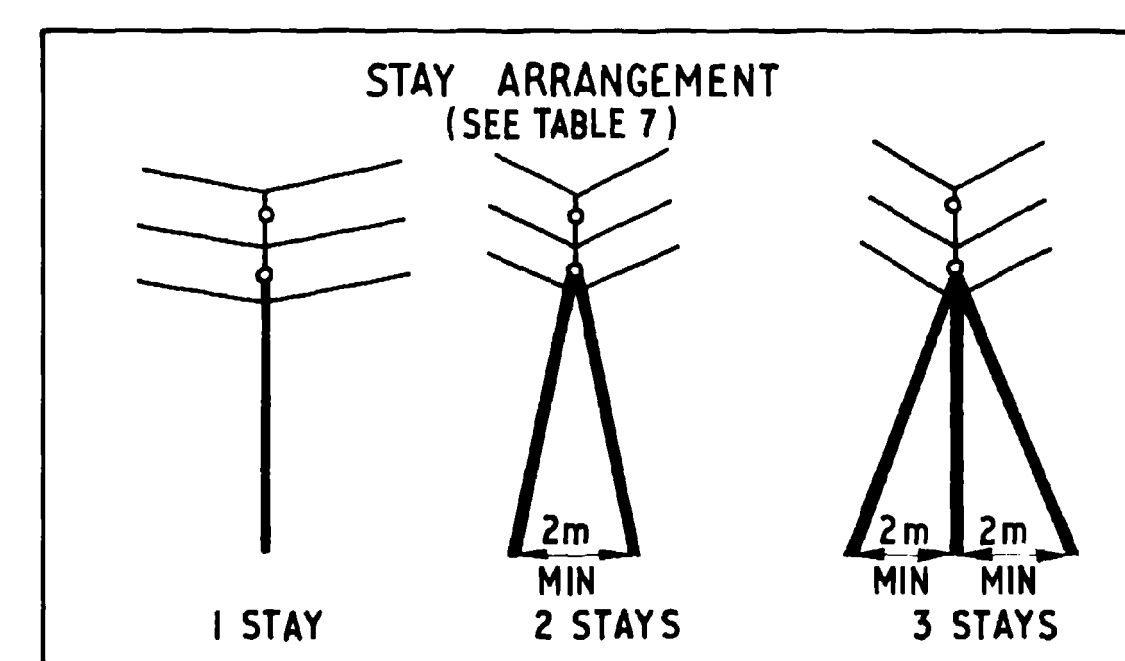

PILOT INSULATORS WHERE
REQUIRED AT ANGLE
POSITIONS ONLY.

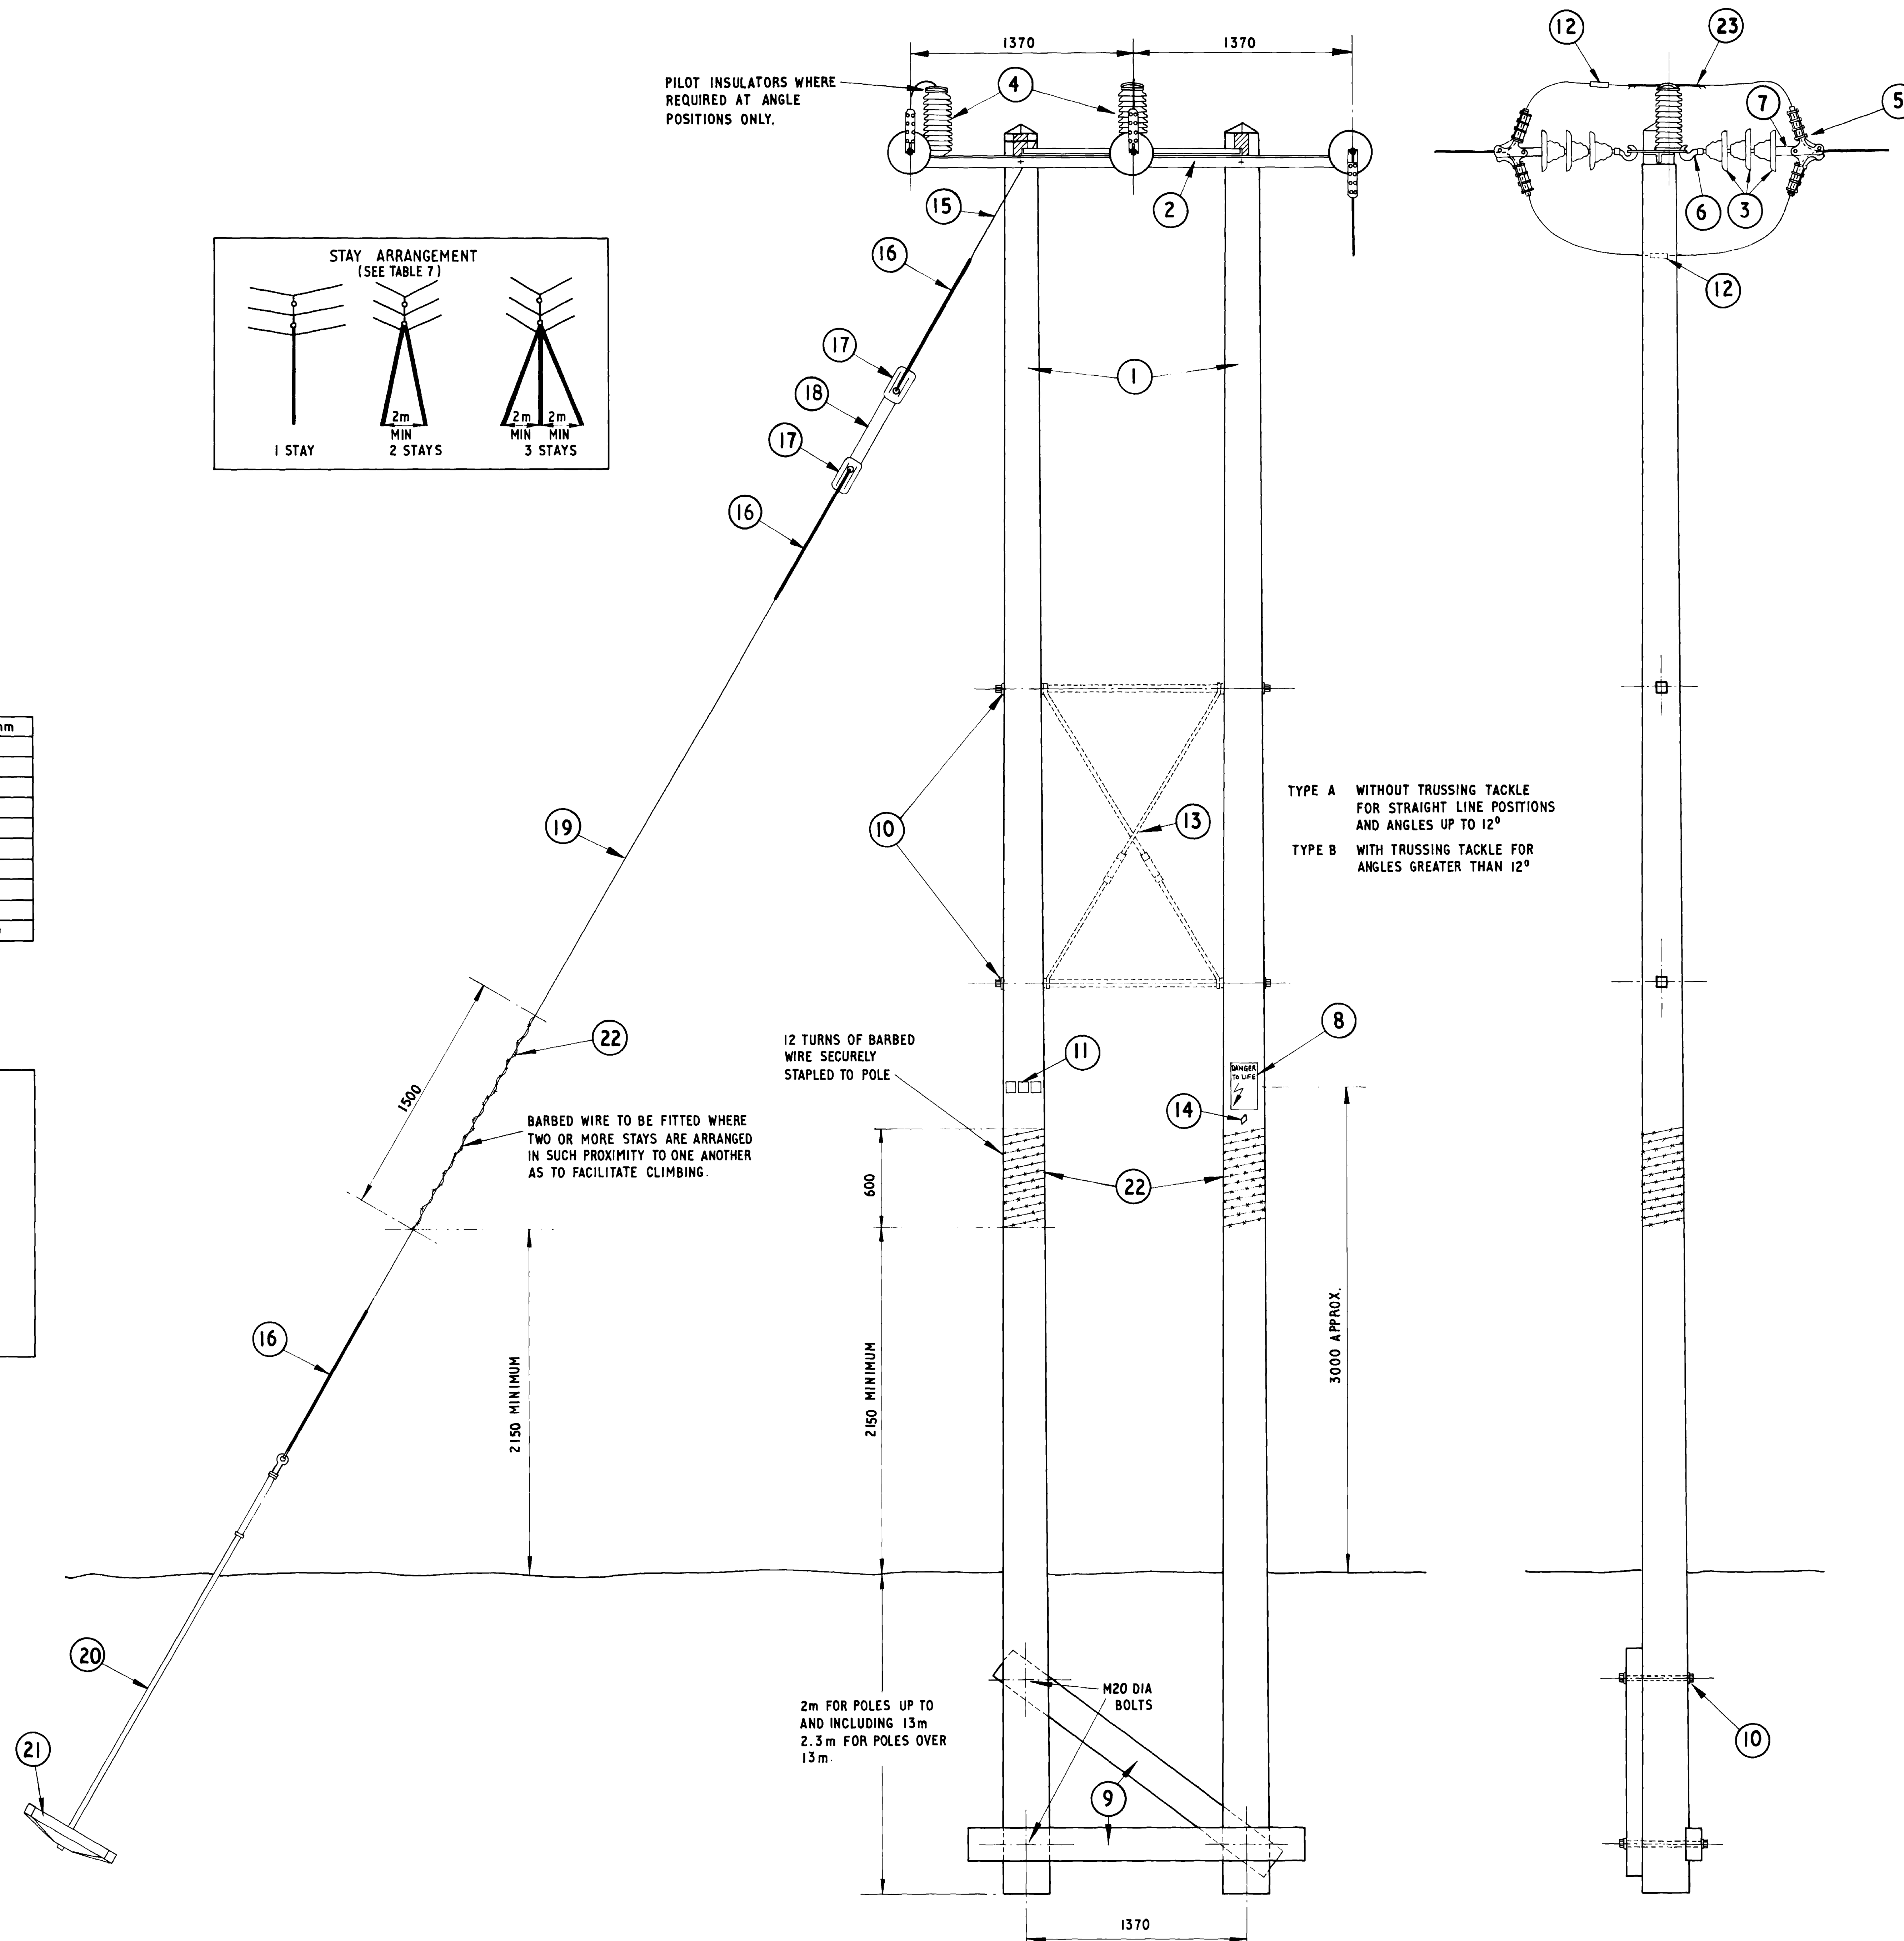

TYPE A WITHOUT TRUSSING TACKLE
FOR STRAIGHT LINE POSITIONS
AND ANGLES UP TO 12°

TYPE B WITH TRUSSING TACKLE FOR ANGLES GREATER THAN 12°

12 TURNS OF BARBED
WIRE SECURELY
STAPLED TO POLE

BARBED WIRE TO BE FITTED WHERE
TWO OR MORE STAYS ARE ARRANGED
IN SUCH PROXIMITY TO ONE ANOTHER
AS TO FACILITATE CLIMBING.

2m FOR POLES UP TO
AND INCLUDING 13m
2.3 m FOR POLES OVER
13m.