


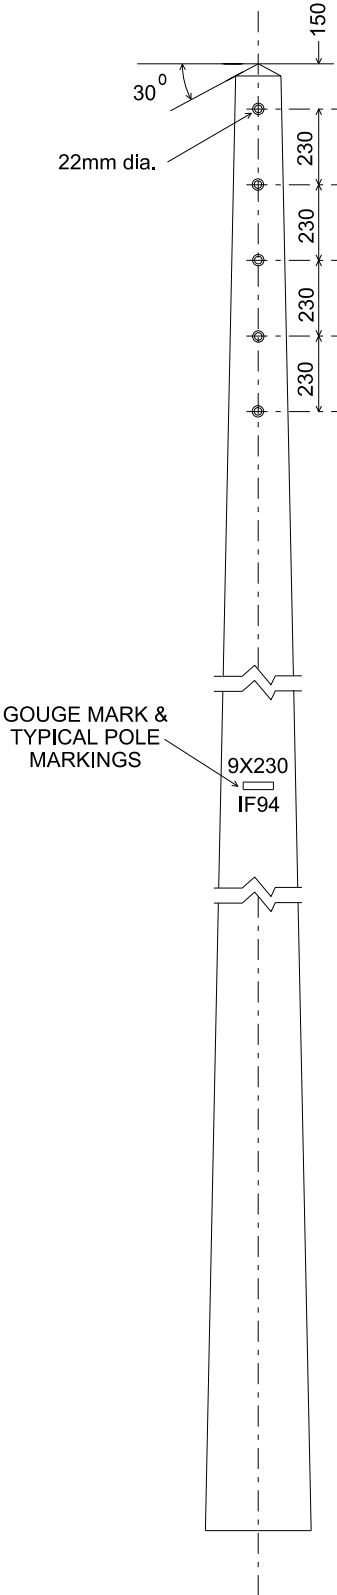


NOTES

- 1. ALL HOLES SHALL BE 18 mm DIA. WITH THE EXCEPTION OF THE TOP WHICH WILL BE 22 mm DIA.
- 2. HOLES SHALL BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.

All dimensions in millimetres

Intermediate Pole LV Lines & Services	© UK Power Networks 2014		
	DRN. June 1994	DRAWING NUMBER	ISSUE
	CKD. January 2014	EDS 01-9000.01	1
	APP.		

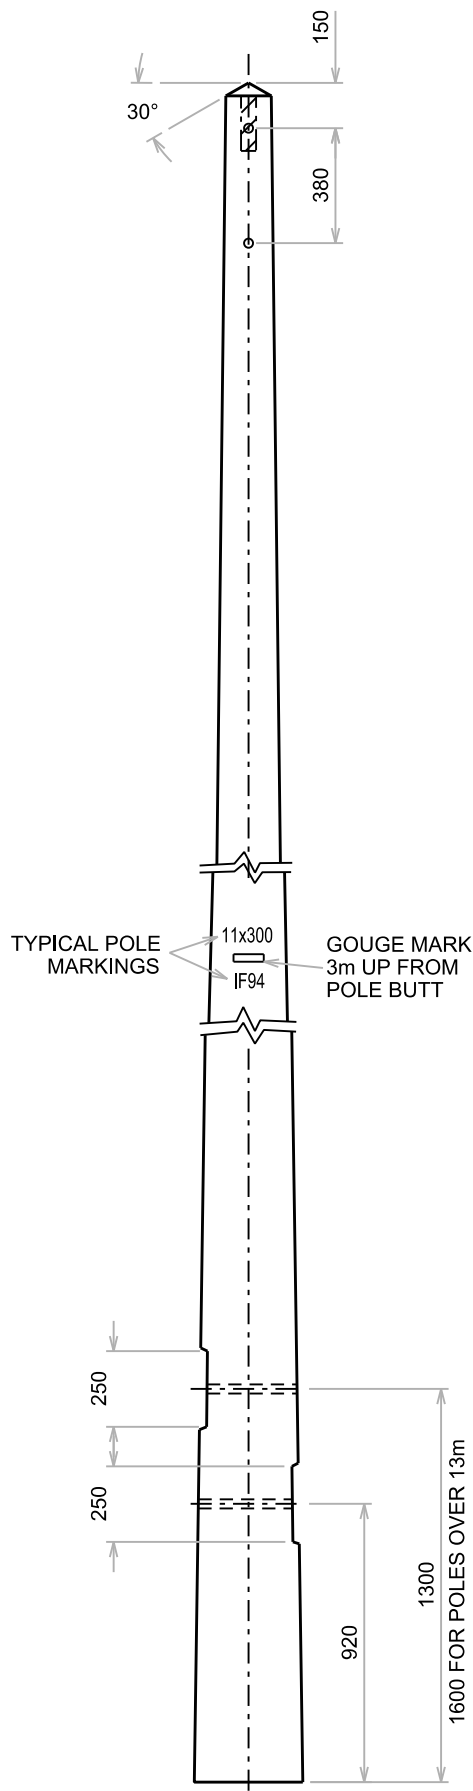

NOTES



1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. ALL SCARFING AND SLOTS, EXCEPT THOSE FOR KICKING BLOCKS, SHALL BE CUT SQUARE TO GIVE A 50mm WIDE FACE.

All dimensions in millimetres

Intermediate, Section, Tee-off or
Terminal Pole for 33kV/HV
Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD.	EDS 01-9000.06	1
APP.		

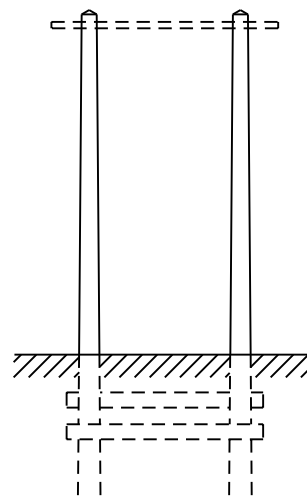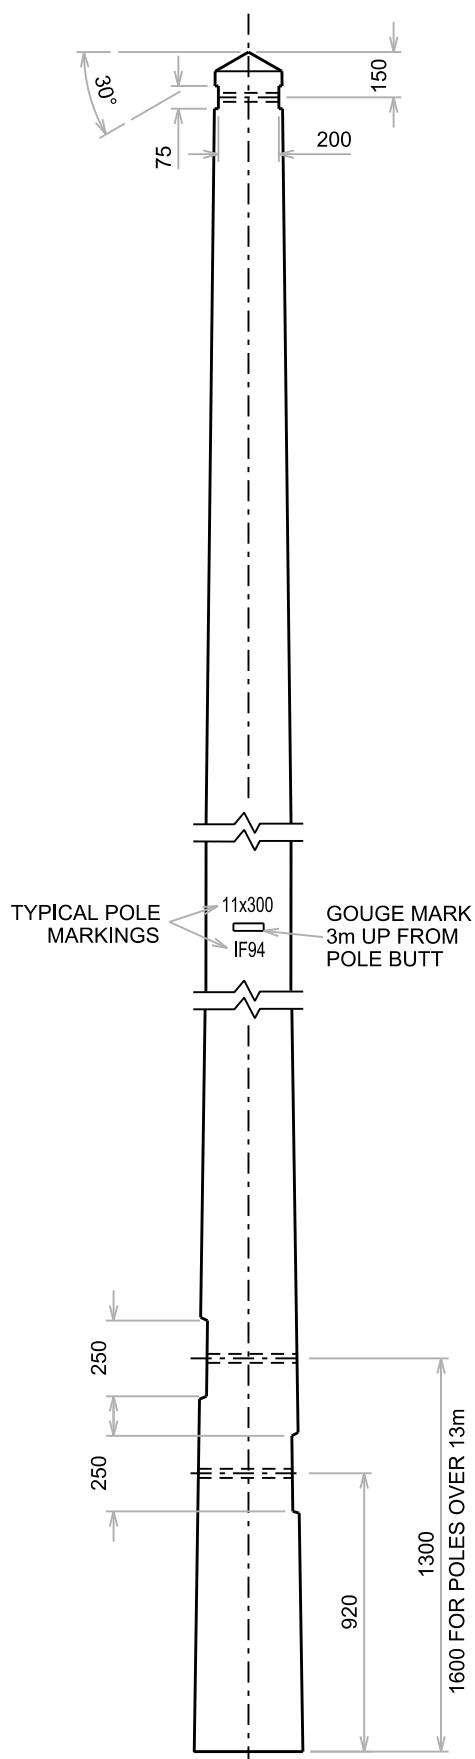

NOTES



1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

All dimensions in millimetres

Section H Pole, Max Deviation 60° 11/33kV Heavy Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD.	EDS 01-9000.09	1
APP.		

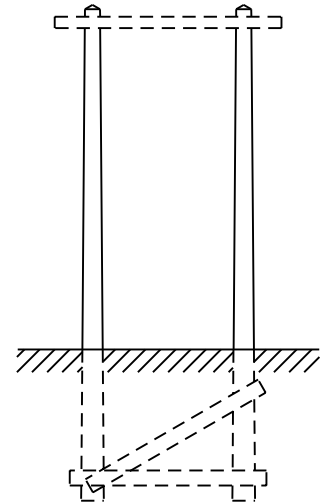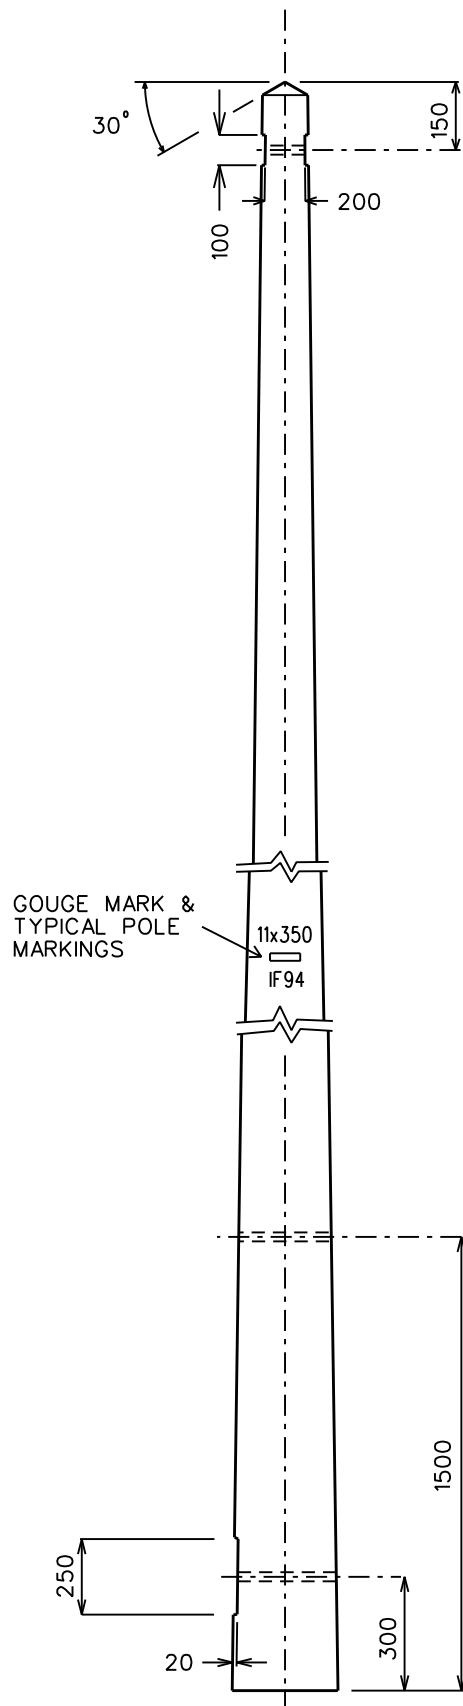**NOTES**


1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

All dimensions in millimetres

Section H Pole, Deviation Over 60° 11/33kV Heavy Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.10	1
APP.		

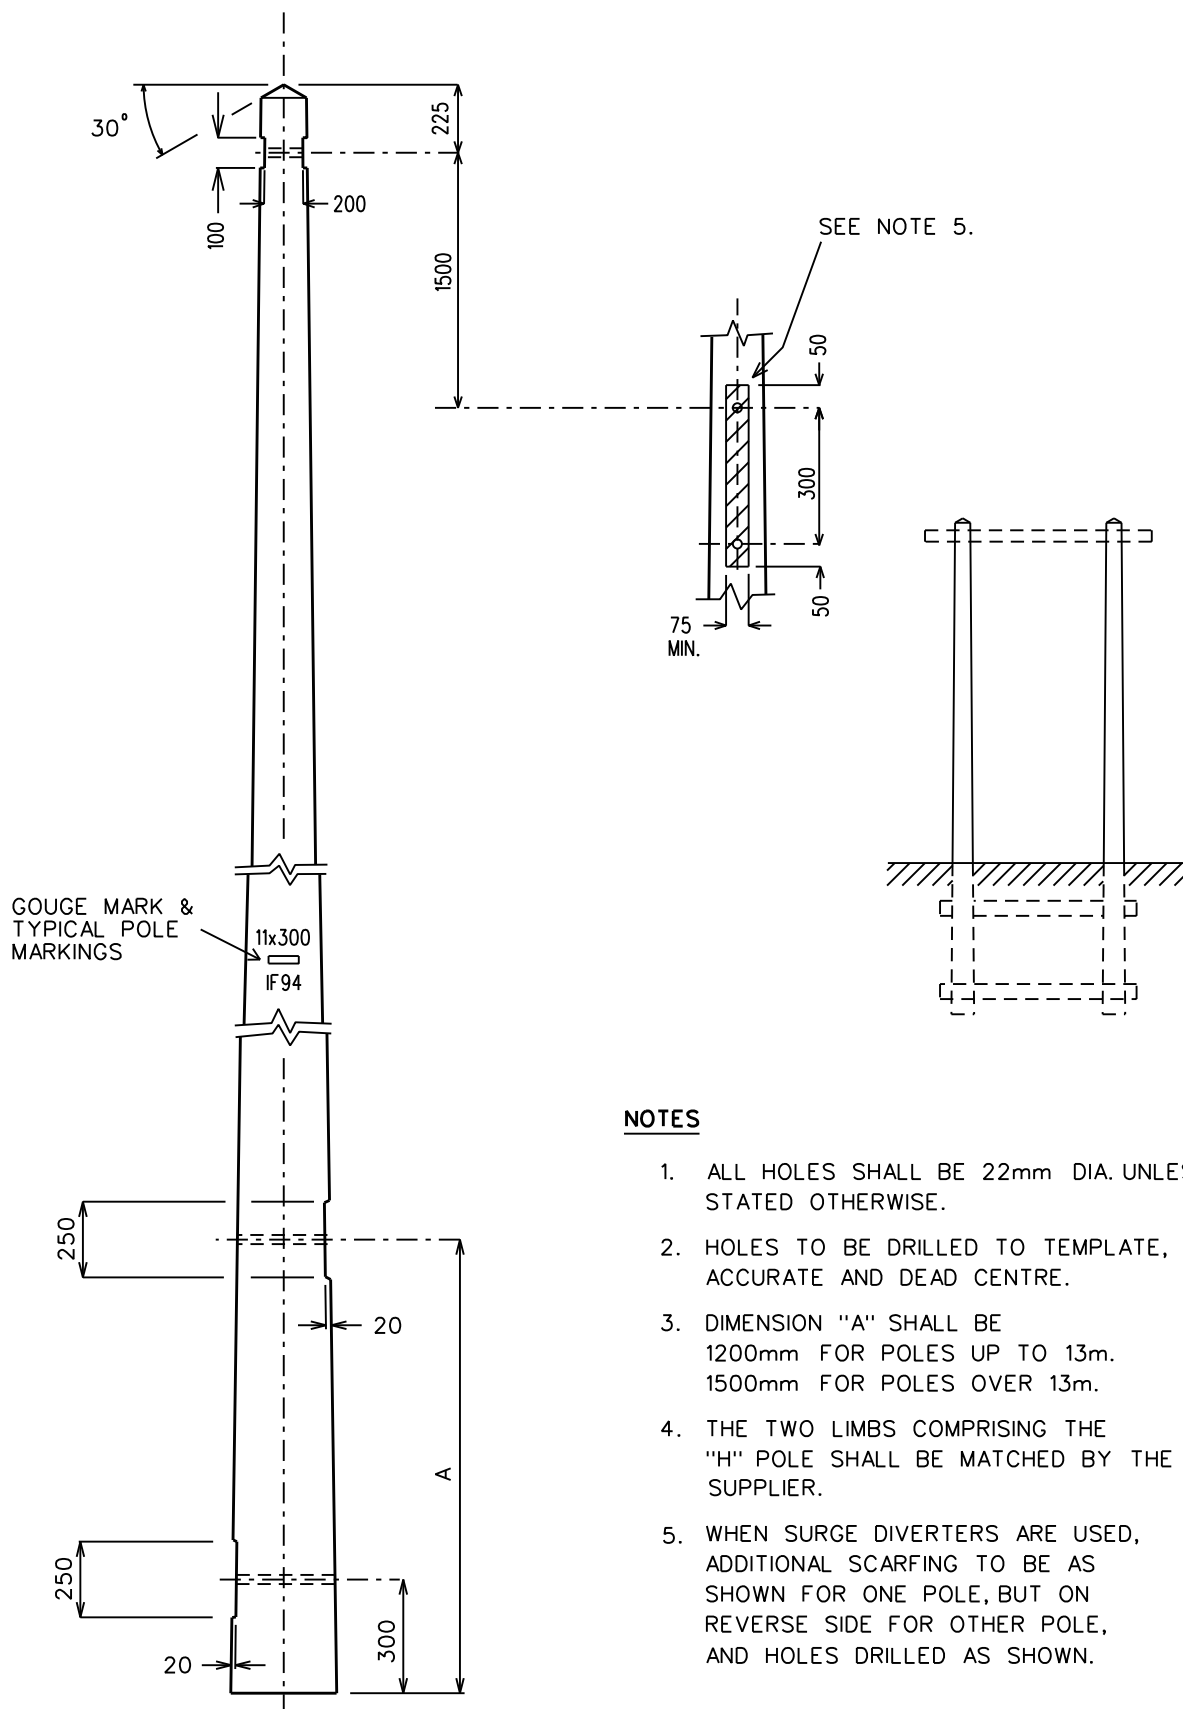

NOTES


1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 1200mm FOR POLES UP TO 13m. 1500mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHEN SURGE DIVERTERS ARE USED, ADDITIONAL SCARFING TO BE AS SHOWN FOR ONE POLE, BUT ON REVERSE SIDE FOR OTHER POLE, AND HOLES DRILLED AS SHOWN.

All dimensions in millimetres

Terminal H Pole with Droppers 33kV Heavy Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.15	1
APP.		

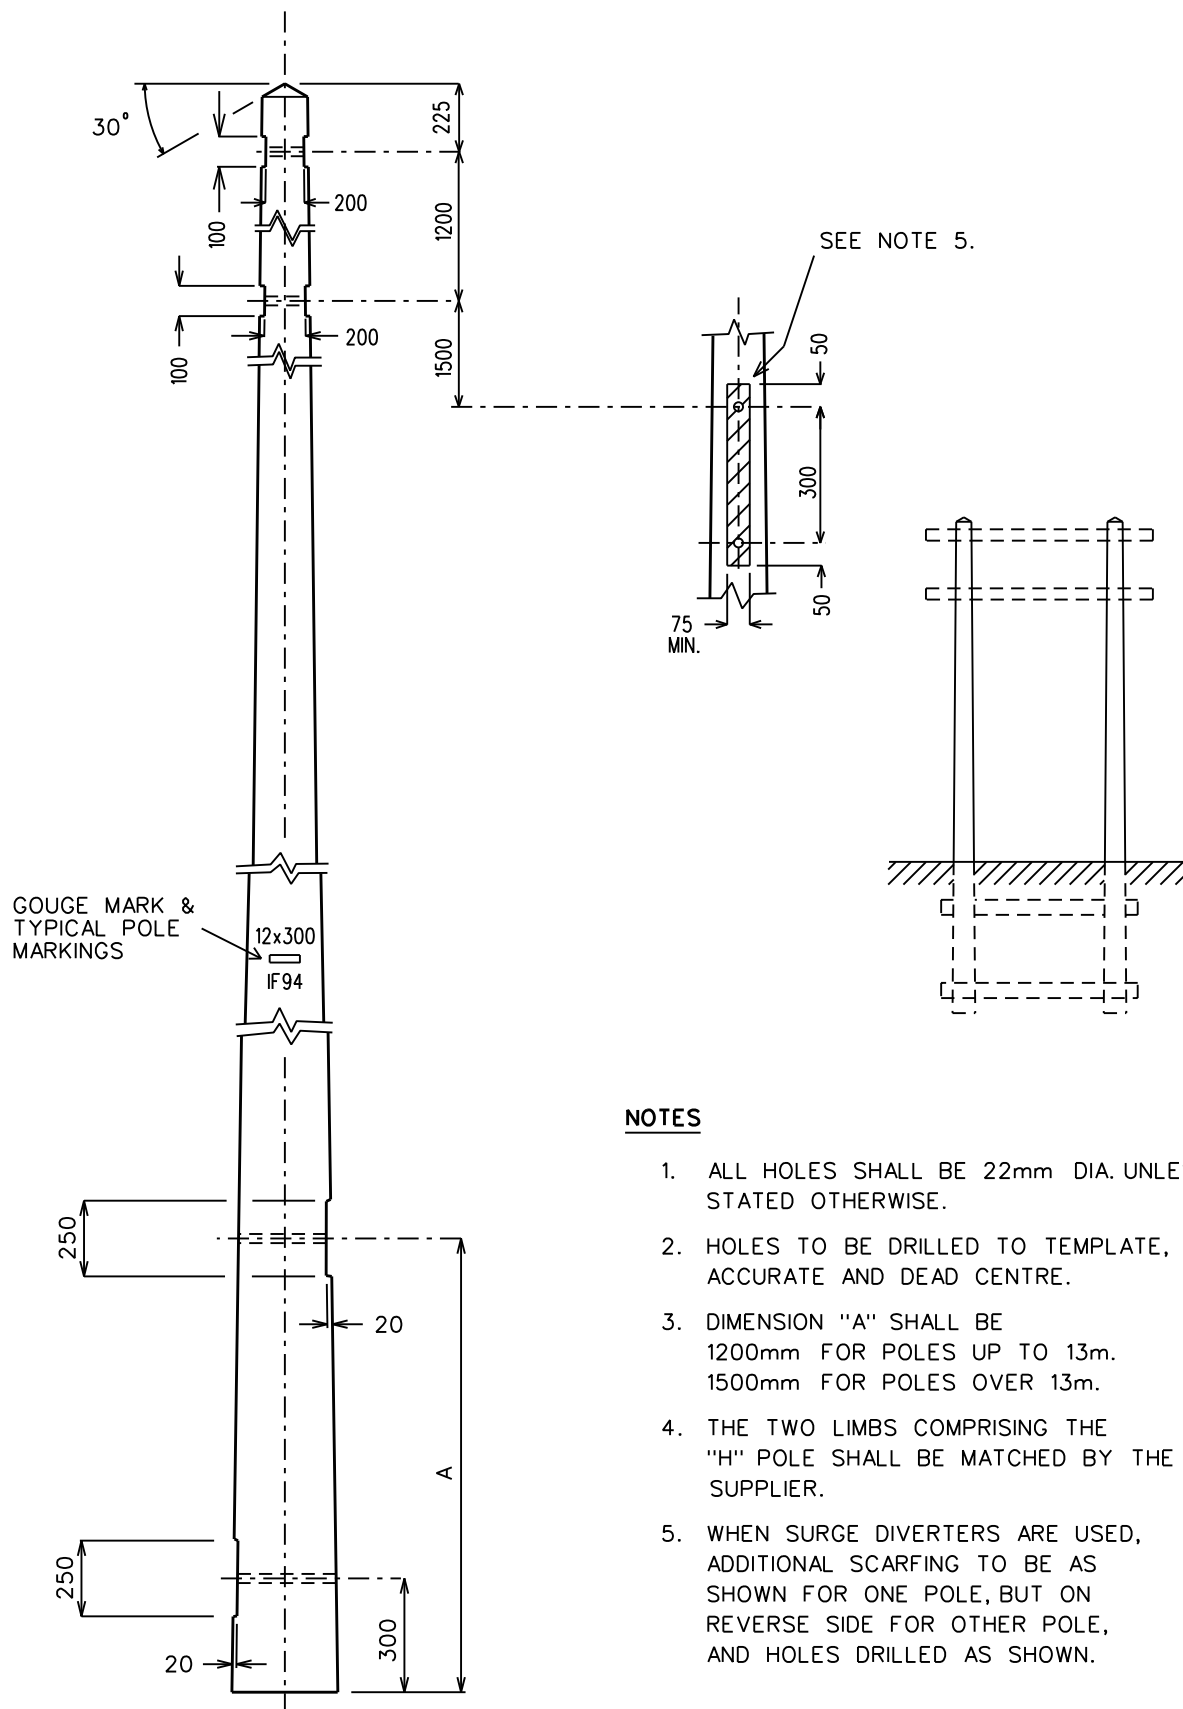

NOTES


1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 1200mm FOR POLES UP TO 13m. 1500mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHEN SURGE DIVERTERS ARE USED, ADDITIONAL SCARFING TO BE AS SHOWN FOR ONE POLE, BUT ON REVERSE SIDE FOR OTHER POLE, AND HOLES DRILLED AS SHOWN.

All dimensions in millimetres

Terminal H Pole with Droppers Large Deviation 33kV Heavy Construction Lines

© UK Power Networks 2014



DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.16	1
APP.		

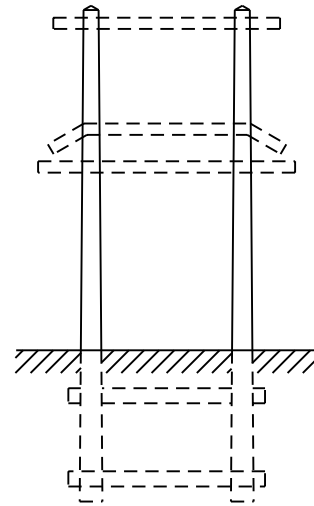

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE
1200mm FOR POLES UP TO 13m.
1500mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE
"H" POLE SHALL BE MATCHED BY THE
SUPPLIER.

Terminal H Pole with Single Cable Circuit 33kV Heavy Construction Lines

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.17	1
APP.		

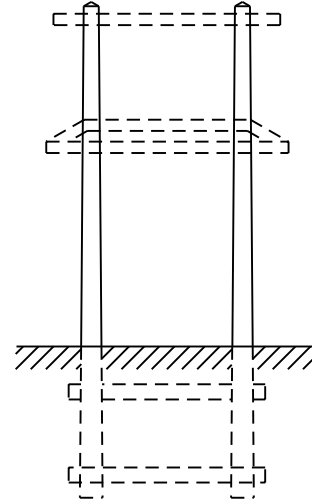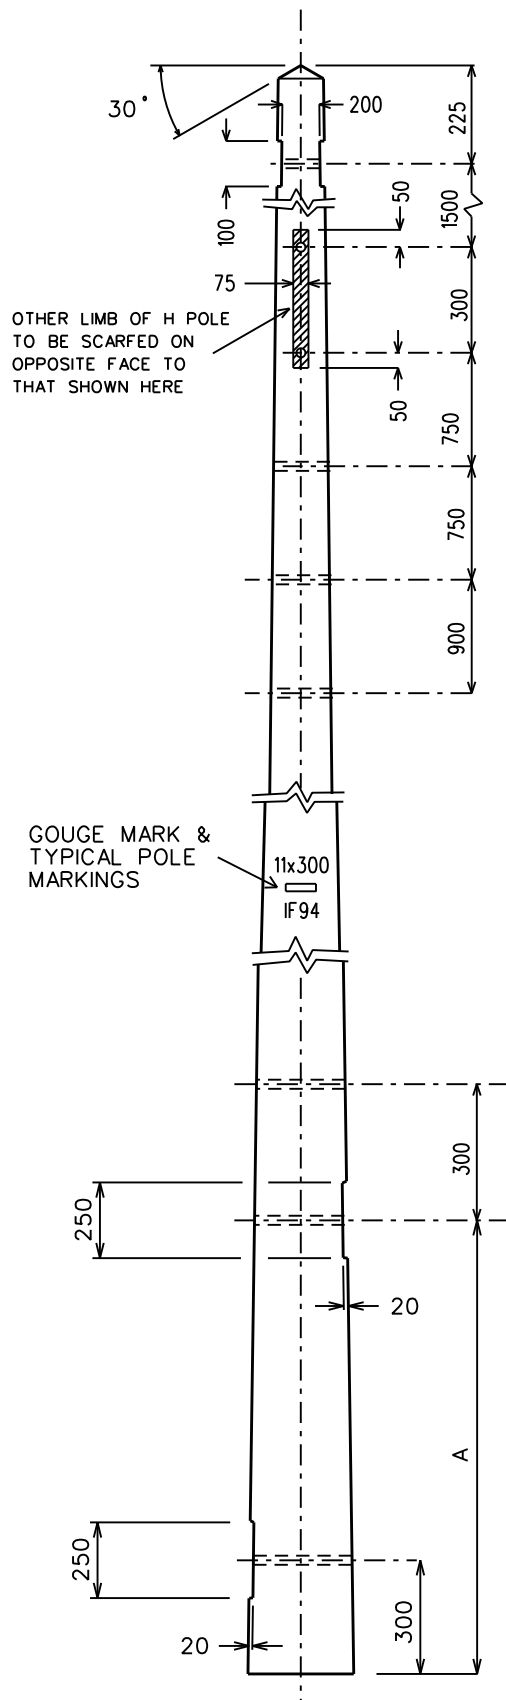

NOTES



1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 900mm FOR POLES UP TO 13m. 1200mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

All dimensions in millimetres

Terminal H Pole with Two Cable Circuits 33kV Heavy Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.18	1
APP.		

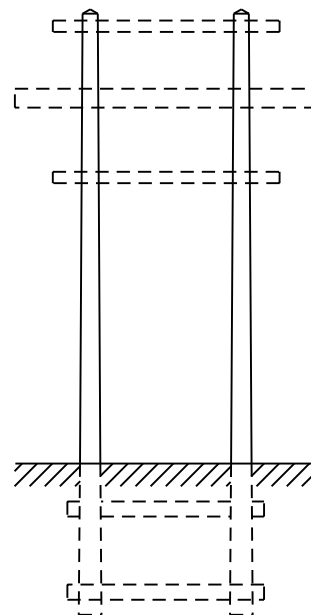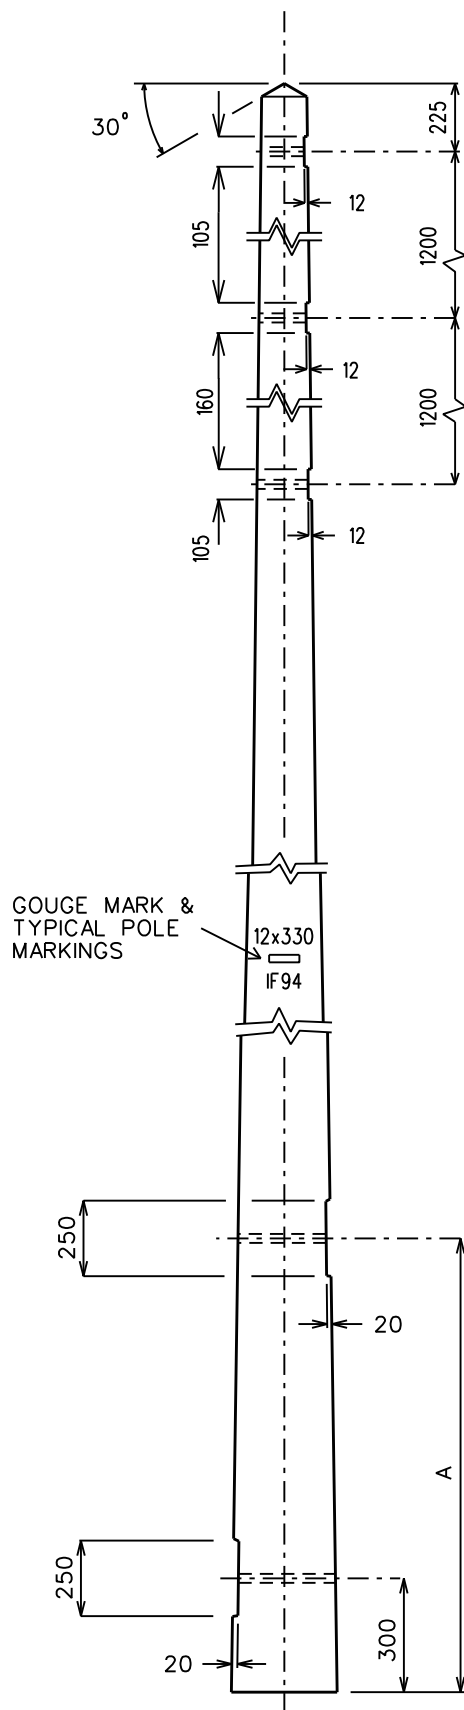

NOTES



1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE
1200mm FOR POLES UP TO 11m.
1500mm FOR POLES FROM 12m. TO 16m.
1800mm FOR POLES OVER 16m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

All dimensions in millimetres

Intermediate H Pole 33kV Double Circuit Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.20	1
APP.		

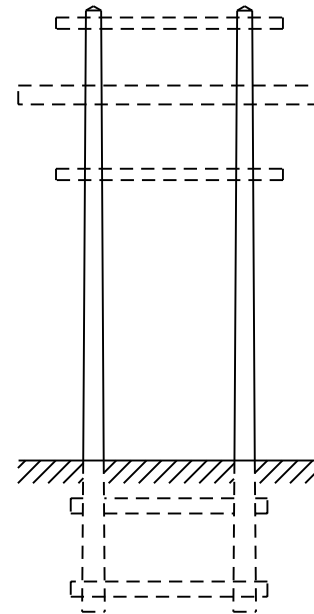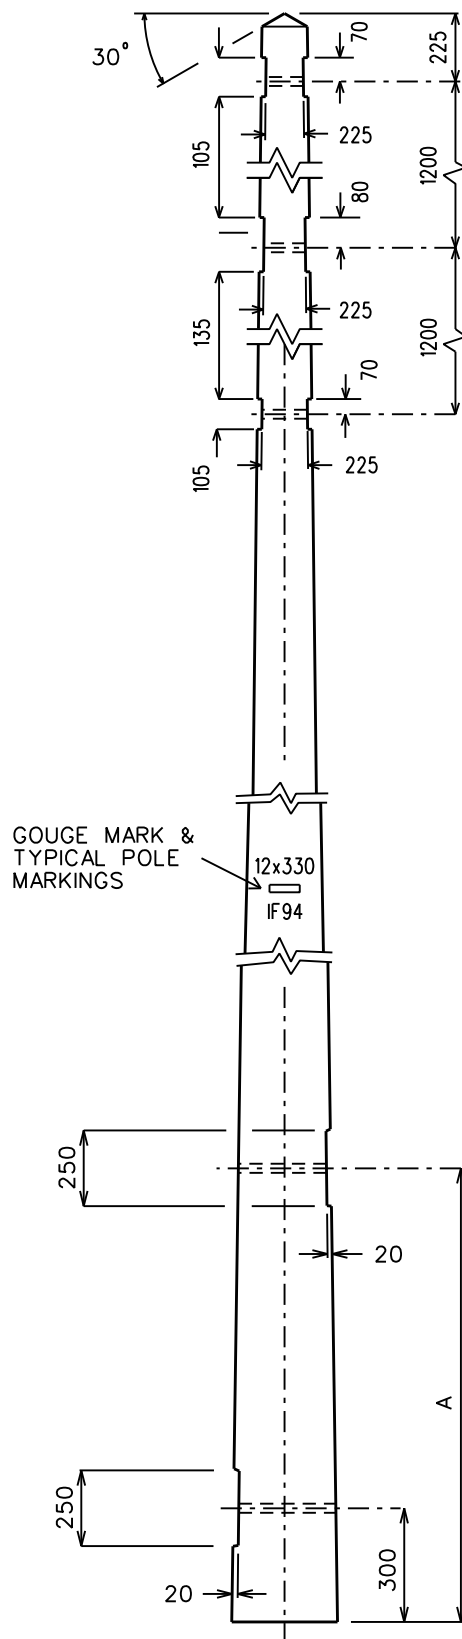

NOTES




1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE
1200mm FOR POLES UP TO 11m.
1500mm FOR POLES FROM 12m. TO 16m.
1800mm FOR POLES OVER 16m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHERE POLE DIAMETERS AT CROSSARM POSITIONS ARE 225mm OR LESS, THE SCARFING AT THESE POSITIONS SHALL BE OMITTED.

All dimensions in millimetres


Section H Pole 33kV Double Circuit Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. February 2014	EDS 01-9000.21	1
APP.		

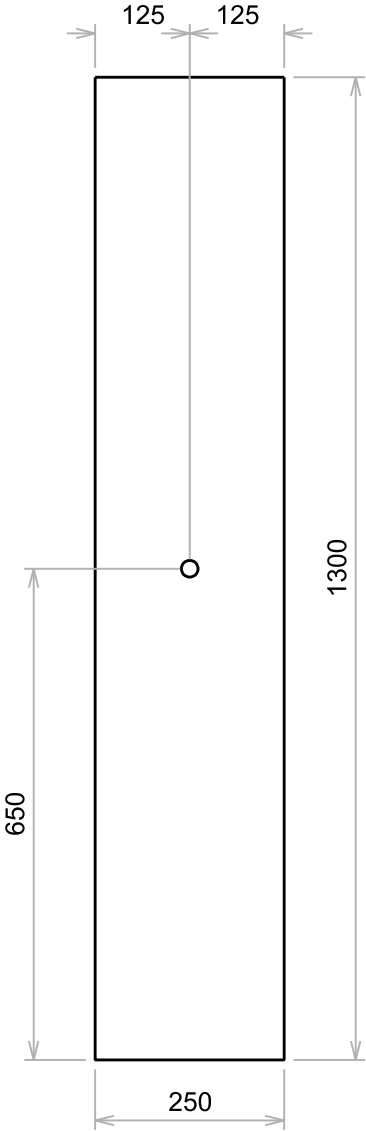

TYPE B

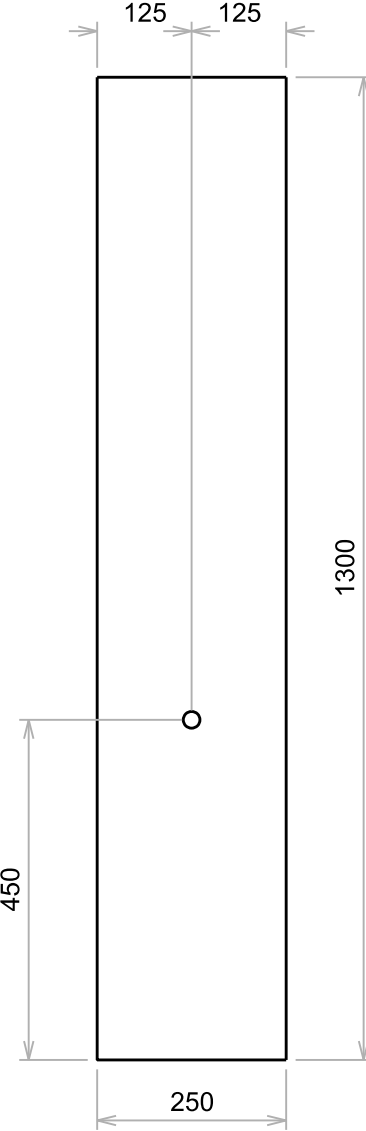


TYPE C

NOTE
All holes 22mm Dia.

All dimensions in millimetres

Wood Kicking Blocks

© UK Power Networks 2014		
DRN. June 1994	DRAWING NUMBER	ISSUE
CKD.	EDS 01-9000.22	1
APP.		

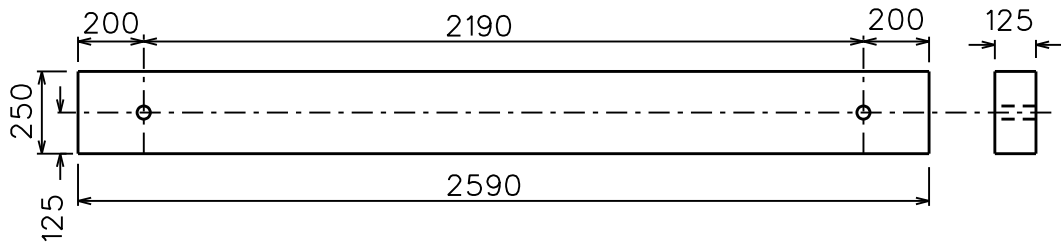

TYPE B



TYPE C



TYPE D

NOTE


All holes 22mm Dia.

All dimensions in millimetres

Wood Brace Blocks

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. January 2014	EDS 01-9000.23	1
APP.		

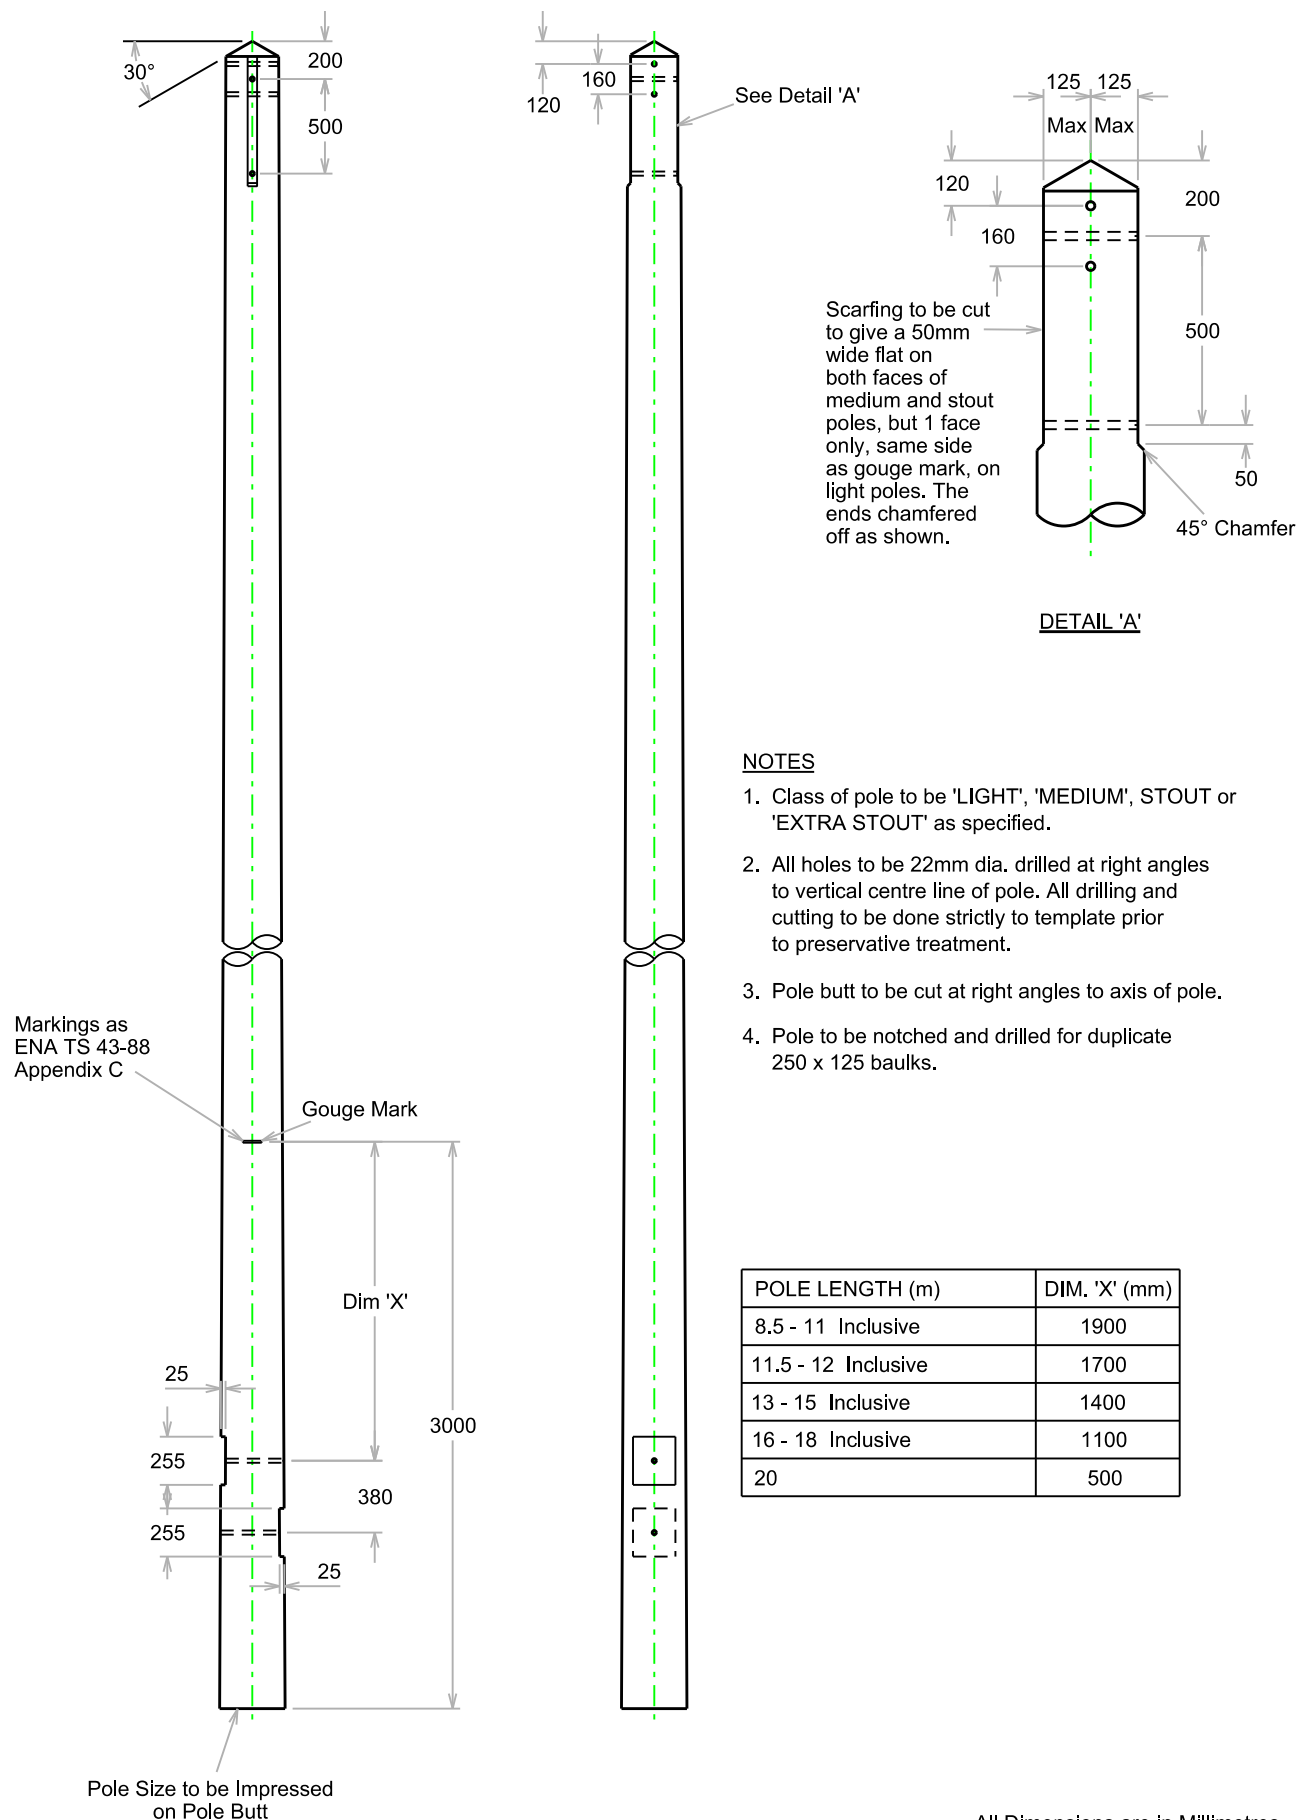


Single Pole Fabrication (HV)

(Based on ENA TS 43-40, Drg. 434001)

© UK Power Networks 2013

DRN.	R.D.H. 15~03~10	SPECIFICATION DRAWING NUMBER	ISSUE
CKD.		EDS 01-9000.101	1
APP.			

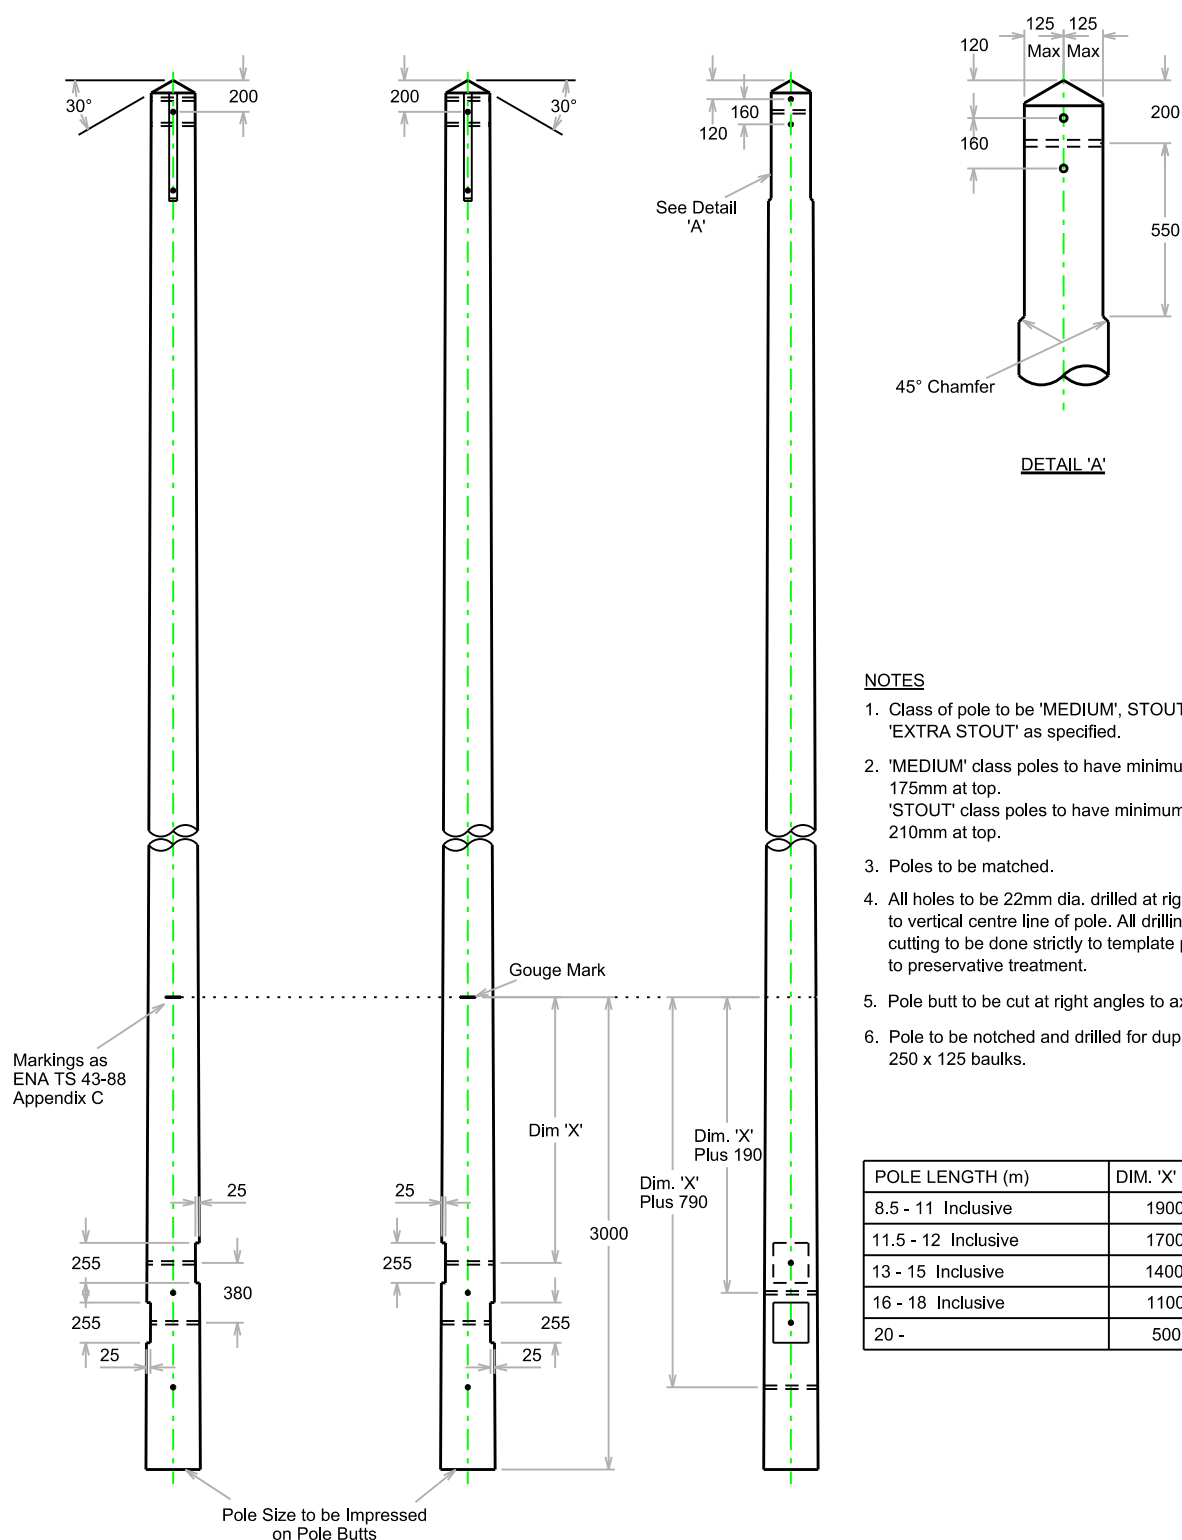


All Dimensions are in Millimetres

'H' Pole Fabrication

(Based on ENA TS 43-40, Drg. 434002)

© UK Power Networks 2013

DRN.	R.D.H. 15~03~10	SPECIFICATION DRAWING NUMBER	ISSUE
CKD.		EDS 01-9000.102	1
APP.			

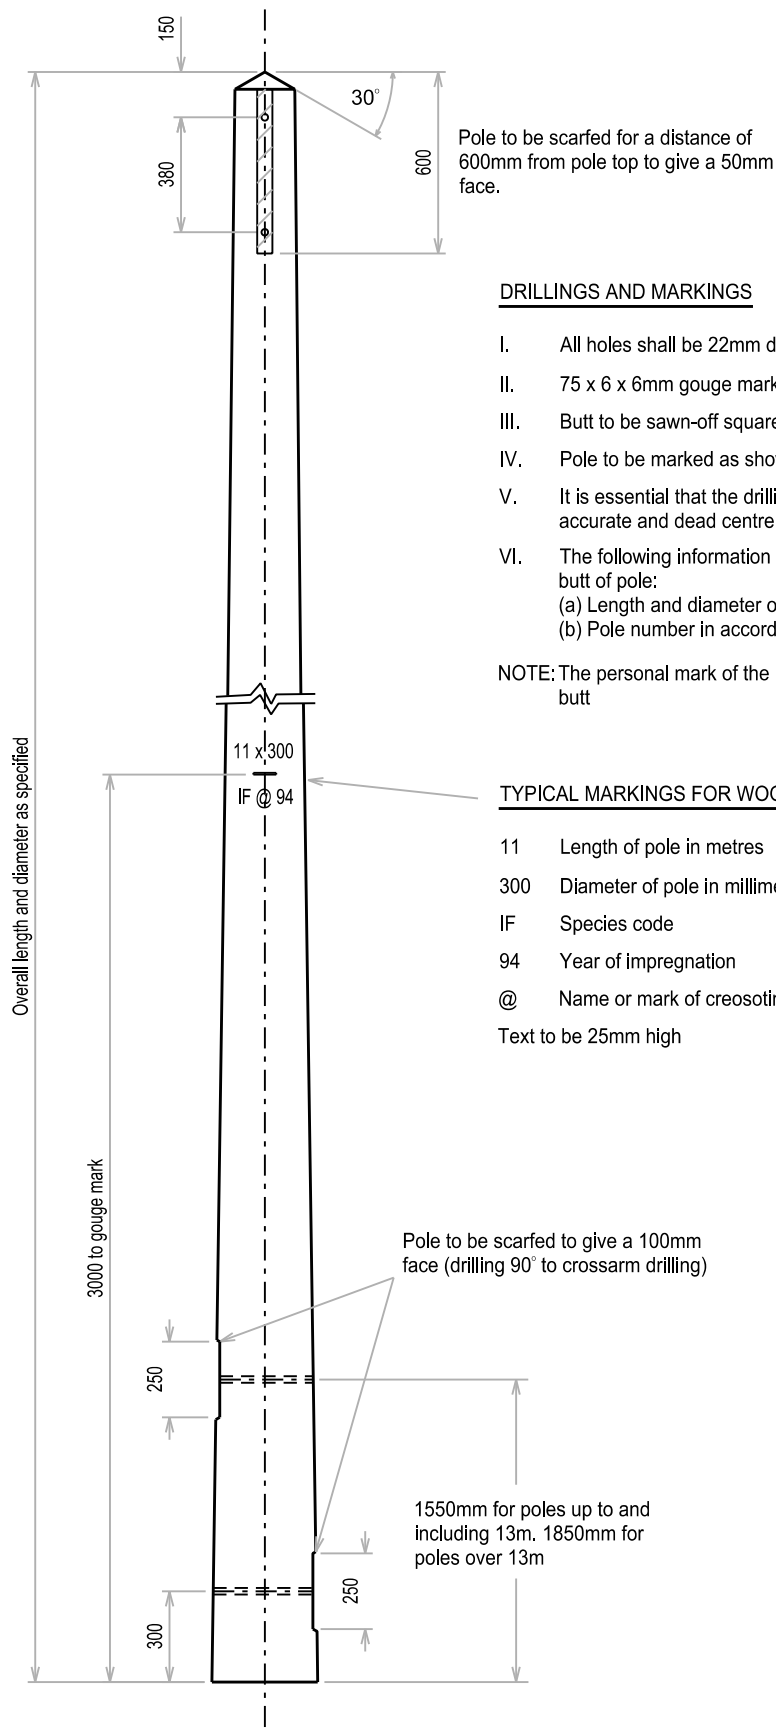

DRILLINGS AND MARKINGS

- I. All holes shall be 22mm dia. unless otherwise stated
- II. 75 x 6 x 6mm gouge mark 3000mm up from butt
- III. Butt to be sawn-off square to the axis of the pole
- IV. Pole to be marked as shown
- V. It is essential that the drillings are drilled to template, are accurate and dead centre
- VI. The following information to be impressed on the end grain of butt of pole:
 - (a) Length and diameter of pole
 - (b) Pole number in accordance with schedule

NOTE: The personal mark of the pole inspector will be impressed on the butt

TYPICAL MARKINGS FOR WOOD POLES

- 11 Length of pole in metres
- 300 Diameter of pole in millimetres at 1500mm from the butt
- IF Species code
- 94 Year of impregnation
- @ Name or mark of creosoting firm
- Text to be 25mm high

33kV Single Circuit Intermediate Pole

Based on EPN drawing 4/B1000

© UK Power Networks 2014

DRN. RDH 24.06.94

CKD.


APP.

SPECIFICATION
DRAWING NUMBER

EDS 01-9000.103

ISSUE

1

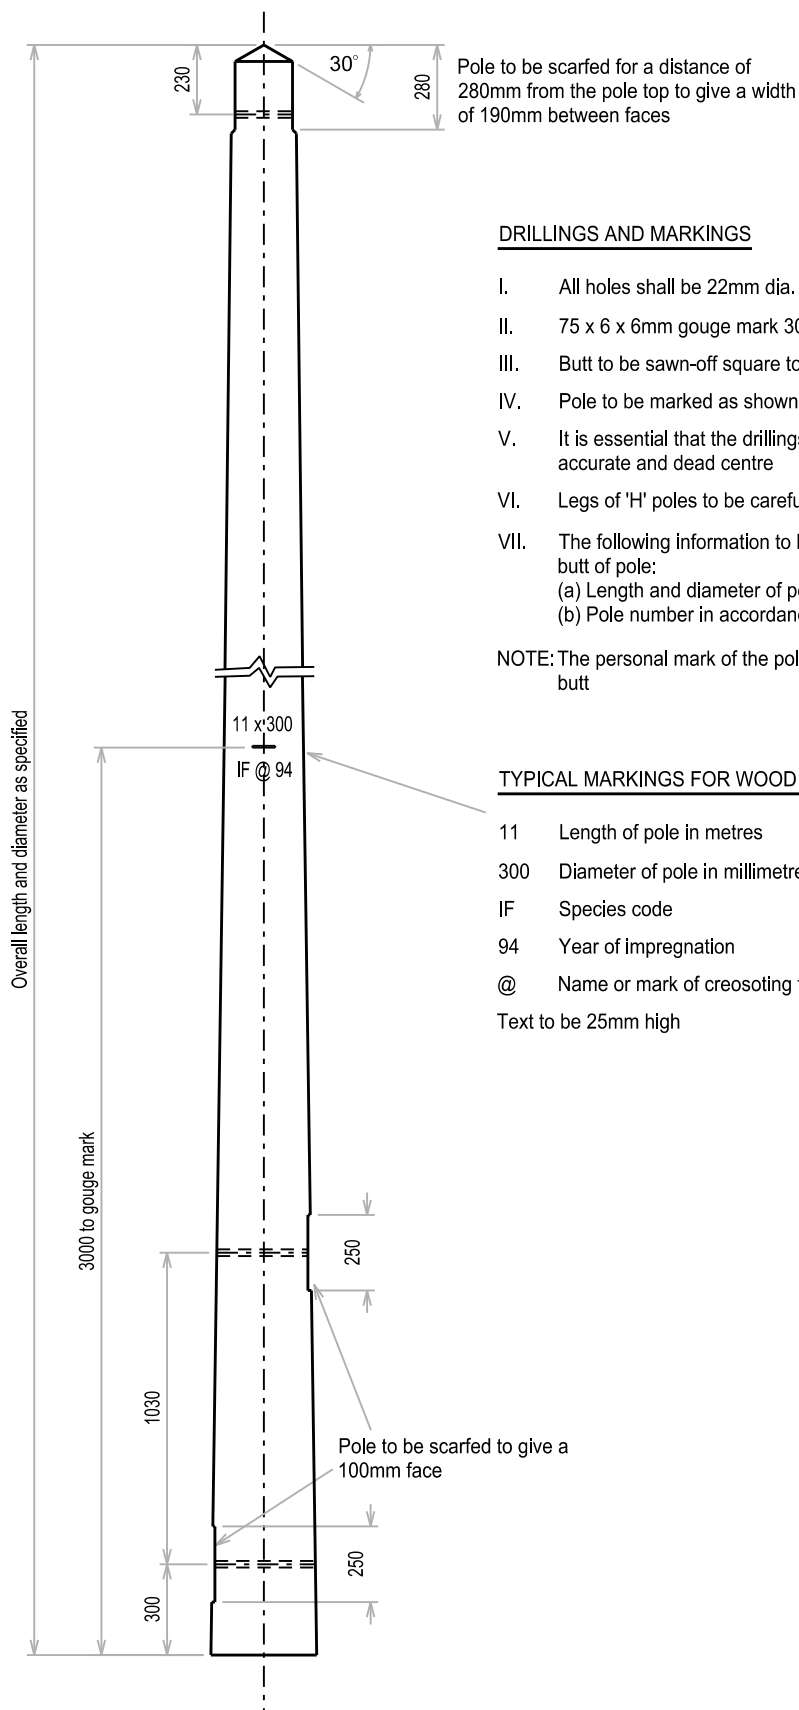

DRILLINGS AND MARKINGS

- I. All holes shall be 22mm dia. unless otherwise stated
- II. 75 x 6 x 6mm gouge mark 3000mm up from butt on inside of legs
- III. Butt to be sawn-off square to the axis of the pole
- IV. Pole to be marked as shown
- V. It is essential that the drillings are drilled to template, are accurate and dead centre
- VI. Legs of 'H' poles to be carefully matched
- VII. The following information to be impressed on the end grain of butt of pole:
 - (a) Length and diameter of pole
 - (b) Pole number in accordance with schedule

NOTE: The personal mark of the pole inspector will be impressed on the butt

TYPICAL MARKINGS FOR WOOD POLES

- 11 Length of pole in metres
- 300 Diameter of pole in millimetres at 1500mm from the butt
- IF Species code
- 94 Year of impregnation
- @ Name or mark of creosoting firm
- Text to be 25mm high

33kV Single Circuit 'H' Through Pole

Based on EPN drawing 4/B1001

© UK Power Networks 2014

DRN. RDH 17.12.13

CKD.


APP.

SPECIFICATION
DRAWING NUMBER

EDS 01-9000.104

ISSUE

1

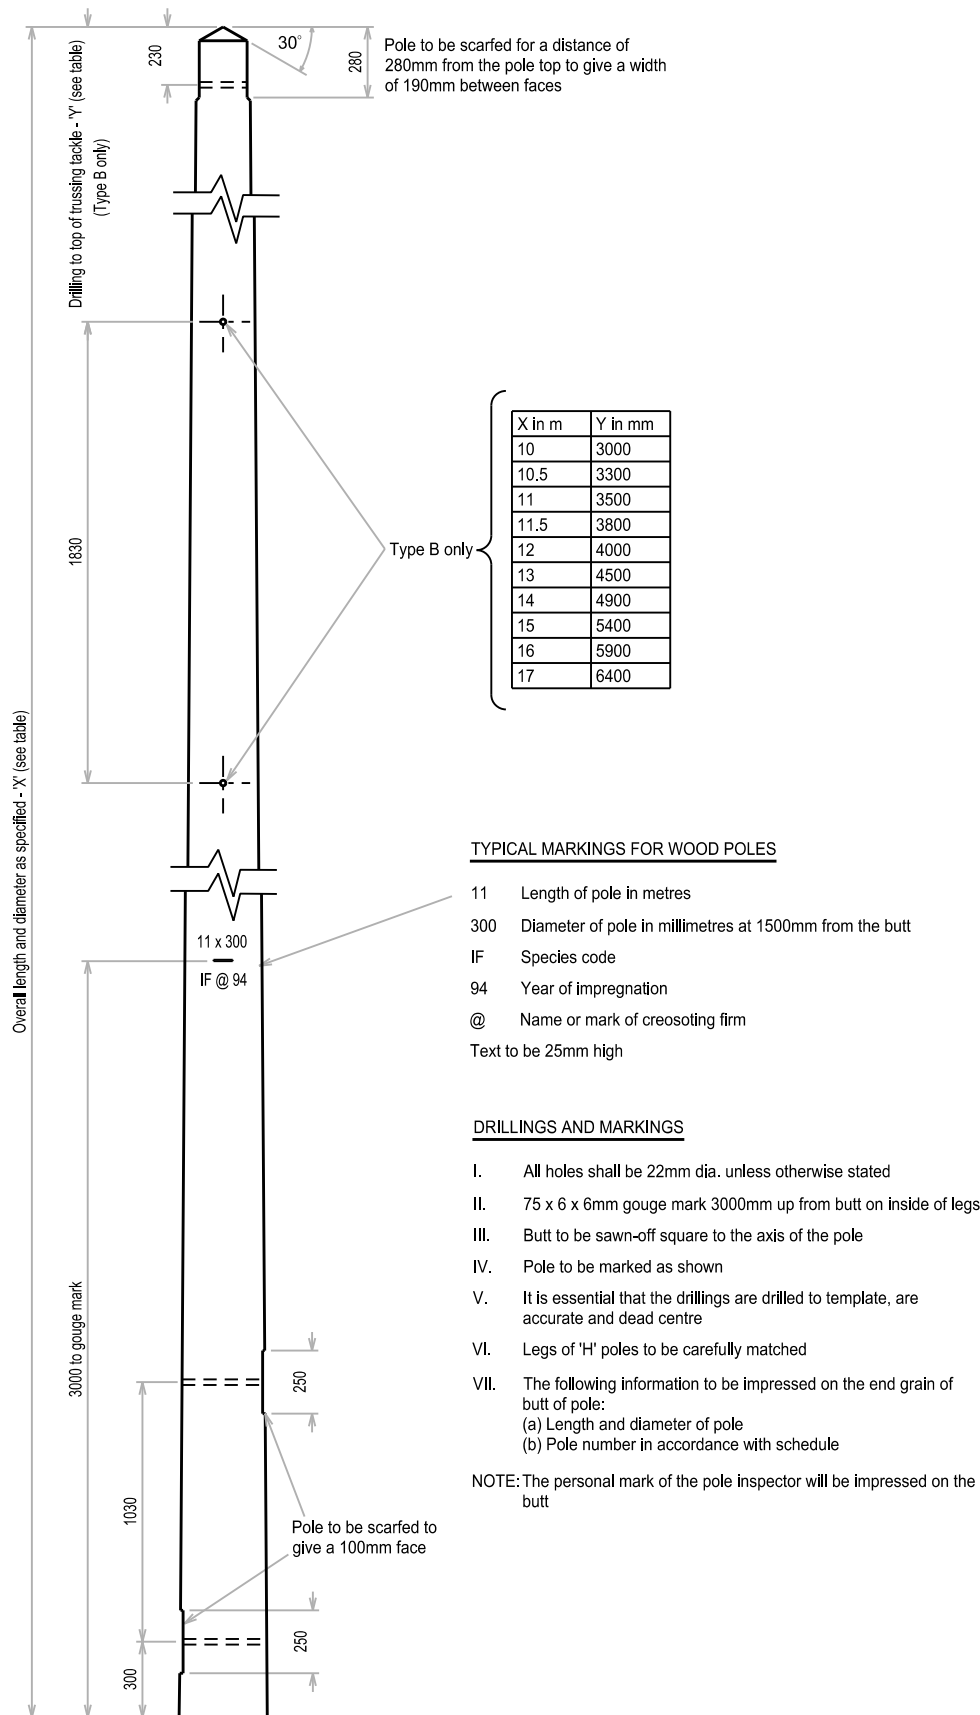

33kV Single Circuit Angle/Section Pole

Based on EPN drawing 4/B1002

© UK Power Networks 2014

DRN. RDH 17.12.13

CKD.


APP.

SPECIFICATION
DRAWING NUMBER

EDS 01-9000.105

ISSUE

1

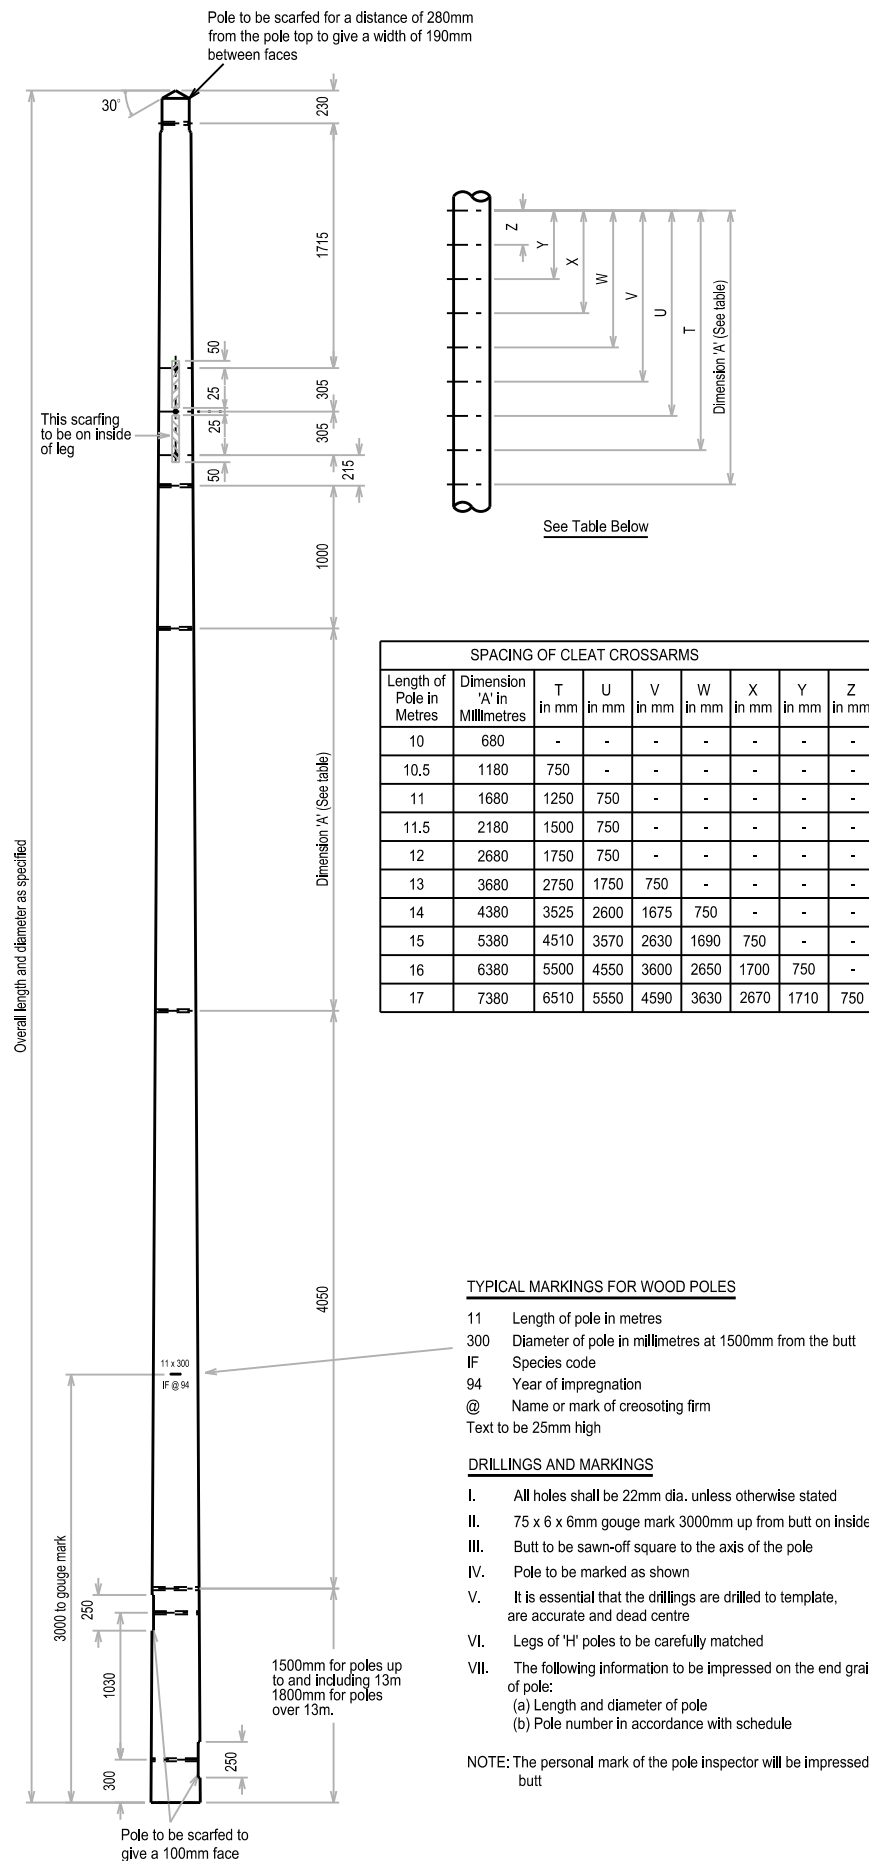

33kV Terminal 'H' Pole

Based on EPN drawing 5/B1007

© UK Power Networks 2014

DRN. RDH 18.12.13

CKD.

APP.

SPECIFICATION
DRAWING NUMBER

EDS 01-9000.106

ISSUE

1