


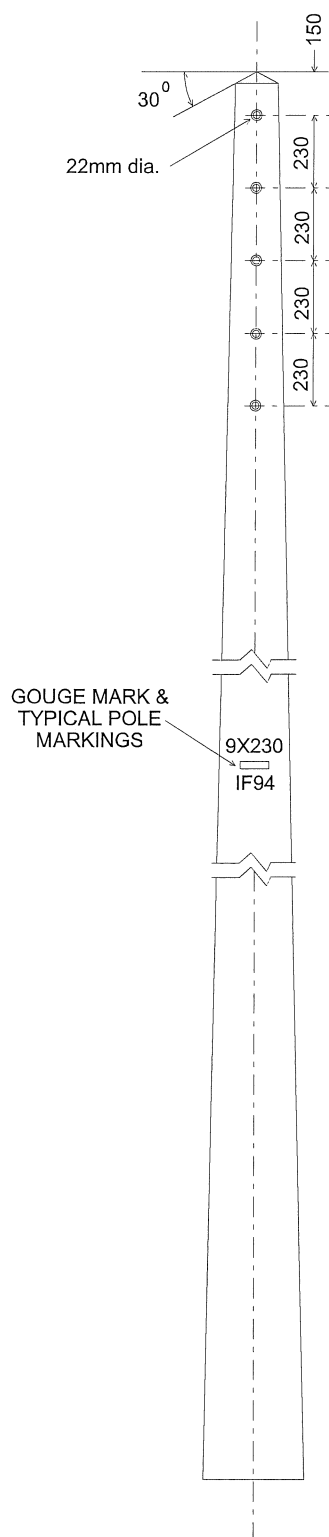

NOTES

1. ALL HOLES SHALL BE 18 mm DIA. WITH THE EXCEPTION OF THE TOP WHICH WILL BE 22 mm DIA.
2. HOLES SHALL BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.

All dimensions in millimetres

Intermediate Pole LV Lines & Services

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. January 2014	EDS 01-9000.01	1
APP.		