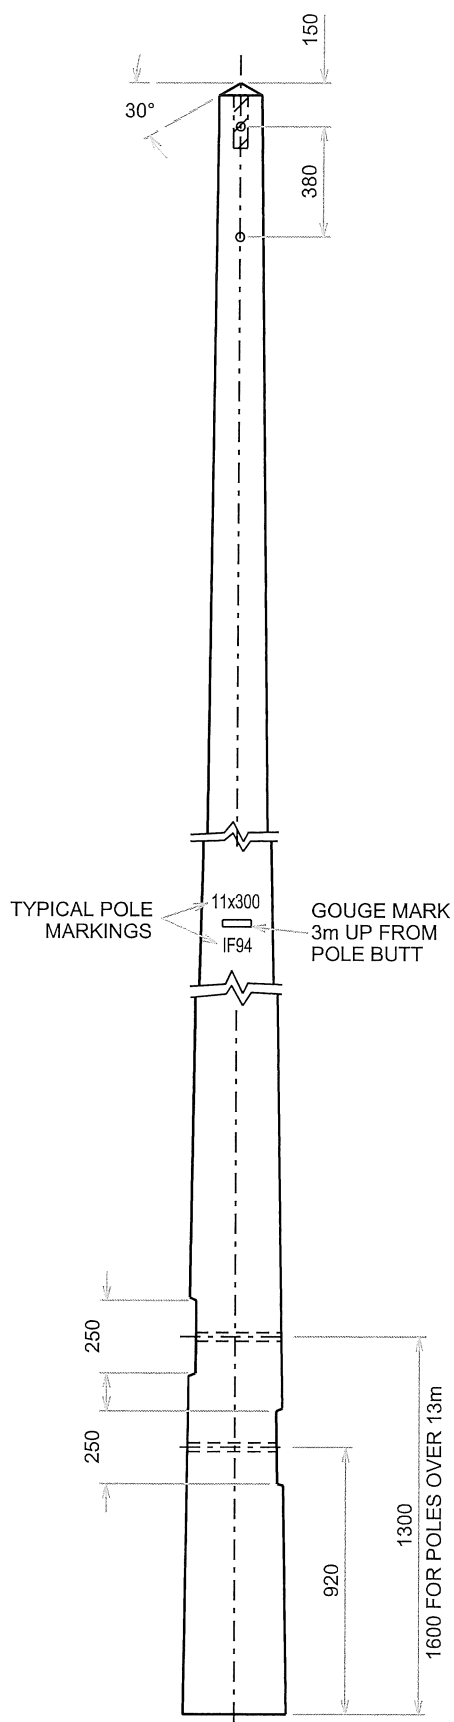


NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. ALL SCARFING AND SLOTS, EXCEPT THOSE FOR KICKING BLOCKS, SHALL BE CUT SQUARE TO GIVE A 50mm WIDE FACE.

All dimensions in millimetres

Intermediate, Section, Tee-off or
Terminal Pole for 33kV/HV
Construction Lines

© UK Power Networks 2014

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD.	EDS 01-9000.06	1
APP.		