



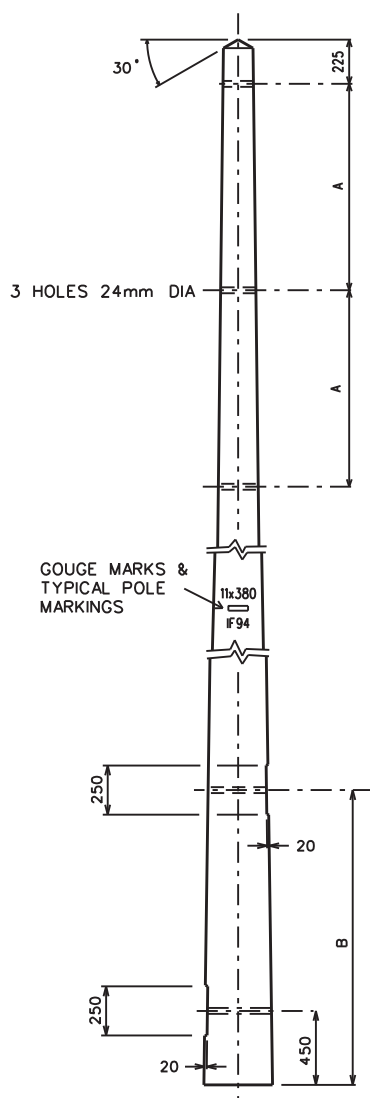

SINGLE POLE

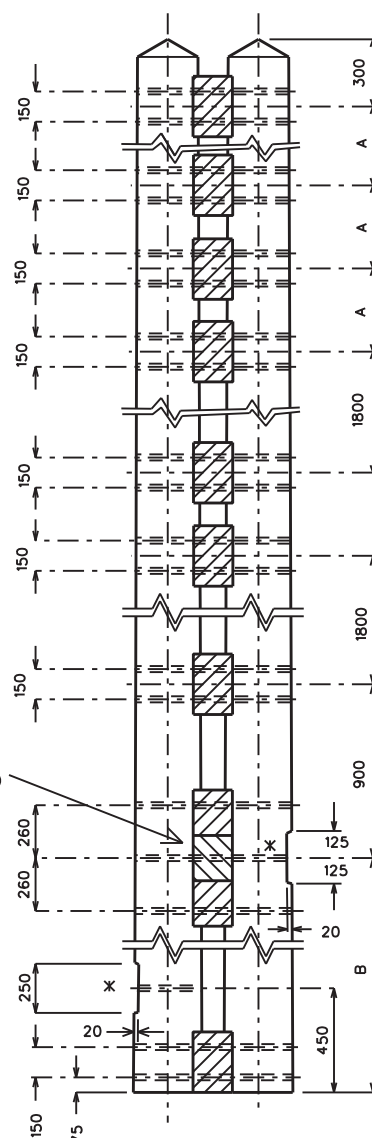

TWIN POLE

NOTES

1. ALL HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED, DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
2. TWIN POLES TO BE MATCHED AND ASSEMBLED AT SUPPLIER'S YARD.
3. POLE TYPE AND DIMENSION 'A' TO BE SPECIFIED. DIMENSION 'A' TO MATCH VERTICAL CONDUCTOR SPACING, i.e. 1200 or 1500mm.
4. DIMENSION 'B' TO BE 1400mm FOR POLES 13m. AND UNDER, 1700mm FOR POLES OVER 13m.
5. SHEAR BLOCKS TO BE WELL SEASONED OAK CUT 50 LONGER THAN SCARFED FACE. SCARFING 12mm DEEP, SQUARE CUT AND DRILLED FOR TWO BOLTS AT POSITIONS SHOWN.
6. BOLTS TO BE FITTED TO ALL HOLES EXCEPT:-
i) 24mm DIA. HOLES (FOR INSULATOR EYE BOLTS)
ii) HOLES MARKED * (FOR KICKING BLOCK FIXING BOLTS)

SHEAR BLOCK SCHEDULE

OVERALL HEIGHT OF POLE	DIMENSION A	TOTAL No. REQ'D
10m TO 12m	1200	8
12m TO 13m	1200	9
13m TO 15m	1200	10
15m TO 17m	1200	11
10m TO 12m	1500	8
12m TO 14m	1500	9
14m TO 16m	1500	10
16m TO 18m	1500	11

All dimensions in millimetres

Vertical Formation Section Pole 11/33kV Heavy Construction Lines

© UK Power Networks 2014

DRN. June 1994

DRAWING NUMBER

ISSUE

CKD. February 2014

EDS 01-9000.12

1

APP.