


ISSUED 20/12/05

PR

①

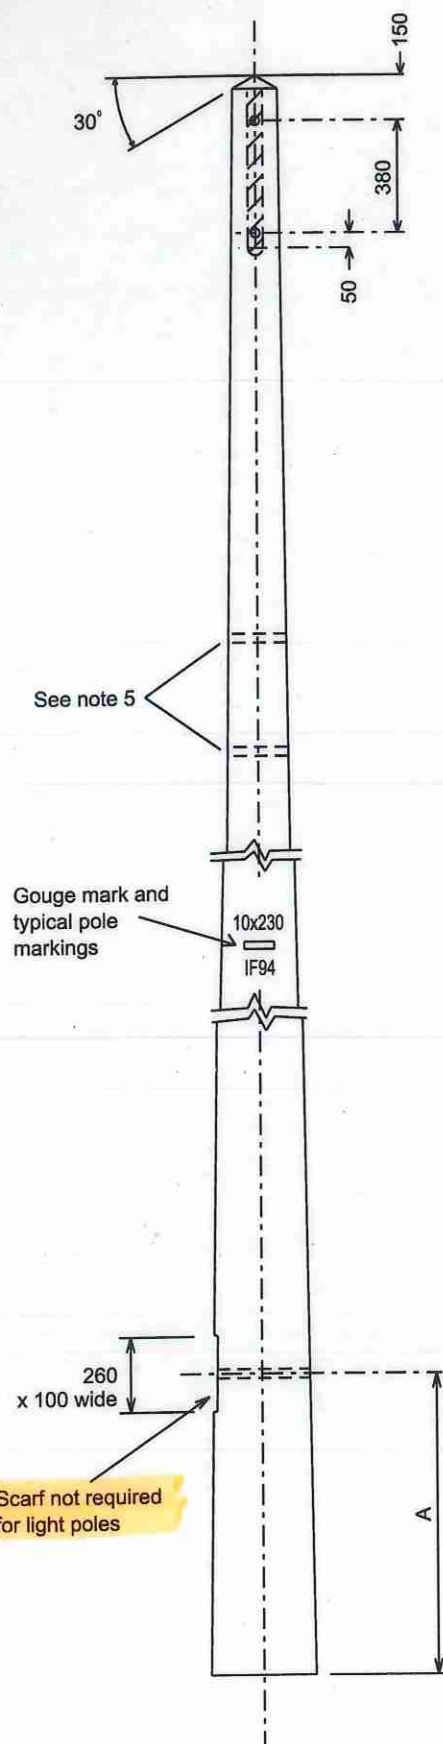

NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. ALL HOLES SHALL BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. SCARFING SHALL BE CUT TO GIVE A 50mm WIDE FACE AND THE LOWER END CHAMFERED OFF BEYOND THE LENGTH SHOWN.
4. FOR LINE DEVIATION OVER 60 DEGREES ADDITIONAL POLE-TOP SCARFING SHALL BE DONE ON SITE.
5. HOLES FOR SURGE DIVERTERS DRILLED ON SITE WHEN REQUIRED.
6. DIMENSION "A" SHALL BE 1300mm FOR POLES UP TO 14m. 1600mm FOR POLES OVER 14m.

All dimensions are in millimetres.

WOOD POLE REQUIREMENTS

© EDF Energy 2004

DRN.	R.D.H. 25.11.04	SPECIFICATION DRAWING NUMBER	ISSUE
CKD.	J.K. 16.12.05		
APP.	J.K. 16.12.05	ES 1-9000.25	2