


RISBY TRAINING CENTRE
- LES COES

UK Power Networks

Engineering Design Standard

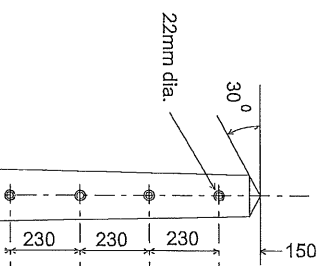

4x 11x295 STOUT
8x 11x240 MEDIUM

NOTES

1. ALL HOLES SHALL BE 18 mm DIA. WITH THE EXCEPTION OF THE TOP WHICH WILL BE 22 mm DIA.
2. HOLES SHALL BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.

All dimensions in millimetres

Intermediate Pole		© UK Power Networks 2014	
LV Lines & Services		DRN. June 1994	DRAWING NUMBER
		CKD. January 2014	EDS 01-9000.01
		APP.	ISSUE
			1

MODIFIED

DBSD10613 28-01-14