


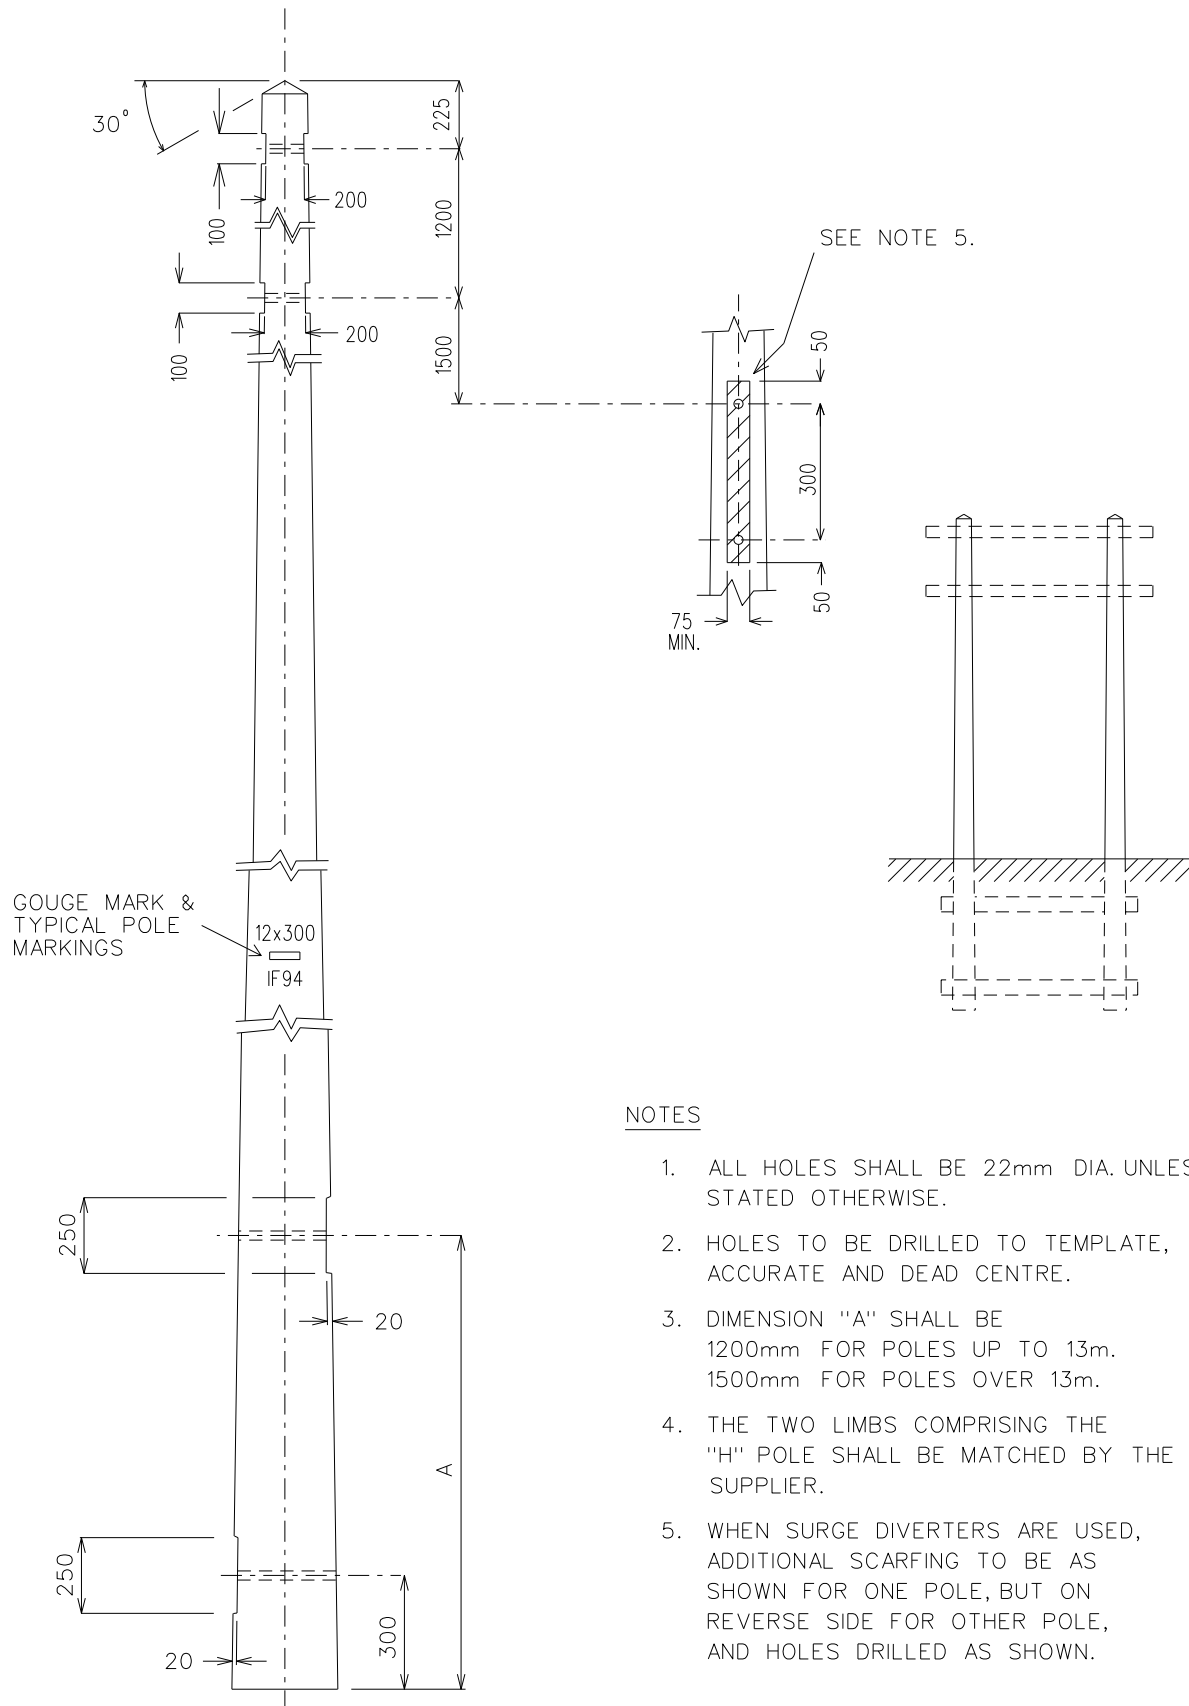

NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 1200mm FOR POLES UP TO 13m. 1500mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHEN SURGE DIVERTERS ARE USED, ADDITIONAL SCARFING TO BE AS SHOWN FOR ONE POLE, BUT ON REVERSE SIDE FOR OTHER POLE, AND HOLES DRILLED AS SHOWN.

All dimensions in millimetres

Terminal H Pole with Droppers Large Deviation 33kV Heavy Construction Lines

© UK Power Networks 2020

DRN. June 1994	DRAWING NUMBER	ISSUE
CKD. A. Archer Feb. 2018	ETS 01-0200.16	1
APP. A. Archer Feb. 2018		