
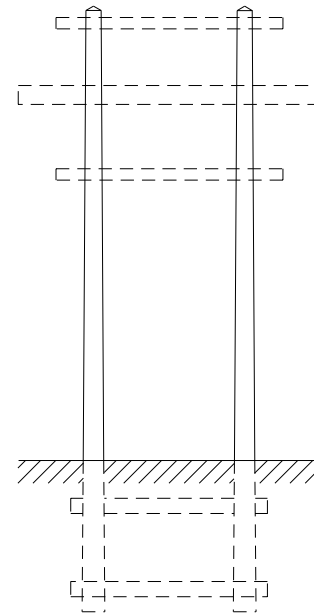


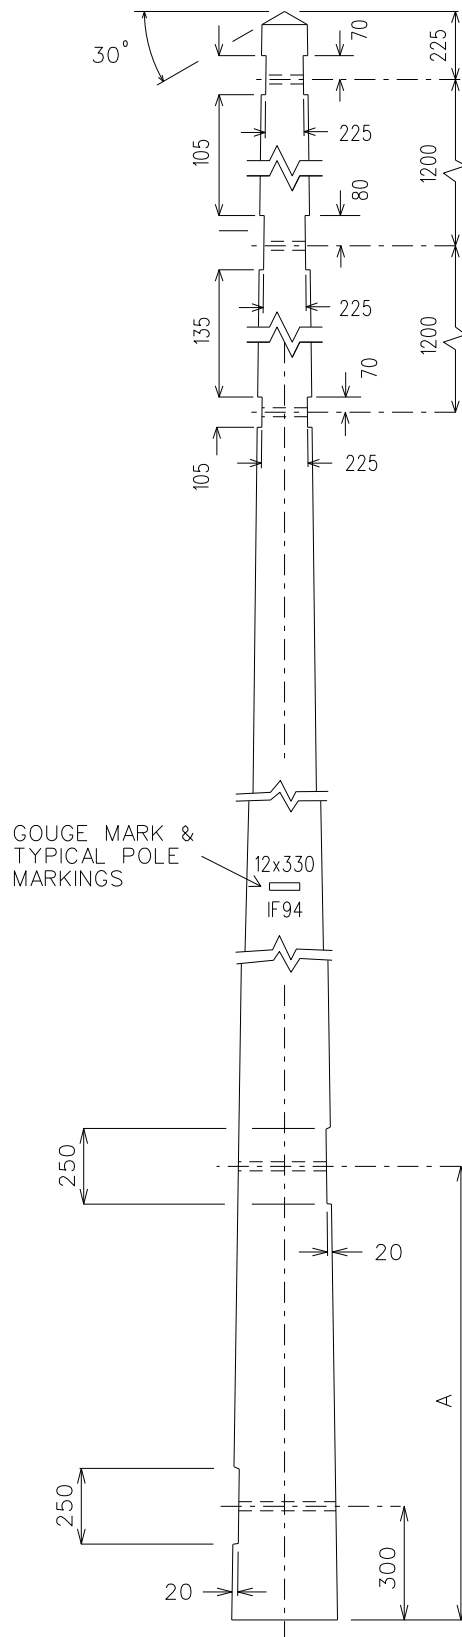

NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE
1200mm FOR POLES UP TO 11m.
1500mm FOR POLES FROM 12m. TO 16m.
1800mm FOR POLES OVER 16m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.
5. WHERE POLE DIAMETERS AT CROSSARM POSITIONS ARE 225mm OR LESS, THE SCARFING AT THESE POSITIONS SHALL BE OMITTED.

All dimensions in millimetres

Section H Pole 33kV Double Circuit Lines

© UK Power Networks 2020

DRN. June 1994

CKD. A. Archer Feb. 2018

APP. A. Archer Feb. 2018

DRAWING NUMBER

ETS 01-0200.21

ISSUE

1