
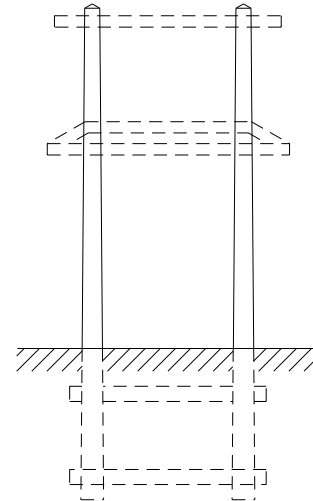


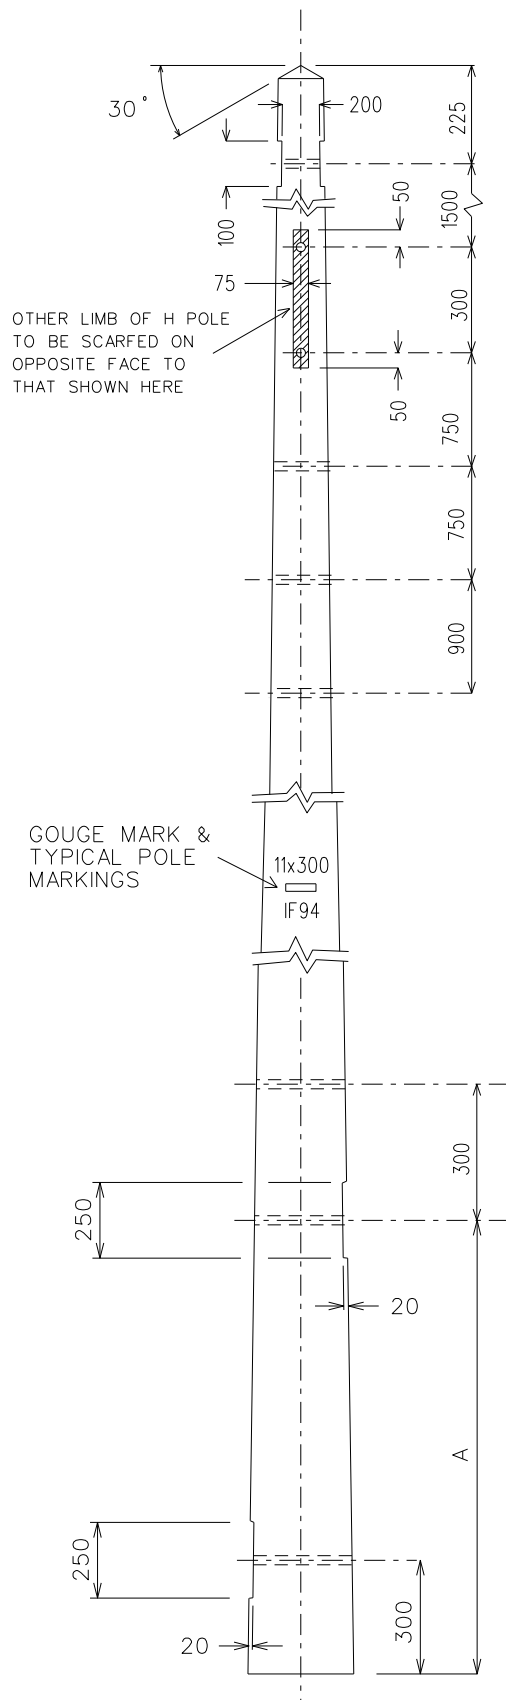

NOTES

1. ALL HOLES SHALL BE 22mm DIA. UNLESS STATED OTHERWISE.
2. HOLES TO BE DRILLED TO TEMPLATE, ACCURATE AND DEAD CENTRE.
3. DIMENSION "A" SHALL BE 900mm FOR POLES UP TO 13m. 1200mm FOR POLES OVER 13m.
4. THE TWO LIMBS COMPRISING THE "H" POLE SHALL BE MATCHED BY THE SUPPLIER.

All dimensions in millimetres

Terminal H Pole with Two Cable Circuits 33kV Heavy Construction Lines

© UK Power Networks 2020

DRN. June 1994

CKD. A. Archer Feb. 2018

APP. A. Archer Feb. 2018

DRAWING NUMBER

ETS 01-0200.18

ISSUE

1