

STEEL CHANNELS TO BE ATTACHED TO WOOD POLES BEFORE LIFT COMMENCES.

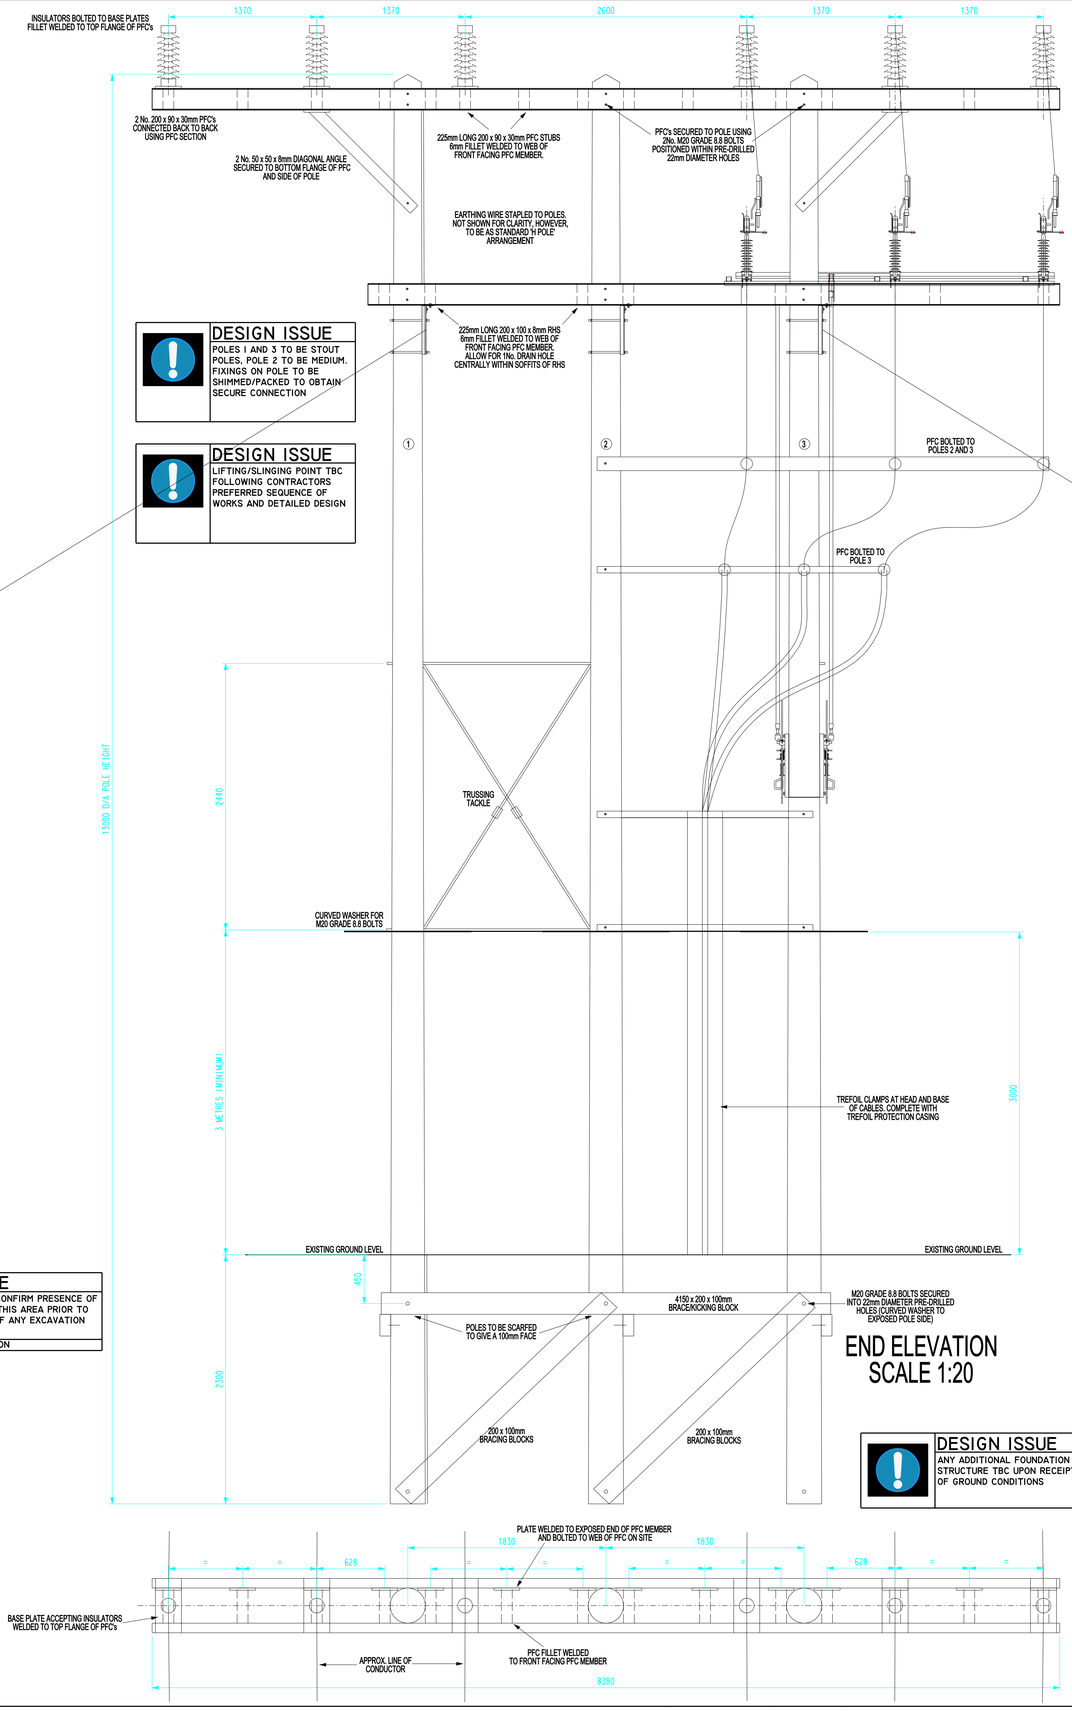


END ELEVATION
SCALE 1:20

PLAN VIEW
SCALE 1:20

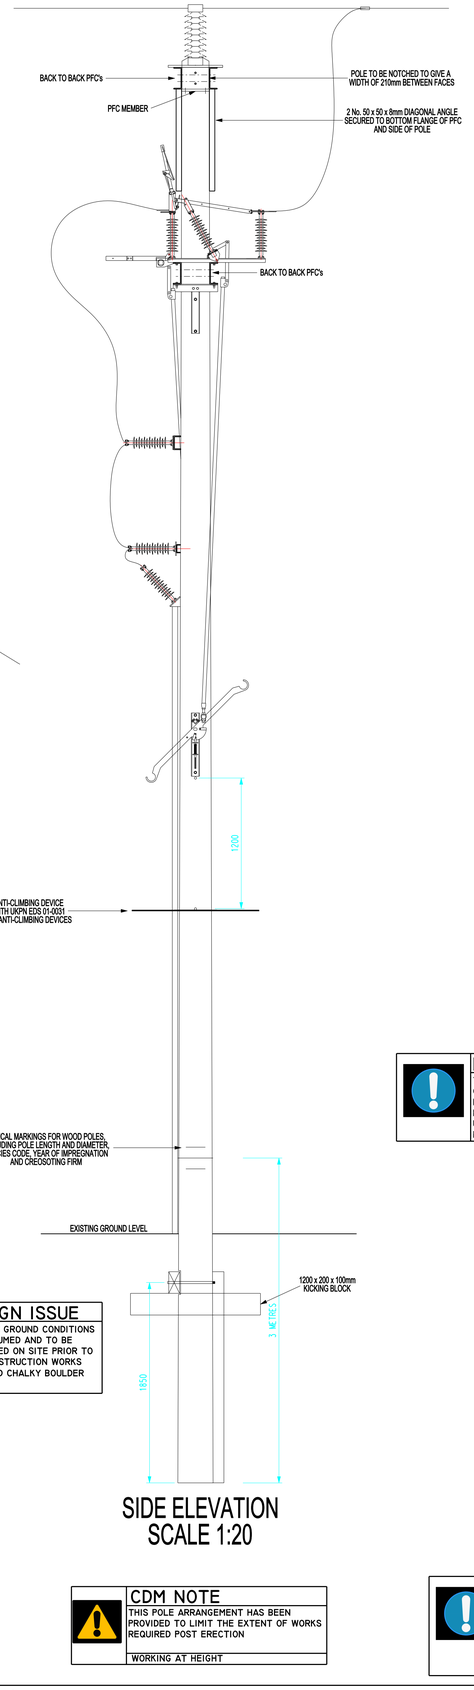

SIDE ELEVATION
SCALE 1:20

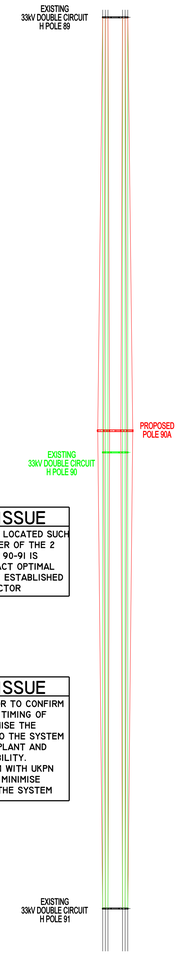

PLAN VIEW
SCALE 1:500

DESIGN ISSUE
POLE 90A TO BE LOCATED SUCH THAT THE LONGER OF THE 2 SPANS 89-90 OR 90-91 IS DECREASED. EXACT OPTIMAL LOCATION TO BE ESTABLISHED BY THE CONTRACTOR

DESIGN ISSUE
THE CONTRACTOR TO CONFIRM THE ORDER AND TIMING OF WORKS TO MINIMISE THE OVERALL RISK TO THE SYSTEM FROM REDUCED PLANT AND CIRCUIT AVAILABILITY. PLEASE CONFIRM WITH UKPN CONTROL AS TO MINIMISE DISRUPTION TO THE SYSTEM

DESIGN ISSUE
THE CONTRACTOR TO CHECK CONDITION OF EXISTING UP AND DOWN STREAM INSULATORS AND FIXINGS. UKPN TO REPLACE IF DEEMED NECESSARY

DESIGN ISSUE
ANY ADDITIONAL FOUNDATION STRUCTURE TBC UPON RECEIPT OF GROUND CONDITIONS

DESIGN ISSUE
EXISTING GROUND CONDITIONS ARE ASSUMED AND TO BE CONFIRMED ON SITE PRIOR TO ANY CONSTRUCTION WORKS (ASSUMED CHALKY BOULDER CLAY)

CDM NOTE
CONTRACTOR TO CONFIRM PRESENCE OF ANY SERVICES IN THIS AREA PRIOR TO COMMENCEMENT OF ANY EXCAVATION WORKS
POLE INSTALLATION

CDM NOTE
THIS POLE ARRANGEMENT HAS BEEN PROVIDED TO LIMIT THE EXTENT OF WORKS REQUIRED POST ERECTION
WORKING AT HEIGHT

NOTE
INFORMATION SHOWN ON THIS DRAWING IS INDICATIVE ONLY AND SUBJECT TO DETAILED DESIGN

Version	Date	DESCRIPTION	Designed Drawn
B	16-12-2013	FILLET ADDED TO LOWER PFC	MJN
A	2013-11-29	ORIGINAL	MJN

UK Power Networks

33kV POINT OF CONNECTION AT POLE NUMBER 90A - DRAPERS FARM

SCALE 1:20 @ A0 PRELIMINARY Checked Approved

DRAWING NO. HQ-2000-4718 Version B

SITE General Drawings

Copyright owned by UK Power Networks. This drawing may not be used or copied without written consent. Original CAD files shall not be issued outside the company and its contractors.