


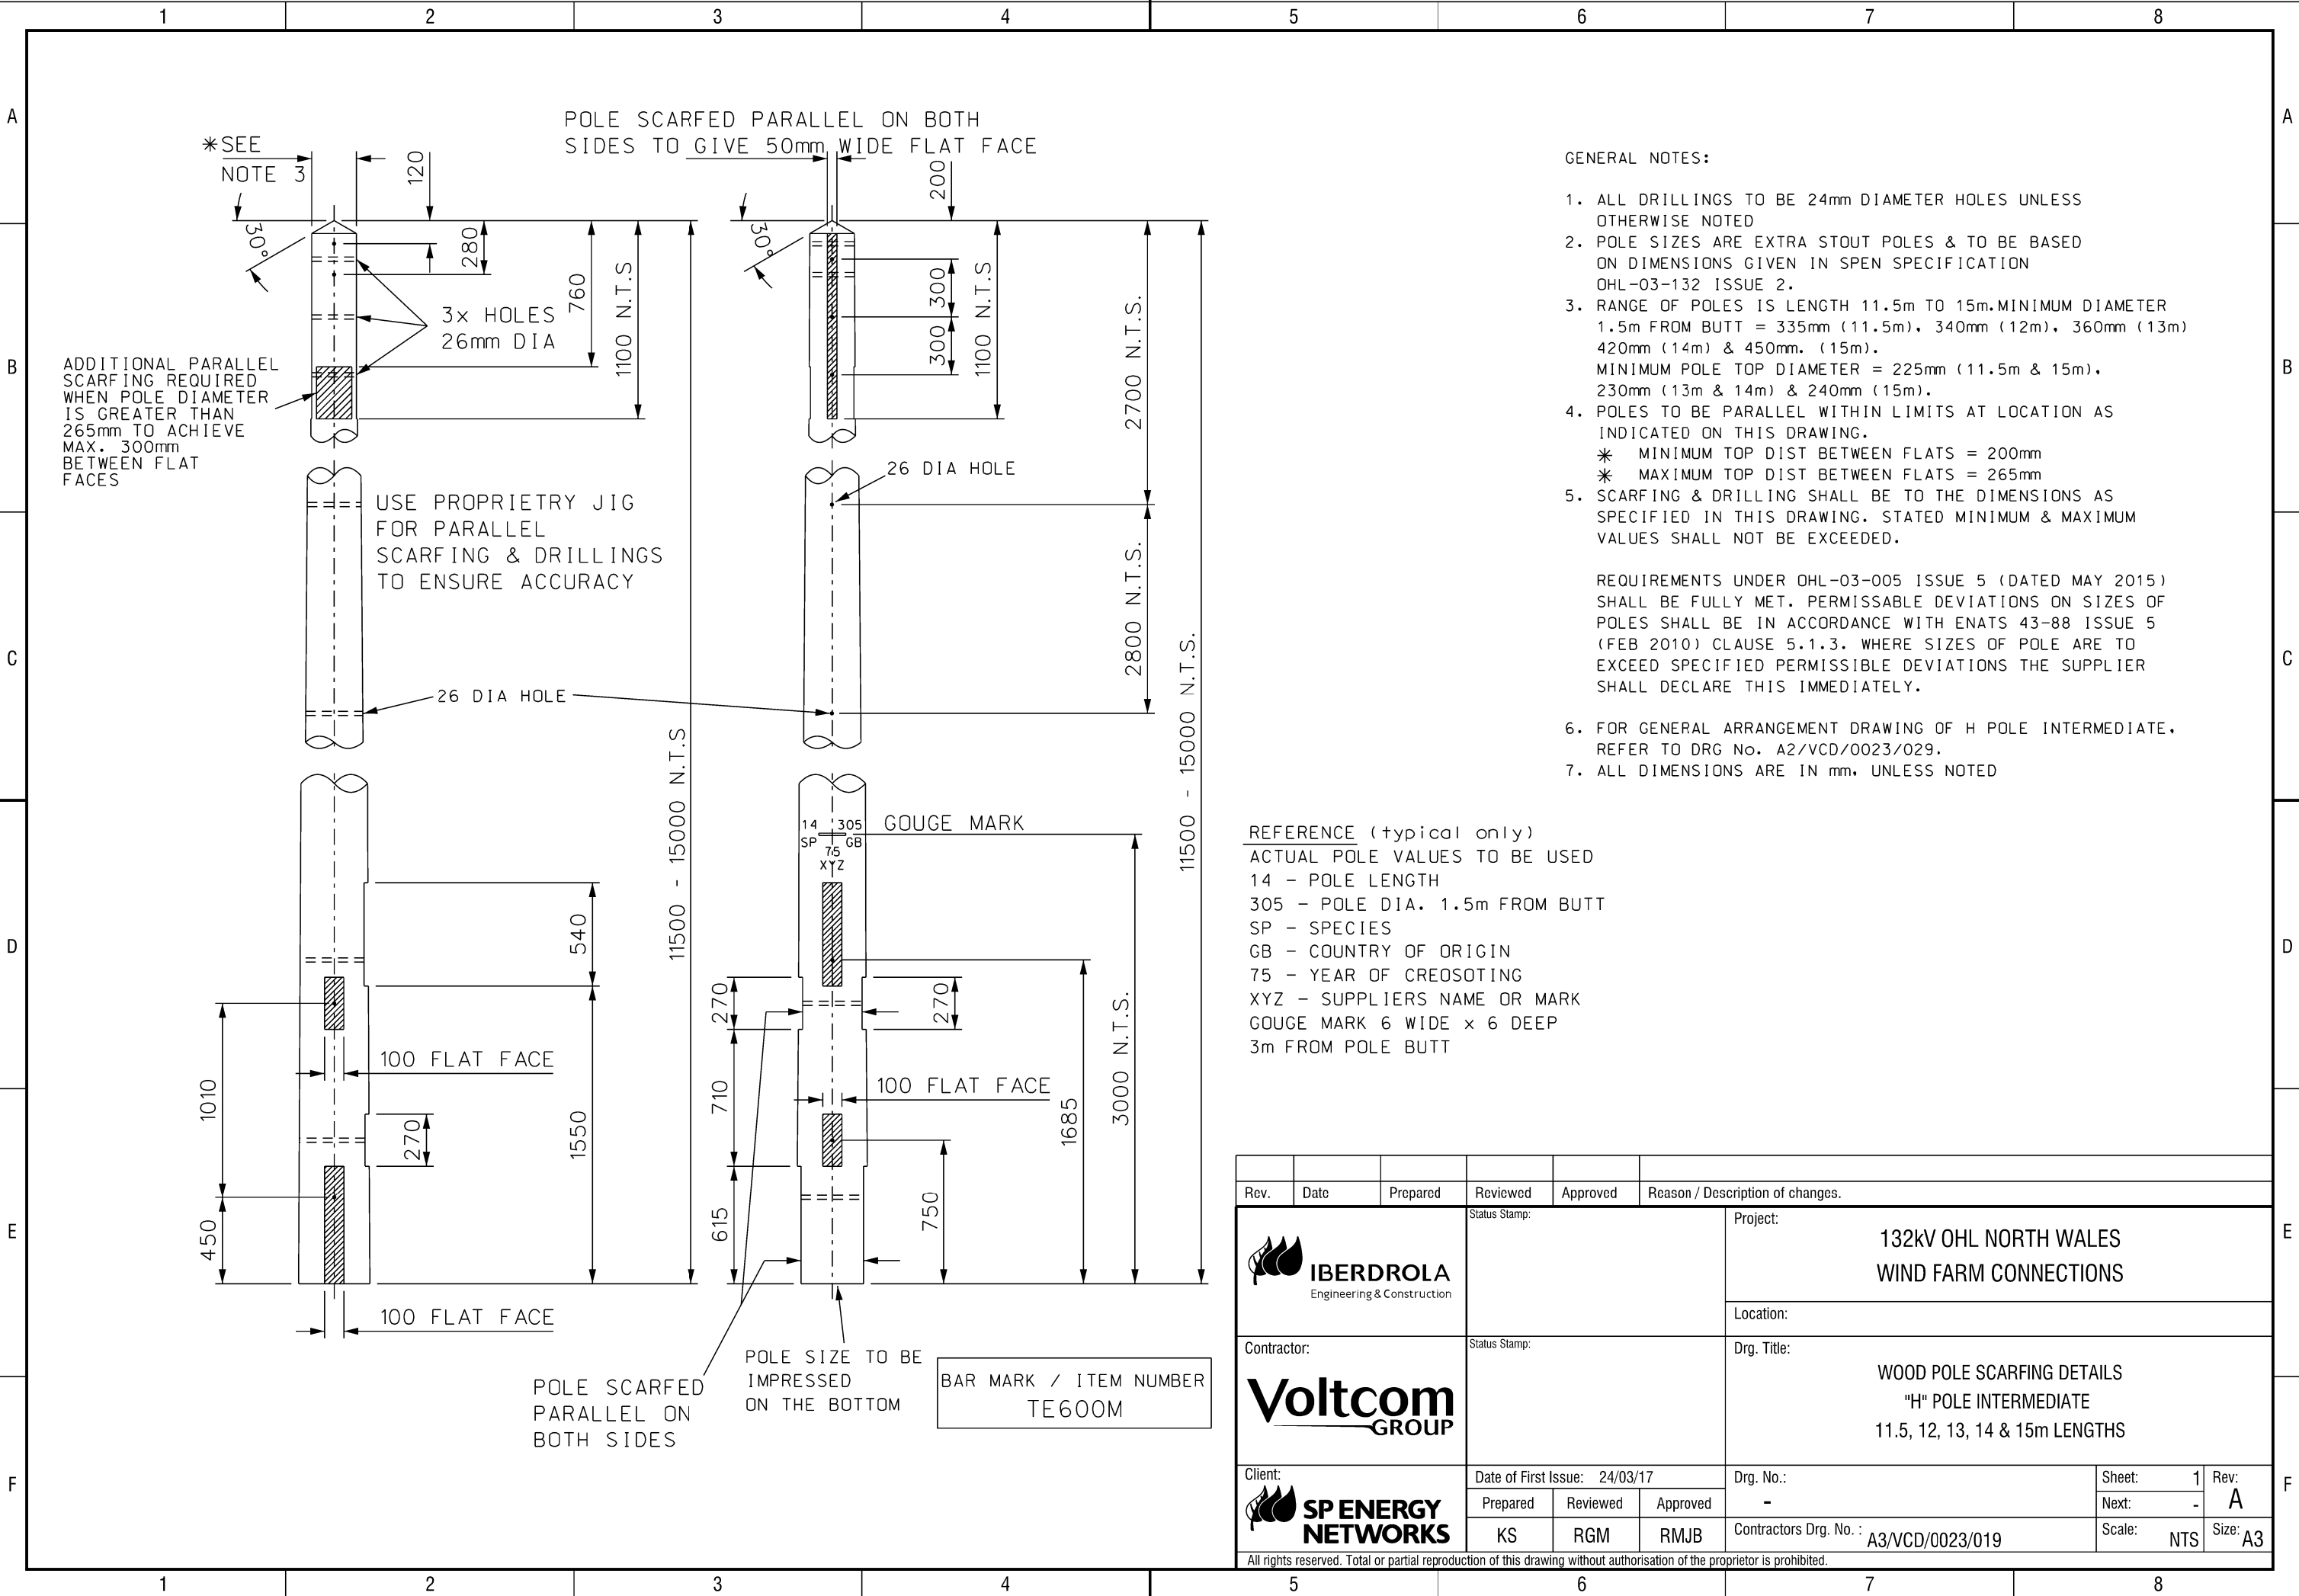

GENERAL NOTES:

1. ALL DRILLINGS TO BE 24mm DIAMETER HOLES UNLESS OTHERWISE NOTED
2. POLE SIZES ARE EXTRA STOUT POLES & TO BE BASED ON DIMENSIONS GIVEN IN SPEN SPECIFICATION OHL-03-132 ISSUE 2.
3. RANGE OF POLES IS LENGTH 11.5m TO 15m. MINIMUM DIAMETER 1.5m FROM BUTT = 335mm (11.5m), 340mm (12m), 360mm (13m) 420mm (14m) & 450mm. (15m). MINIMUM POLE TOP DIAMETER = 225mm (11.5m & 15m), 230mm (13m & 14m) & 240mm (15m).
4. POLES TO BE PARALLEL WITHIN LIMITS AT LOCATION AS INDICATED ON THIS DRAWING.
 - * MINIMUM TOP DIST BETWEEN FLATS = 200mm
 - * MAXIMUM TOP DIST BETWEEN FLATS = 265mm
5. SCARFING & DRILLING SHALL BE TO THE DIMENSIONS AS SPECIFIED IN THIS DRAWING. STATED MINIMUM & MAXIMUM VALUES SHALL NOT BE EXCEEDED.
6. FOR GENERAL ARRANGEMENT DRAWING OF H POLE INTERMEDIATE, REFER TO DRG No. A2/VCD/0023/029.
7. ALL DIMENSIONS ARE IN mm, UNLESS NOTED

REFERENCE (typical only)
ACTUAL POLE VALUES TO BE USED
14 - POLE LENGTH
305 - POLE DIA. 1.5m FROM BUTT
SP - SPECIES
GB - COUNTRY OF ORIGIN
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP
3m FROM POLE BUTT

Rev.		Date	Prepared	Reviewed	Approved	Reason / Description of changes.		
IBERDROLA		Engineering & Construction		Status Stamp:		Project: 132kV OHL NORTH WALES WIND FARM CONNECTIONS		
Contractor:		Status Stamp:		Drg. Title:		WOOD POLE SCARFING DETAILS "H" POLE INTERMEDIATE 11.5, 12, 13, 14 & 15m LENGTHS		
Client:		Date of First Issue: 24/03/17		Drg. No.:		Sheet: 1 Rev: A		
SP ENERGY NETWORKS		Prepared KS		Reviewed RGM		Approved RMJB		Next: -
All rights reserved. Total or partial reproduction of this drawing without authorisation of the proprietor is prohibited.		Contractors Drg. No. : A3/VCD/0023/019		Scale: NTS		Size: A3		