


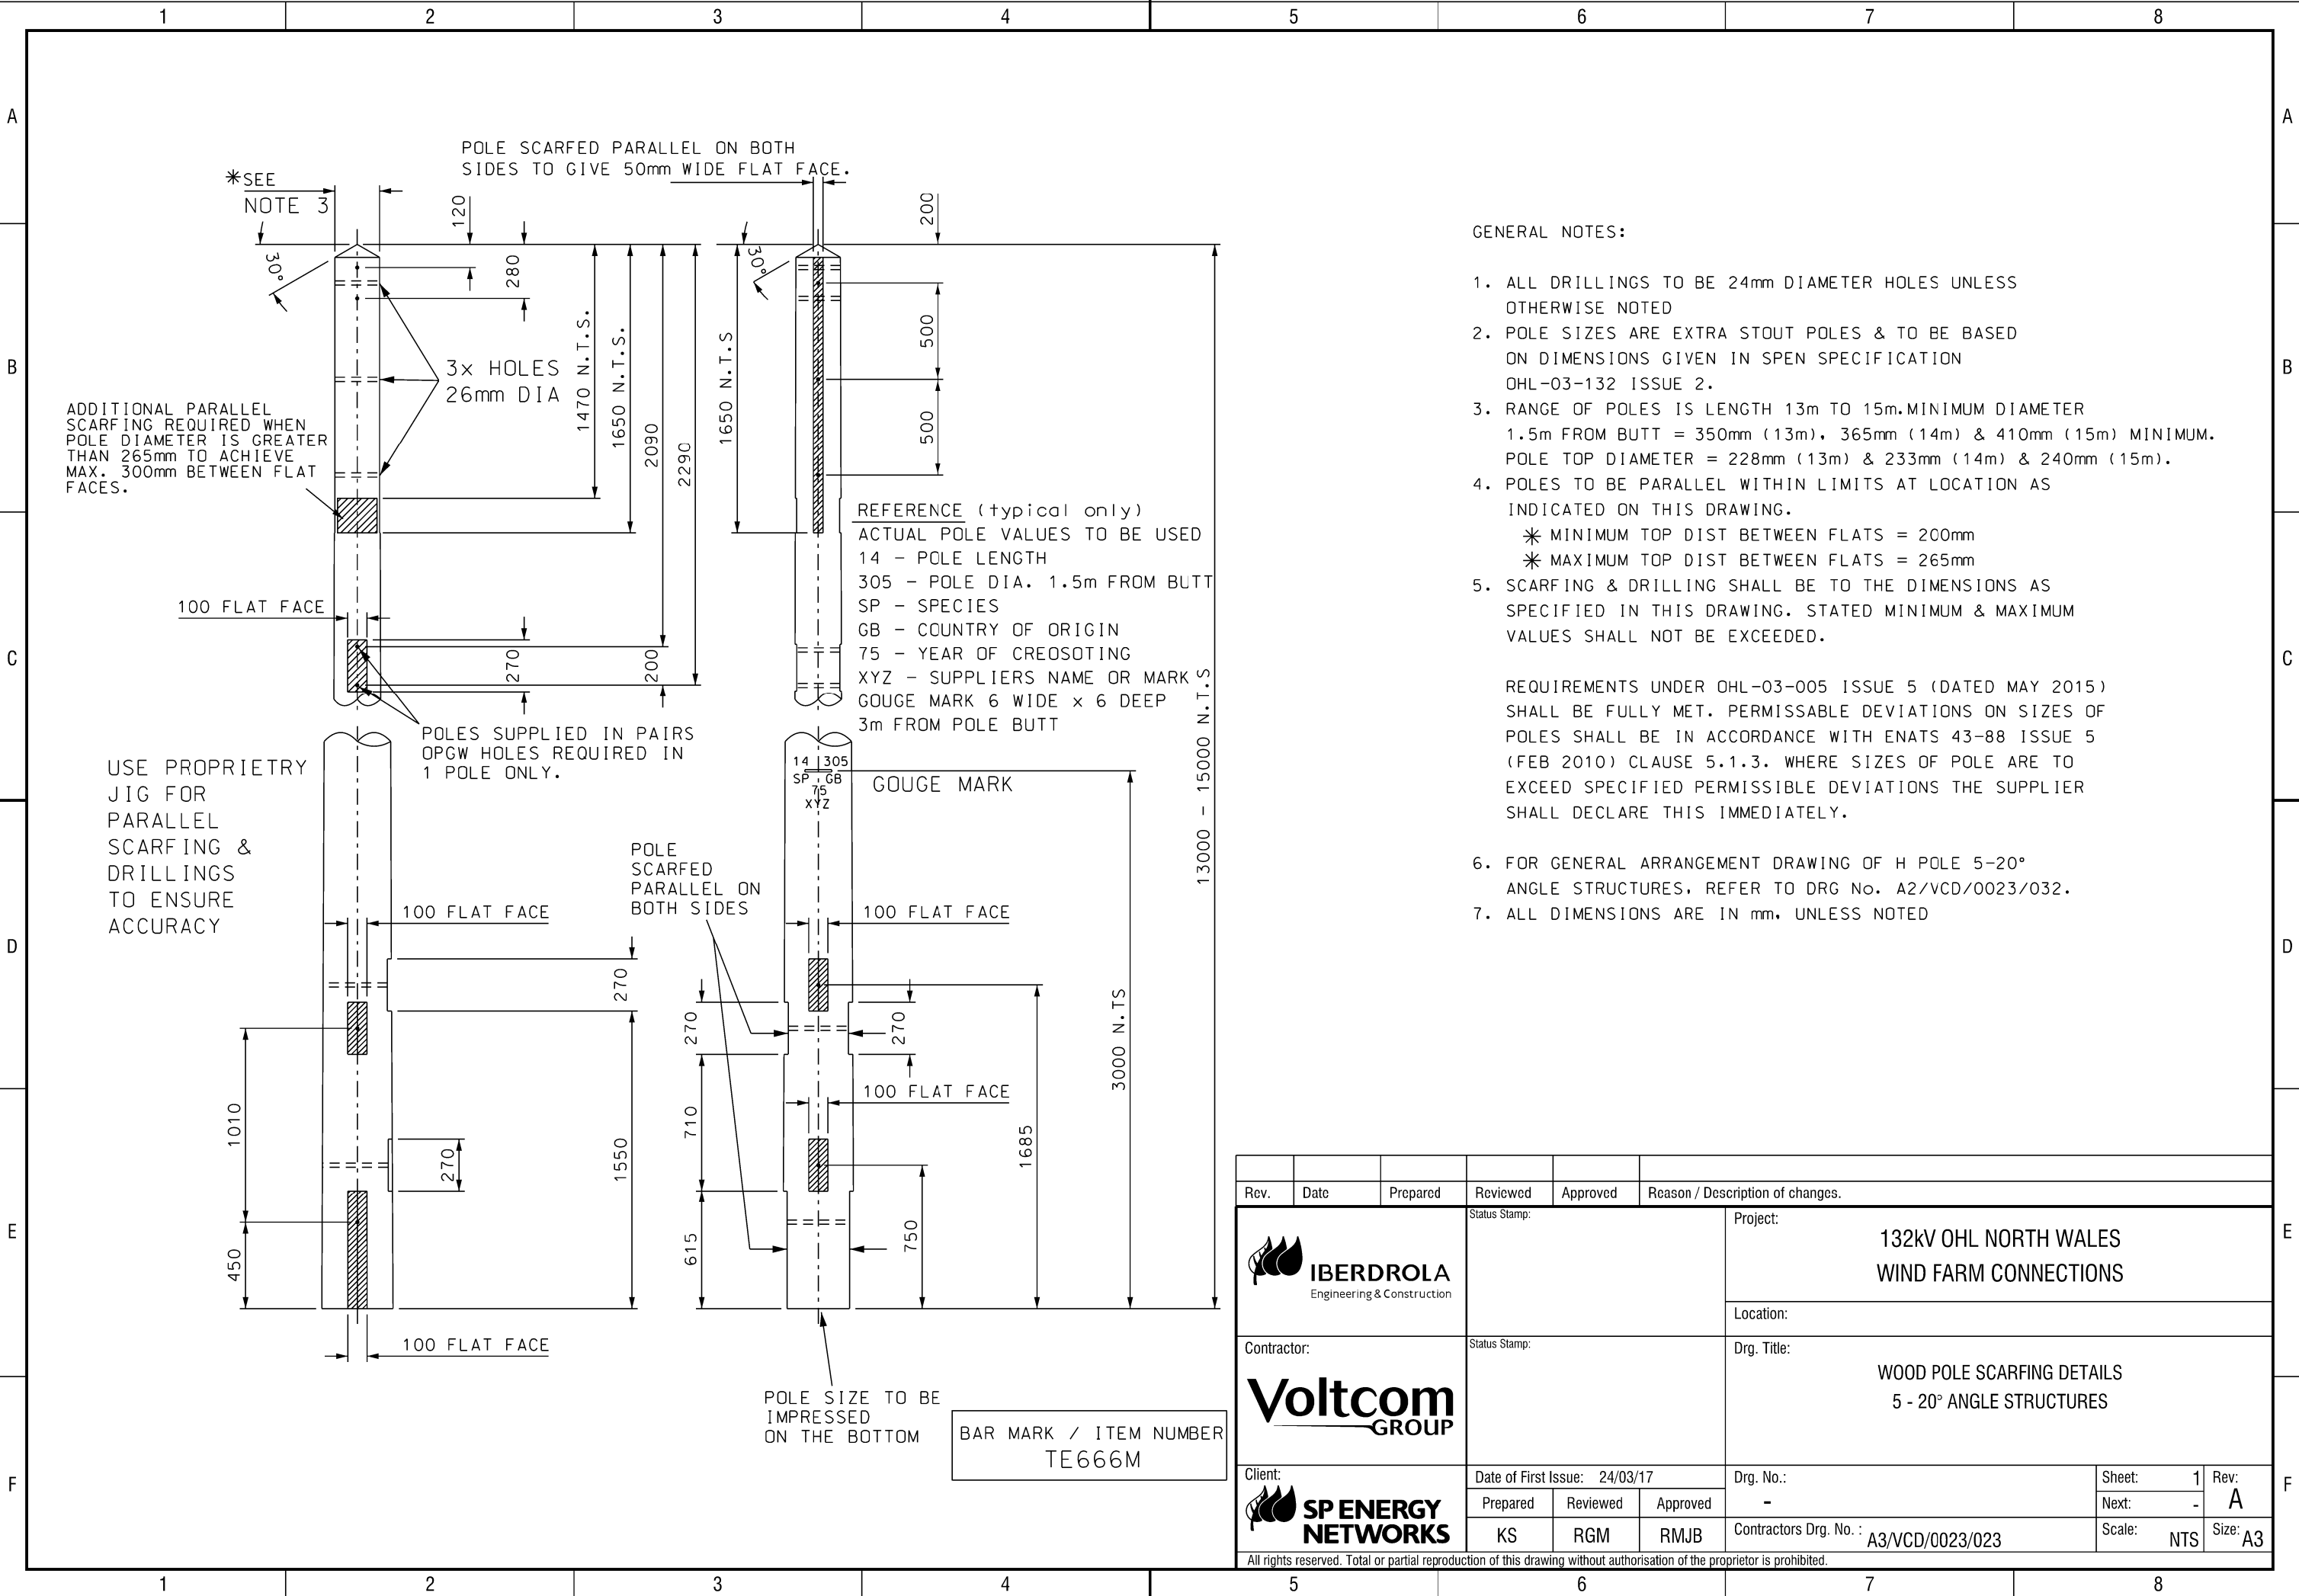

GENERAL NOTES:

1. ALL DRILLINGS TO BE 24mm DIAMETER HOLES UNLESS OTHERWISE NOTED
2. POLE SIZES ARE EXTRA STOUT POLES & TO BE BASED ON DIMENSIONS GIVEN IN SPEN SPECIFICATION OHL-03-132 ISSUE 2.
3. RANGE OF POLES IS LENGTH 13m TO 15m. MINIMUM DIAMETER 1.5m FROM BUTT = 350mm (13m), 365mm (14m) & 410mm (15m) MINIMUM. POLE TOP DIAMETER = 228mm (13m) & 233mm (14m) & 240mm (15m).
4. POLES TO BE PARALLEL WITHIN LIMITS AT LOCATION AS INDICATED ON THIS DRAWING.
 - * MINIMUM TOP DIST BETWEEN FLATS = 200mm
 - * MAXIMUM TOP DIST BETWEEN FLATS = 265mm
5. SCARFING & DRILLING SHALL BE TO THE DIMENSIONS AS SPECIFIED IN THIS DRAWING. STATED MINIMUM & MAXIMUM VALUES SHALL NOT BE EXCEEDED.
6. FOR GENERAL ARRANGEMENT DRAWING OF H POLE 5-20° ANGLE STRUCTURES, REFER TO DRG No. A2/VCD/0023/032.
7. ALL DIMENSIONS ARE IN mm, UNLESS NOTED

REQUIREMENTS UNDER OHL-03-005 ISSUE 5 (DATED MAY 2015) SHALL BE FULLY MET. PERMISSABLE DEVIATIONS ON SIZES OF POLES SHALL BE IN ACCORDANCE WITH ENATS 43-88 ISSUE 5 (FEB 2010) CLAUSE 5.1.3. WHERE SIZES OF POLE ARE TO EXCEED SPECIFIED PERMISSIBLE DEVIATIONS THE SUPPLIER SHALL DECLARE THIS IMMEDIATELY.

Rev.	Date	Prepared	Reviewed	Approved	Reason / Description of changes.			
IBERDROLA Engineering & Construction Contractor:  Client: 			Status Stamp:		Project: 132kV OHL NORTH WALES WIND FARM CONNECTIONS			
			Status Stamp:		Location:			
			Status Stamp:		Drg. Title: WOOD POLE SCARFING DETAILS 5 - 20° ANGLE STRUCTURES			
			Date of First Issue: 24/03/17		Drg. No.: -		Sheet: 1	Rev: A
			Prepared	Reviewed	Approved	Contractors Drg. No. : A3/VCD/0023/023		Next: -
			KS	RGM	RMJB	Scale: NTS		Size: A3

All rights reserved. Total or partial reproduction of this drawing without authorisation of the proprietor is prohibited.