


See ME 90/2 & ME 90/3
for conductor termination.

Dimension	33kv	66kv
A	3'-6" (1.07)	5'-0" (1.53)
B	1'-5" (430)	2'-11" (890)

Spacing Blocks:- 12" (305) x 5" (125) cut 2" (50)
longer than dressed face. Pole dressing 1/2" (13)
deep, square cut & drilled for two bolts 6" (150) centres at
positions shown. Poles to be matched & assembled at suppliers yard.

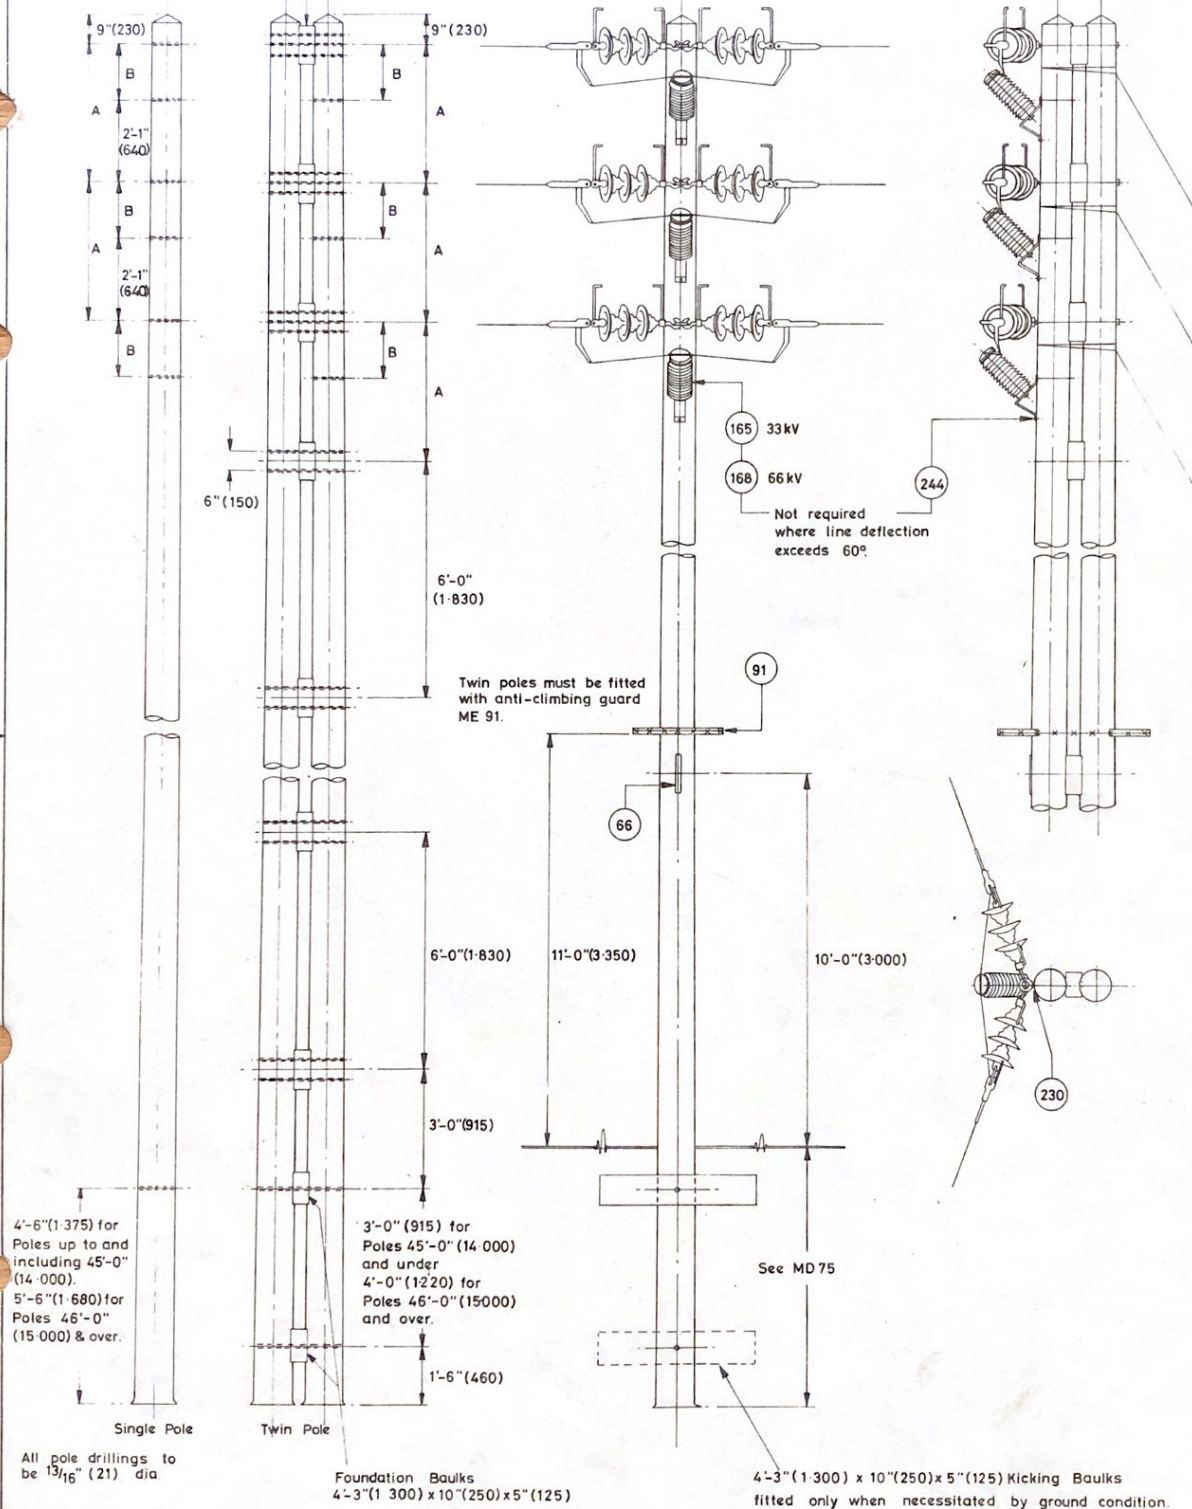

SCALE	1/50
DATE	8-10-74
DRAWN	W B
TRACED	P G
CHECKED	
APPROVED	

33kv & 66kv CONSTRUCTION VERTICAL SECTION ANGLE POLE

ISSUE	ISSUE
D	E
Redrawn & metricated.	Conductor termination note added.
ARB 26-2-76	RAC 25-1-78

MIDLANDS
ELECTRICITY BOARD

MP 21.