

INTERMEDIATE POLE

SECTION POLE & ANGLE 0° TO 10°

ANGLE POLE (ANGLES 10° TO 60°)

U BOLTS TO
Y003 X 220G

CROSSARM TO Y003 X 3310

SUSPENSION INSULATOR
STRINGS TO Y003 X 220G

LENGTH OF POLE TO SUIT SITE CONDITIONS

PLATE FIXING
TO Y003 X 3511

DANGER PLATE TO
Y003 X 3512

NUMBER PLATE
TO Y003 X 350G

POLES TO
Y003 X 3103

FOUNDATION BALKS
TO Y003 X 3201 TYPE 2

FRONT ELEVATION

SIDE ELEVATION

CROSSARM TO Y003 X 3311

STAY FOR ANGLE
POSITIONS ONLY

POLE BRACING FOR
ANGLE POSITIONS ONLY
TO Y003 X 3103

LENGTH OF POLE TO SUIT SITE CONDITIONS

DANGER PLATE TO
Y003 X 3512

NUMBER PLATE
TO Y003 X 350G

PLATE FIXING
TO Y003 X 3511

POLES TO
Y003 X 3103

FOUNDATION BALKS
TO Y003 X 3201 TYPE 3

FRONT ELEVATION

SIDE ELEVATION

TENSION INSULATOR STRINGS
ACSR CONDUCTORS Y003 X 2204
CU CONDUCTORS Y003 X 2207

ALTERNATIVE CG AV
LINE POST INSULATOR

CROSSARM TO Y003 X 3312

33 kV PIN INSULATOR
TO Y003 X 2106
PIN TO B.S. 3282 PART 2
REF 50

TENSION INSULATOR STRINGS
ACSR CONDUCTORS Y003 X 2204
CU CONDUCTORS Y003 X 2207

STAY DISPOSITION

NO. OF STAYS	DISPOSITION
1	OUTER LIMB
2	OUTER LIMB
3	2 ON INNER LIMB 1 ON OUTER LIMB

SINGLE BRACING REQUIRED
ONLY FOR POLES UP TO &
INCLUDING 45°-0" DOUBLE
BRACING FOR POLES 50°-0"
& ABOVE

LENGTH OF POLE TO SUIT SITE CONDITIONS

DANGER PLATE TO
Y003 X 3512

NUMBER PLATE
TO Y003 X 350G

PLATE FIXING
TO Y003 X 3511

PERMALI STAY
INSULATOR &
ARCING HORNS TO
Y003 X 3207

POLES TO
Y003 X 3103

GALVANISED M.S. BRACING
TO Y003 X 3103


FOUNDATION BALKS
TO Y003 X 3201 TYPE 3

FRONT ELEVATION


SIDE ELEVATION

STAY ROD TO
Y003 X 3204


STAY BALK
TO Y003 X 3201
(TYPE 2)

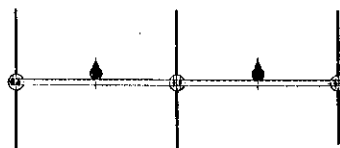

PLAN

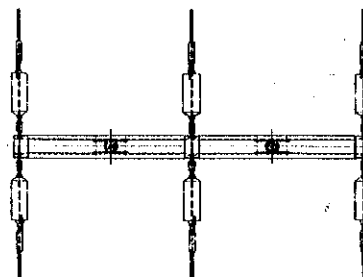

PLAN

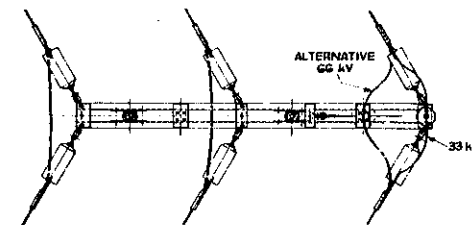

PLAN

POLE LENGTH IN FEET	DIMENSION X
UP TO & INC. 35'-0"	6'-0"
39'-0" TO 42'-0"	6'-6"
45'-0" TO 50'-0"	7'-0"
51'-0" TO 55'-0"	7'-6"
OVER 55'-0"	8'-0"

OVERHEAD LINES SPEC CE/C/37

GENERAL ARRANGEMENT OF
INTERMEDIATE SECTION & ANGLE POLES

Yorkshire Electricity Board

Y003 X 1103