


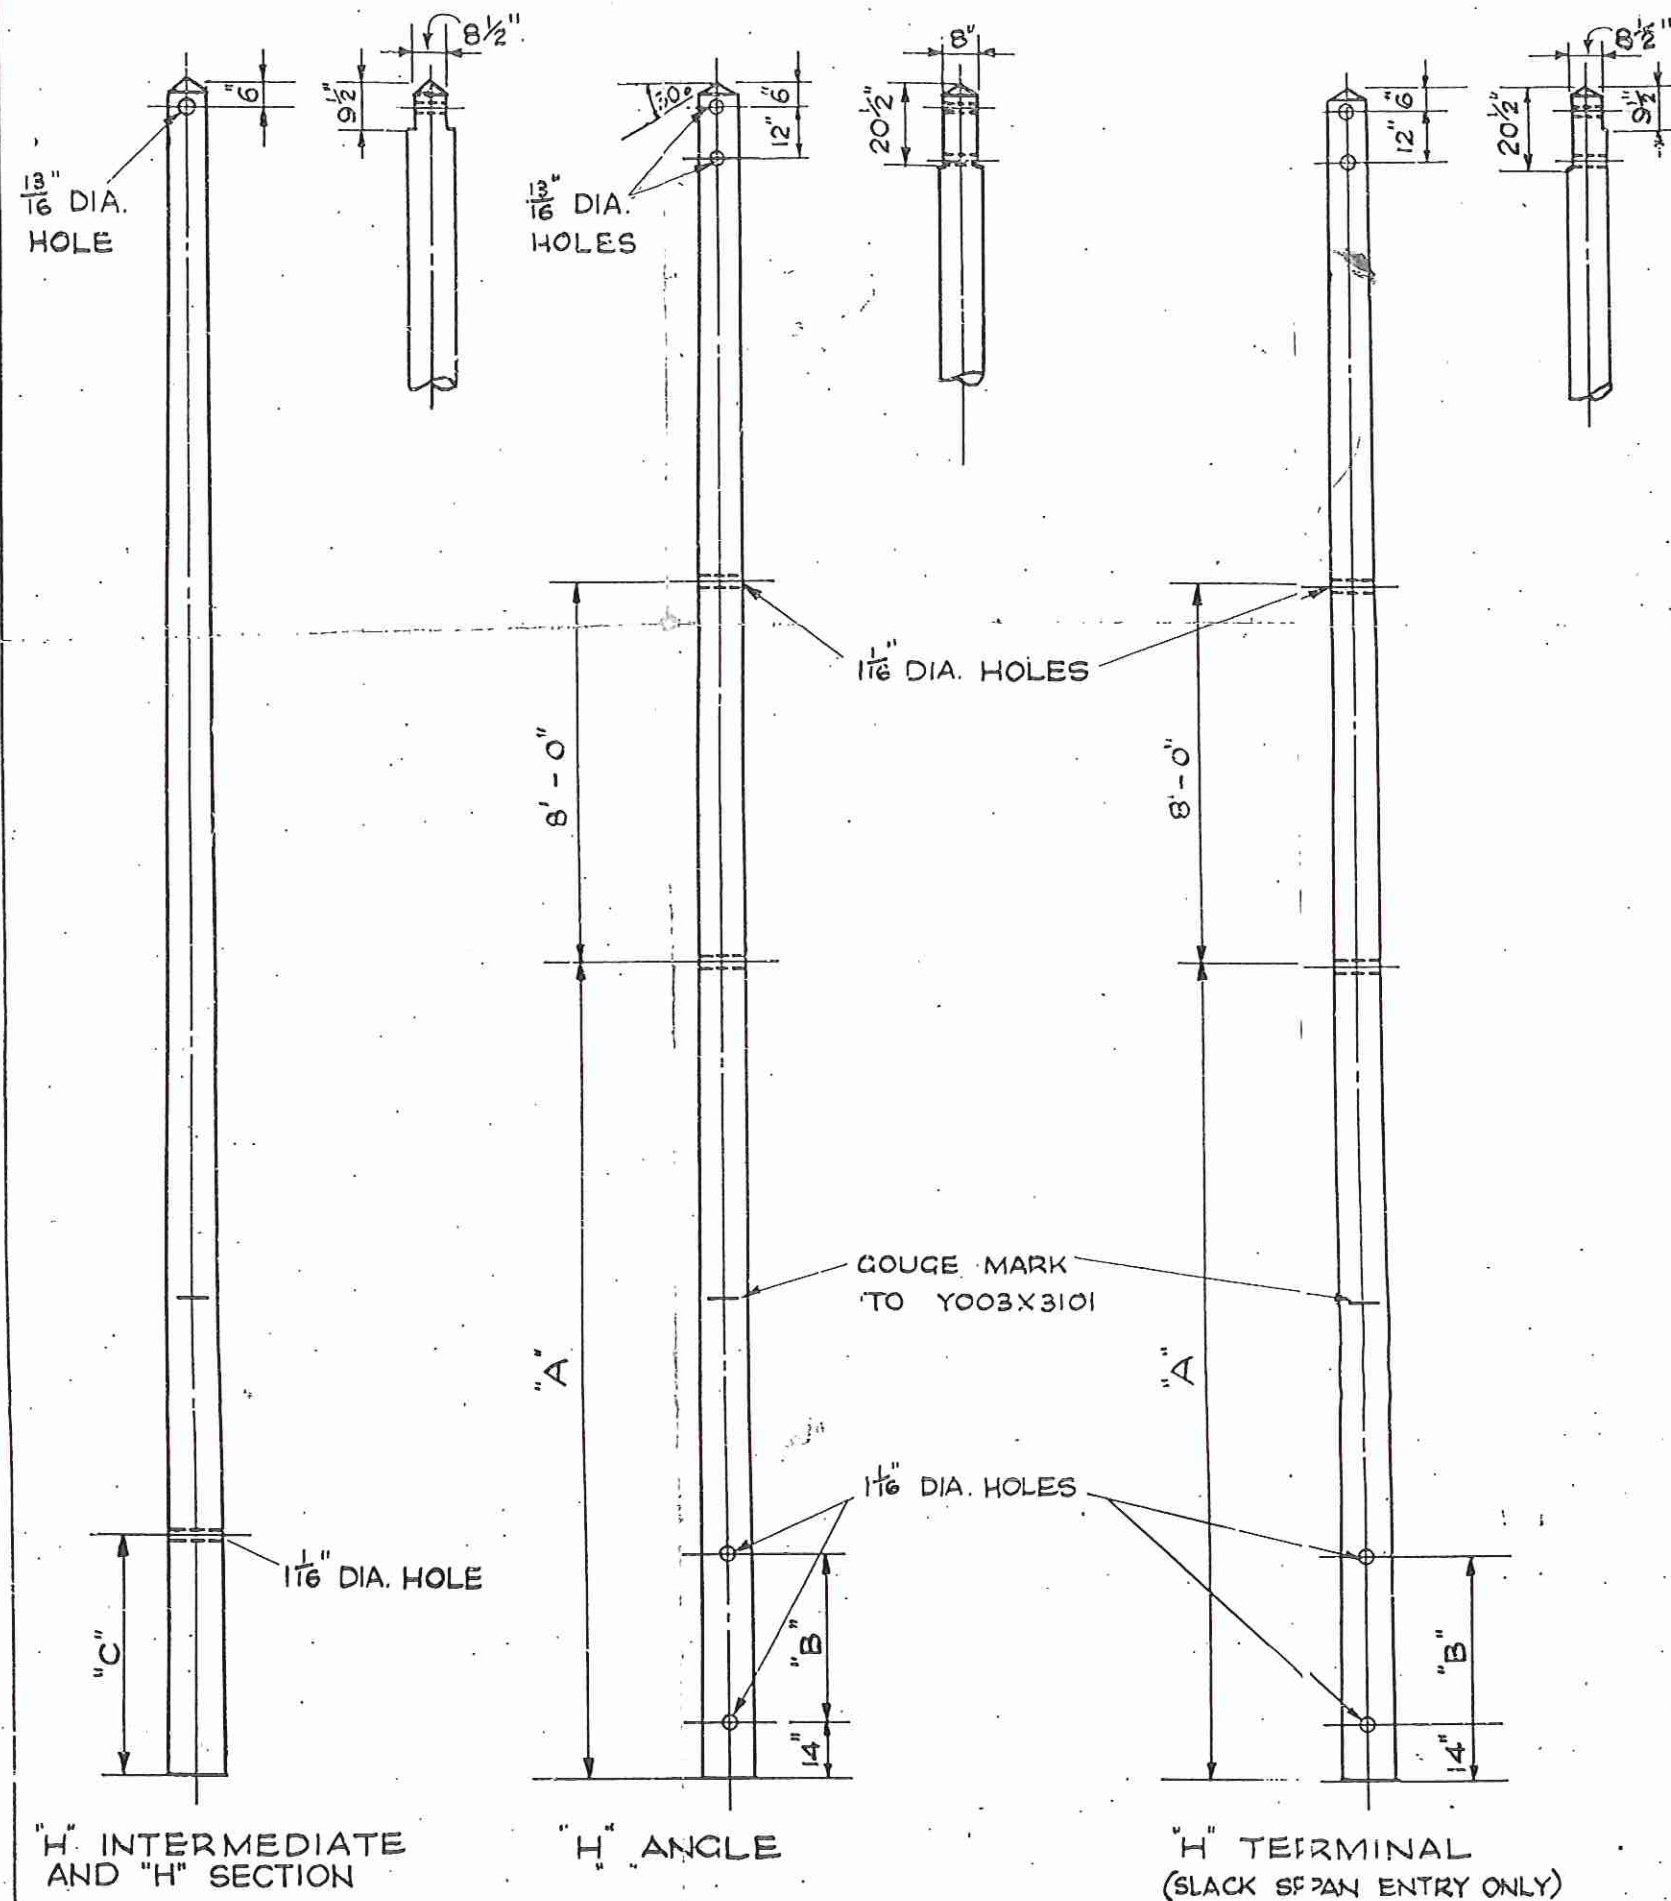

NOTES

- POLES TO BE STOUT CLASS TO B.S. 1990, CREOSOTED TO B.S. 913 BY THE RUEPING PROCESS AFTER ALL DRILLING AND SCARFING IS COMPLETE.
- POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS FROM 1 ONWARDS.
- POLES SELECTED FOR ANGLE AND TERMINAL STRUCTURES TO HAVE A POLE TOP DIAMETER NOT LESS THAN $\frac{3}{4}$ " (20mm) ABOVE THE MINIMUM SPECIFIED IN BS 1990, TABLE 3
- POLE TOP DIAMETER BEFORE SCARFING TO BE NOT LESS THAN 8" (205mm) FOR INTERMEDIATE SUPPORTS AND 8 1/2" (215mm) FOR SECTION SUPPORTS. SCARFING ONLY REQUIRED WHERE THE POLE TOP DIAMETER EXCEEDS 8 1/2" (215mm)
- BRACINGS TO Y003X3105 REQUIRED ON ANGLE AND TERMINAL POLES ONLY. (6)

POLE LENGTH METRES	FEET	DIM 'A'	DIM 'B'	DIM 'C'
UP TO 11.5	UP TO 38'-0"	19'-0"	2'-10"	4'-6"
12 - 13	40'-0"-42'-0"	19'-0"	3'-4"	5'-0"
14	45'-0"	22'-0"	3'-10"	5'-6"
15	50'-0"	19'-0" 2 SETS OF BRACING	3'-10"	5'-6"
16		22'-0" 2 SETS OF BRACING	4'-4"	6'-0"
17	55'-0"	24'-0" 2 SETS OF BRACING	4'-4"	6'-0"
18	60'-0"	27'-0" 2 SETS OF BRACING	4'-10"	6'-6"
20		34'-0" 2 SETS OF BRACING	4'-10"	6'-6"
22		39'-0" 2 SETS OF BRACING	4'-10"	6'-6"

ISSUED

01 AUG 1991

drawn
traced J.A.
checked P.
date 11.4.69
scale 1/4" TO 1 FT.

HV OVERHEAD LINES SPEC. CE/C/37

POLE DETAILS FOR PORTAL SUPPORTS

Yorkshire Electricity Board

Y003X3103 A

A TABLE AND NOTES
MODIFIED. HEIGHT TO COUGE
MARK REMOVED NF 3.6.77.

C

D